

Arroyo Water Well Supply

Sales & Service of Complete Water Systems
CONTRACTORS LICENSE NO. 475150

MAY 6, 2016

HANS C HANSEN & DENISE A HANSEN

2480 MESA RANCH ROAD

ARROYO GRANDE, CA. 93420

4 HOUR WELL TEST

TIME	GPM	WATER LEVEL
10:00am	15	63'
10:15	15	73
10:30	15	74
10:45	15	74
11:00	15	74
11:15	15	74
11:30	15	74
11:45	15	74
12:00pm	15	74
12:15	15	74
12:30	15	74
12:45	15	74
1:00	15	74
1:15	15	74
1:30	15	74
1:45	15	74
2:00	15	74
2:05	RECOVERY	63'

WELL # 2 IS 35' AWAY FROM WELL # 1 (WATER LEVEL 62', 62.5' WHILE WELL # 1 WAS PUMPING)




BARBARA C. RALPH, PRES.

ARROYO WATER WELL SUPPLY

ARROYO WATER WELL SUPPLY

TO: DON BALLA
2480 MESA RANCH RD., A.G.
 TELEPHONE: 951-538-4571
 FAX #: _____

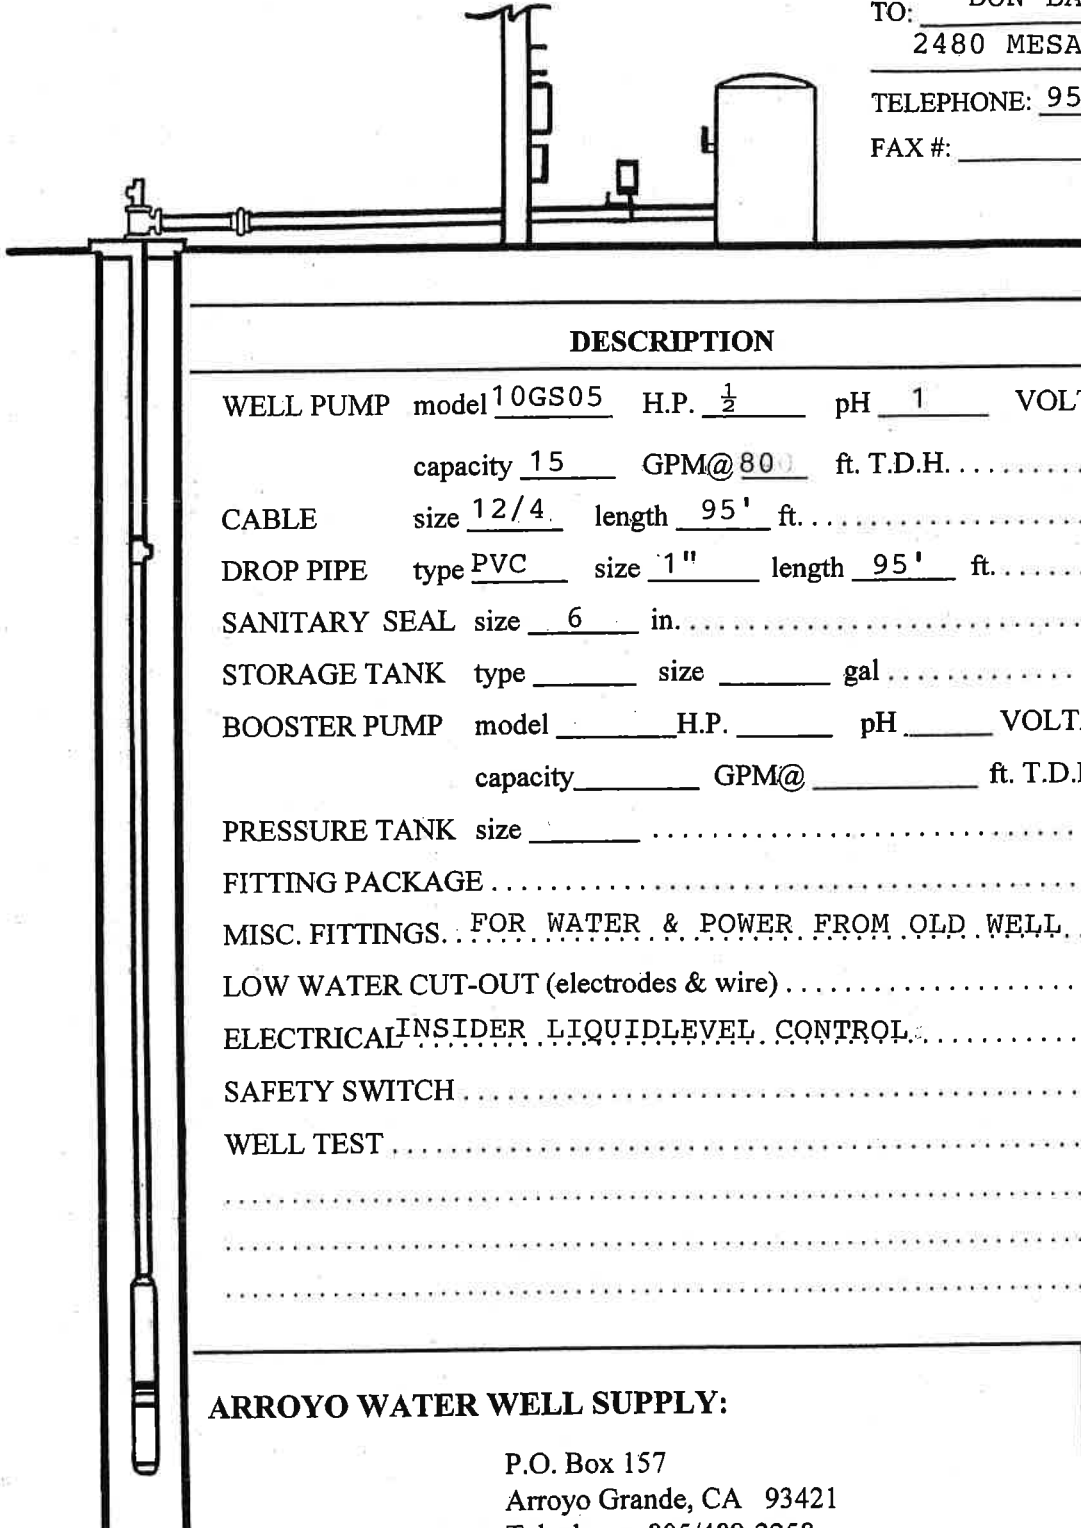

DESCRIPTION	PRICE
WELL PUMP model <u>10GS05</u> H.P. <u>1/2</u> pH <u>1</u> VOLTAGE <u>230</u> capacity <u>15</u> GPM@ <u>80</u> ft. T.D.H.	765.00
CABLE size <u>1 2/4</u> length <u>95'</u> ft.	140.50
DROP PIPE type <u>PVC</u> size <u>1"</u> length <u>95'</u> ft.	275.50
SANITARY SEAL size <u>6</u> in.	54.15
STORAGE TANK type _____ size _____ gal	
BOOSTER PUMP model _____ H.P. _____ pH _____ VOLTAGE _____ capacity _____ GPM@ _____ ft. T.D.H.	
PRESSURE TANK size _____	
FITTING PACKAGE	
MISC. FITTINGS FOR WATER & POWER FROM OLD WELL	250.00
LOW WATER CUT-OUT (electrodes & wire)	
ELECTRICAL INSIDER LIQUID LEVEL CONTROL	191.43
SAFETY SWITCH	100.00
WELL TEST	

ARROYO WATER WELL SUPPLY:

P.O. Box 157
 Arroyo Grande, CA 93421
 Telephone: 805/489-2258
 FAX No.: 805/489/6291

Sub Total	1,776.58
Sales Tax	142.13
Installation	90.00
TOTAL PRICE	2,008.71

SUBMITTED BY: *Don Balla*
DEALER'S SIGNATURE
 DATE: AUG. 19, 2016

THIS ESTIMATE IS GOOD FOR 30 DAYS.
 TERMS OF PAYMENT: NET 30 DAYS. 1 1/2% per month will be charged on all past due accounts.

ACCEPTED BY: _____
CUSTOMER'S SIGNATURE

Abalone Coast Analytical, Inc.

141 Suburban Road, Suite C-1 San Luis Obispo CA, 93401
Phone: 595-1080 Fax: 595-1075

Order #: 16-2523

Date/Time Rec'd: 5/4/16 1546

Hans C. Hansen
2480 Mesa Ranch Rd.
Arroyo Grande, CA 93420

Contact: Hans Hansen
Phone: 489-8534
Sampler: Water Well Supply & Hans Hansen

Project: Mesa Ranch

Sample #	Sample Description	Date / Time	Analysis	Method	Result	MCL	Units	RL	Completed
-1	Well	5/4/16 1400	Nitrate - as N	EPA 300.0	25.0	10	mg/L	0.1	05/05/16
-2	After Treatment	5/4/16 1400	Nitrate - as N	EPA 300.0	3.5	10	mg/L	0.1	05/05/16
-3	Well	5/4/16 1300	MPN Total Coliform	SM 9223 B.	ND.		MPN/100mL	1	05/05/16
			MPN E-coli	IDEXX	ND.		MPN/100mL	1	05/05/16

Report Completion date: 5/6/16

Reviewed: 
Amanda Smith, Lab Director

ND = Analyte NOT DETECTED at or above RL

* Result detected below the RL are estimated concentration