

**TOWN OF PARADISE
ONSITE WASTEWATER MANAGEMENT ZONE
EVALUATION REPORT**

Permit Number: OS18-01412
AP Number: 052-050-030-000
Property Address: 714 CAMELLIA DR
Occupancy Type: Single Family

Primary Contact: JARED GILMORE
714 CAMELLIA DR.
PARADISE, CA 95969

Evaluation Date: 02/23/2018

Evaluator: RACHEL BARTLETT
CHICO SEPTIC

Evaluation Results

Pump Only	No
Access Risers in Place	Yes
Sanitary Tee - Inlet	Yes
Scum Depth, Inlet Compartment	8 Inches
Sludge Depth, Inlet Compartment	10 Inches
Structural Tank Condition	Good
Liquid from Operating Level	Normal
Baffle Condition	Good
Tank Volume	1200 Gallons
Riser Condition	Good
Sanitary Tee - Outlet	Yes
Scum Depth, Outlet Compartment	1 Inches
Sludge Depth, Outlet Compartment	2 Inches
Tank Material	Concrete
Septic Tank Pumping Required	No
Was Septic Tank Pumped	No
Depth to Septic Tank Access Lid - Inlet	1 Inches
Depth to Septic Tank Access Lid - Outlet	1 Inches
Effluent Pump	No
Effluent Line Diverter Valve	No
Well on Property	No
Common Area/Community Absorption Field	Yes
Absorption Field Type	Standard
Surfacing Effluent	No
Hydraulic Load Test	Yes
Hydraulic Load Test - Results	Excellent
Down Slope Seepage	No
Saturated Absorption Field	No
Multiple Systems	No
Graywater Discharge	No

Evaluator Comments

Everything is good working order.


Location Sketch

COMMENTS / OBSERVATIONS

COMMENTS: _____

This onsite wastewater treatment and disposal system evaluation report is a true and complete record of the onsite wastewater treatment and disposal system on the date of the evaluation. No warranty is given or implied regarding the remaining life of this system. I certify that this onsite wastewater treatment and disposal system evaluation report reflects conditions observed on the parcel (s) during the routine maintenance of the onsite wastewater treatment and disposal system.

EVALUATOR SIGNATURE: _____ DATE: _____

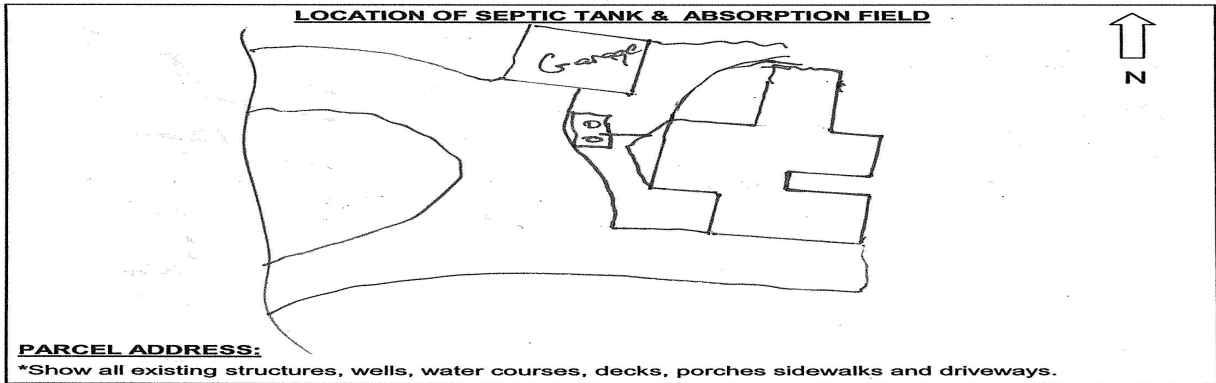

TOWN OF PARADISE USE ONLY
The onsite wastewater treatment and disposal system is in substantial compliance with Chapter 13.04 of the Paradise Municipal Code and the Town of Paradise Manual for the Treatment of Wastewater:

YES NO

TOWN OF PARADISE ONSITE WASTEWATER MANAGEMENT ZONE
5555 SKYWAY PARADISE, CA 95969
OFFICE: (530) 872-6291 FAX: (530) 877-5059