Paradise Sanitation Company
Septic System Evaluation

P.O. Box 3815
Paradise, CA 95967
530-877-3207

Evaluation Date January 29, 2019

Owner's Name: Requested by Remax of Paradise Phone No. 520-8545

Property Address: 6320 Bliss Ct

City, State, Zip: Magalia, CA 95954

Mailing Address: c/o Julie Rolls @ Remax

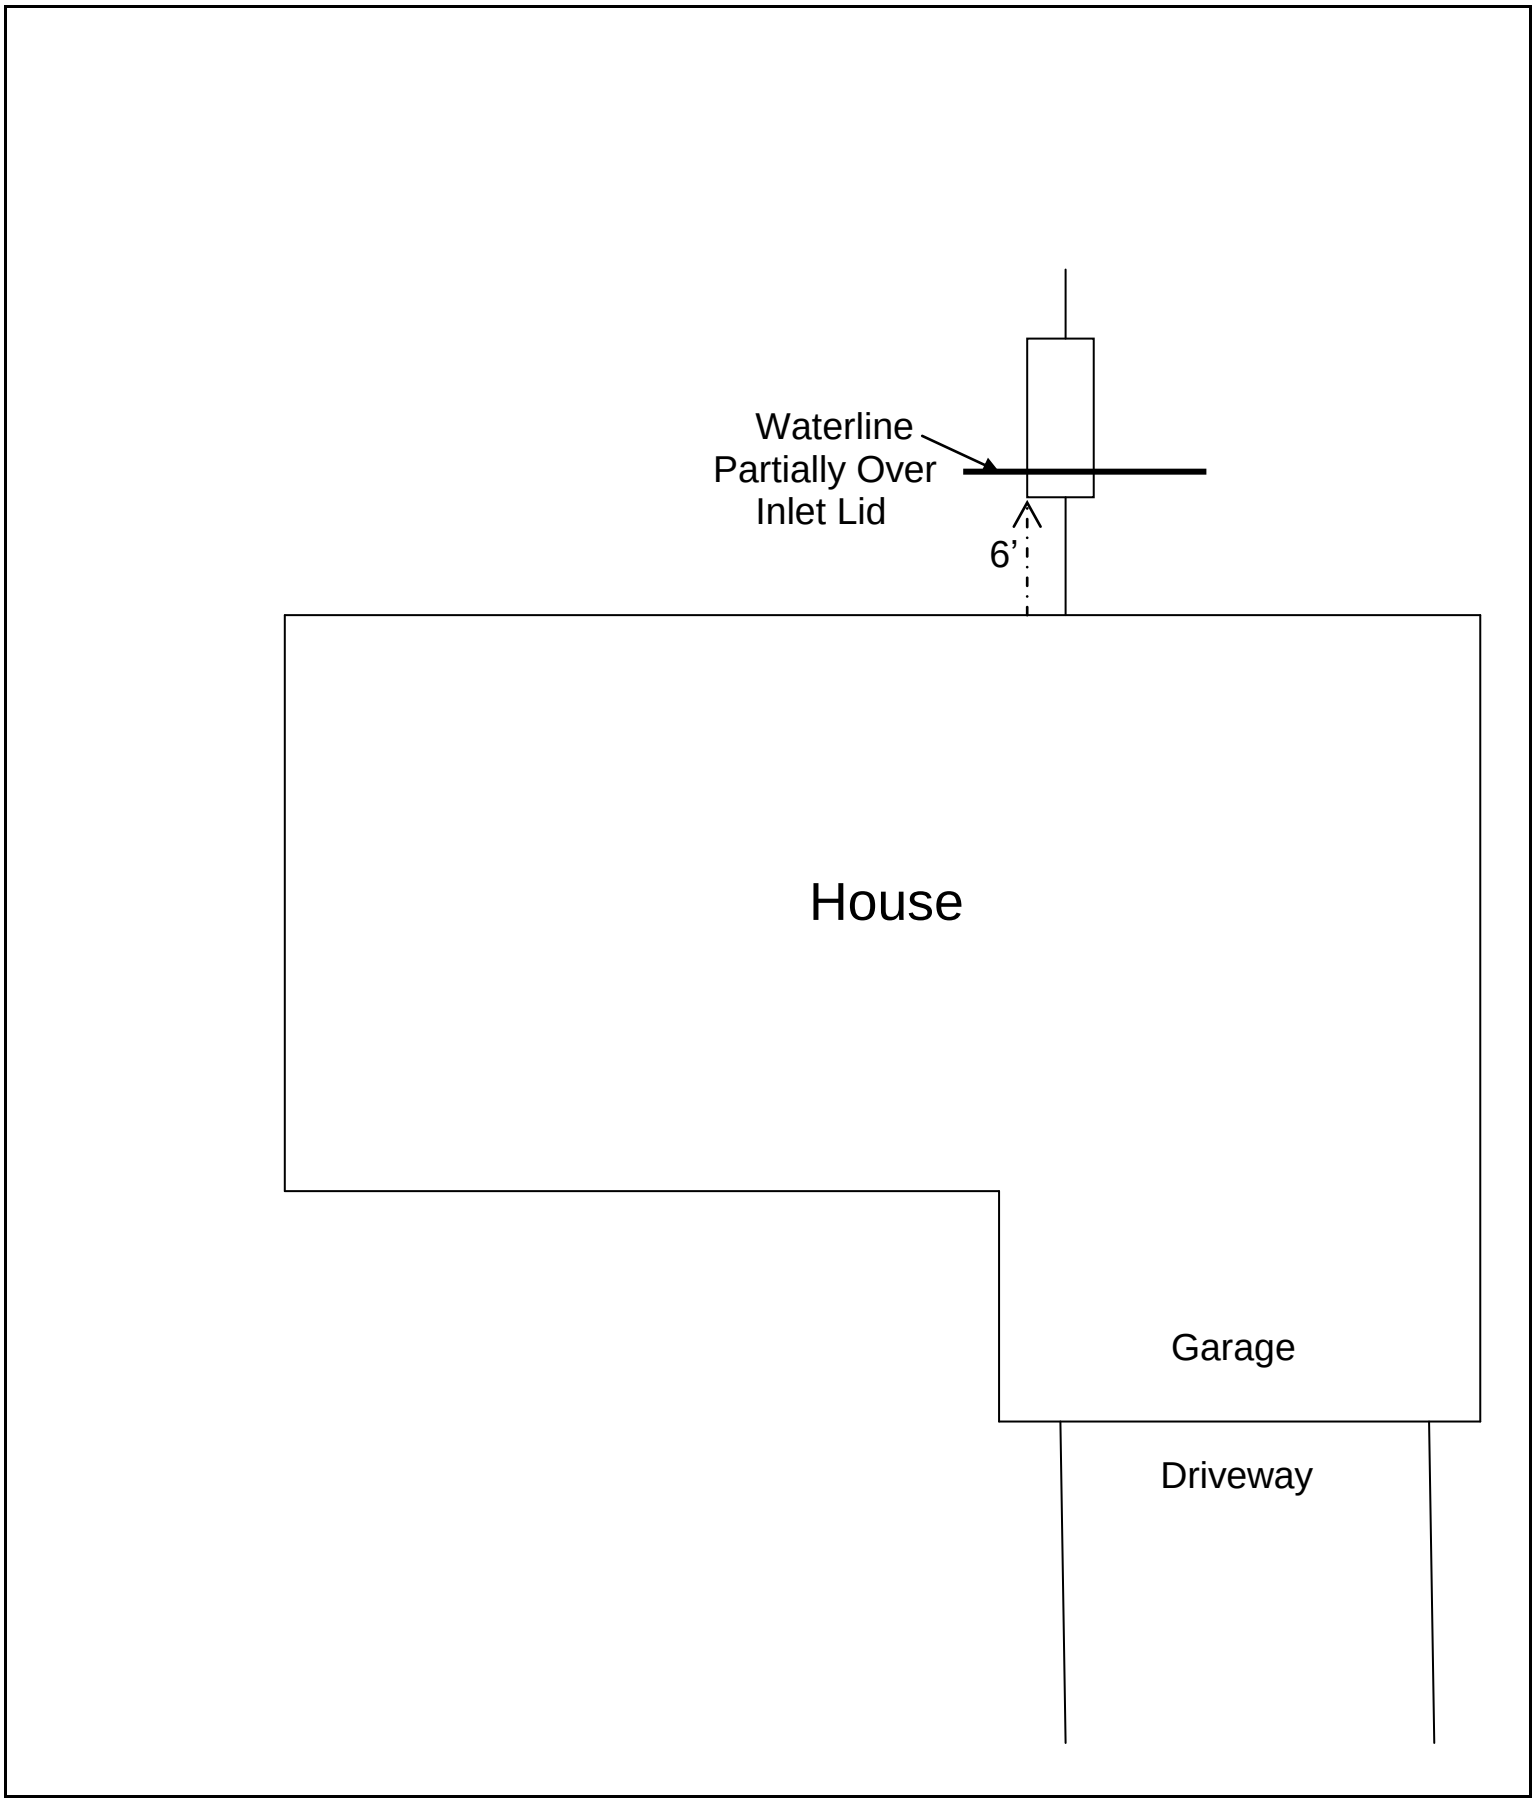
Evaluator: Paradise Sanitation Co – Mark Muhlbaier **License No.** s501

SEPTIC TANK OBSERVATIONS

Access Riser(s) in Place……[X] No [ ] Yes
Scum Depth, Inlet Compartment ..... 22 Inches
Sludge Depth, Inlet Compartment ..... 21 Inches
Structural Tank Condition..... [ ] Good [X] Fair [ ] Poor
Septic Tank Volume ..... 1000 Gallons
Scum Depth, Outlet Compartment..... 0 Inches
Sludge Depth, Outlet Compartment..... 18 Inches
Tank Material ..... [X] Concrete [ ] Poly/Fiberglass [ ] Other
Septic Tank Pumping Recommended..... [ ] No [X] Yes
Was Septic Tank Pumped..... [ ] No [X] Yes
Depth To Septic Tank Access Lid ..... Inches
Effluent Pump..... [X] No [ ] Yes
Hydraulic Load Test Results **[ ] Excellent [X] Good [ ] Satisfactory**
[ ] Marginal [ ] Poor [ ] FAILURE

Comments: <u>Tank appears to be structurally sound and absorption field is working normally.</u>

This onsite wastewater treatment and disposal system evaluation report is a true and complete record of the onsite wastewater treatment and disposal system on the date of the evaluation. No warranty is given or implied regarding the remaining life of this system. I certify that this onsite wastewater treatment and disposal system evaluation report reflects conditions observed on the parcel (s) during the routine inspection of the onsite wastewater treatment and disposal system.


Waterline
Partially Over
Inlet Lid
6’
House
Garage
Driveway