



The Original DOBRICH & SONS SEPTIC SERVICE

P.O. BOX 1681 MAGALIA, CA. 95954

(530)-873-9901

INVOICE

JOB SITE : 8919 Skyway			NEEDS WORK		
			YES	NO	X
CITY Paradise	DATE ORDERED 04/24/2023	SCHEDULE DATE 04/26/23	INSPECTION COMPLETED 04/26/23		
ORDERED BY: Joan Colyer joansindognito@gmail.com		BILL/REPORT TO:			
PHONE: (530)-327-4596					
ESCROW COMPANY:		OFFICER:		ESCROW:	
SPECIAL NOTES: Inspection of a 1500 Gallon Concrete Septic Tank. The Tank is 12" deep with Plastic Risers with Lids. The Inlet and Outlet Tees are intact. There is 0" of Scum and 2" of Sludge in the Inlet side of the Tank. The Effluent level in the Tank is normal. The Septic Tank and Risers are in good condition. The Hydraulic Load Test on the Absorption Field indicates that it's working normally at this time. The Septic Tank did not need to be pumped.					
ORDER	DONE	DESCRIPTION		PRICE	
X	X	INSPECTION Brought Water		\$150.00	
		INLET REPAIR			
		OUTLET REPAIR			
		EXTRA CHARGE			
		PUMP NEEDED			
		PUMP ORDERED			

SUBTOTAL \$150.00

AMOUNT PAID

AMOUNT OWED


CHECK#

WE ARE IN BUSINESS BECAUSE OF YOU

THANK YOU

Additional Notes: This map is not to scale. This is being offered to express a general idea or layout, and not to be used for construction. It is intended for information only and not accurate construction dimensions.

Location Sketch

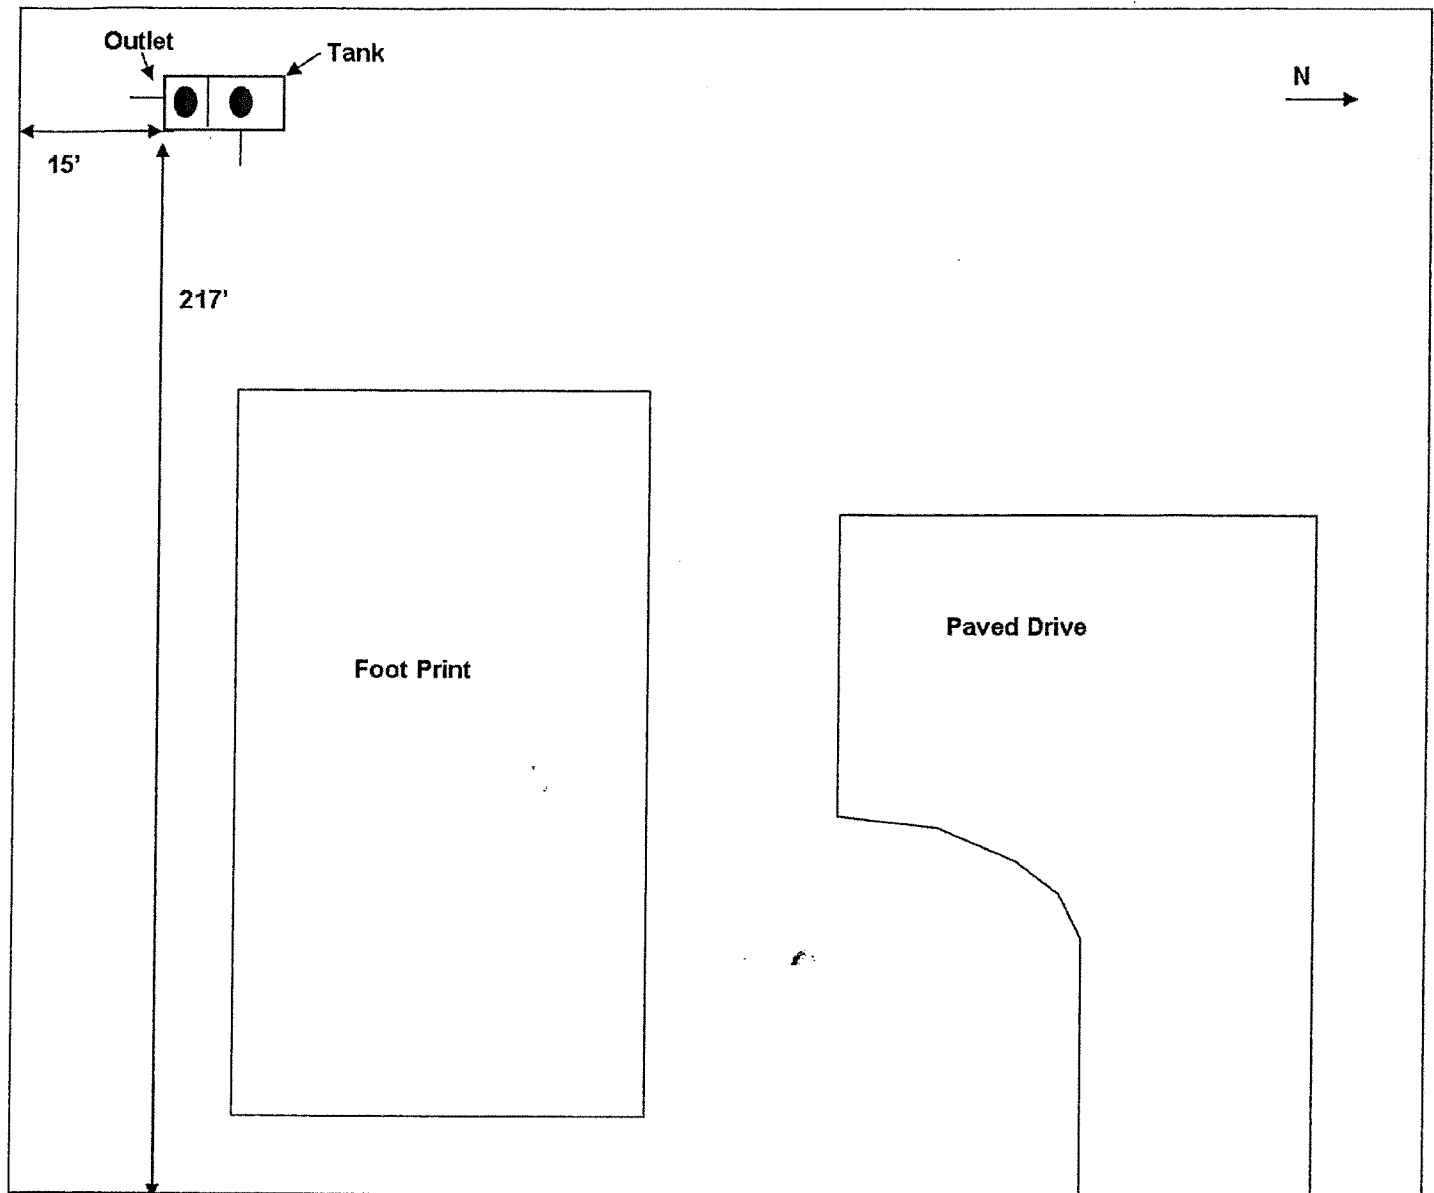

8919 Skyway, Paradise

This Septic Inspection was completed and prepared by

Dobrich & Sons Septic Service

P.O. Box 1681

Magalia, CA. 95954

(530)-873-9901

shirldob@aol.com