

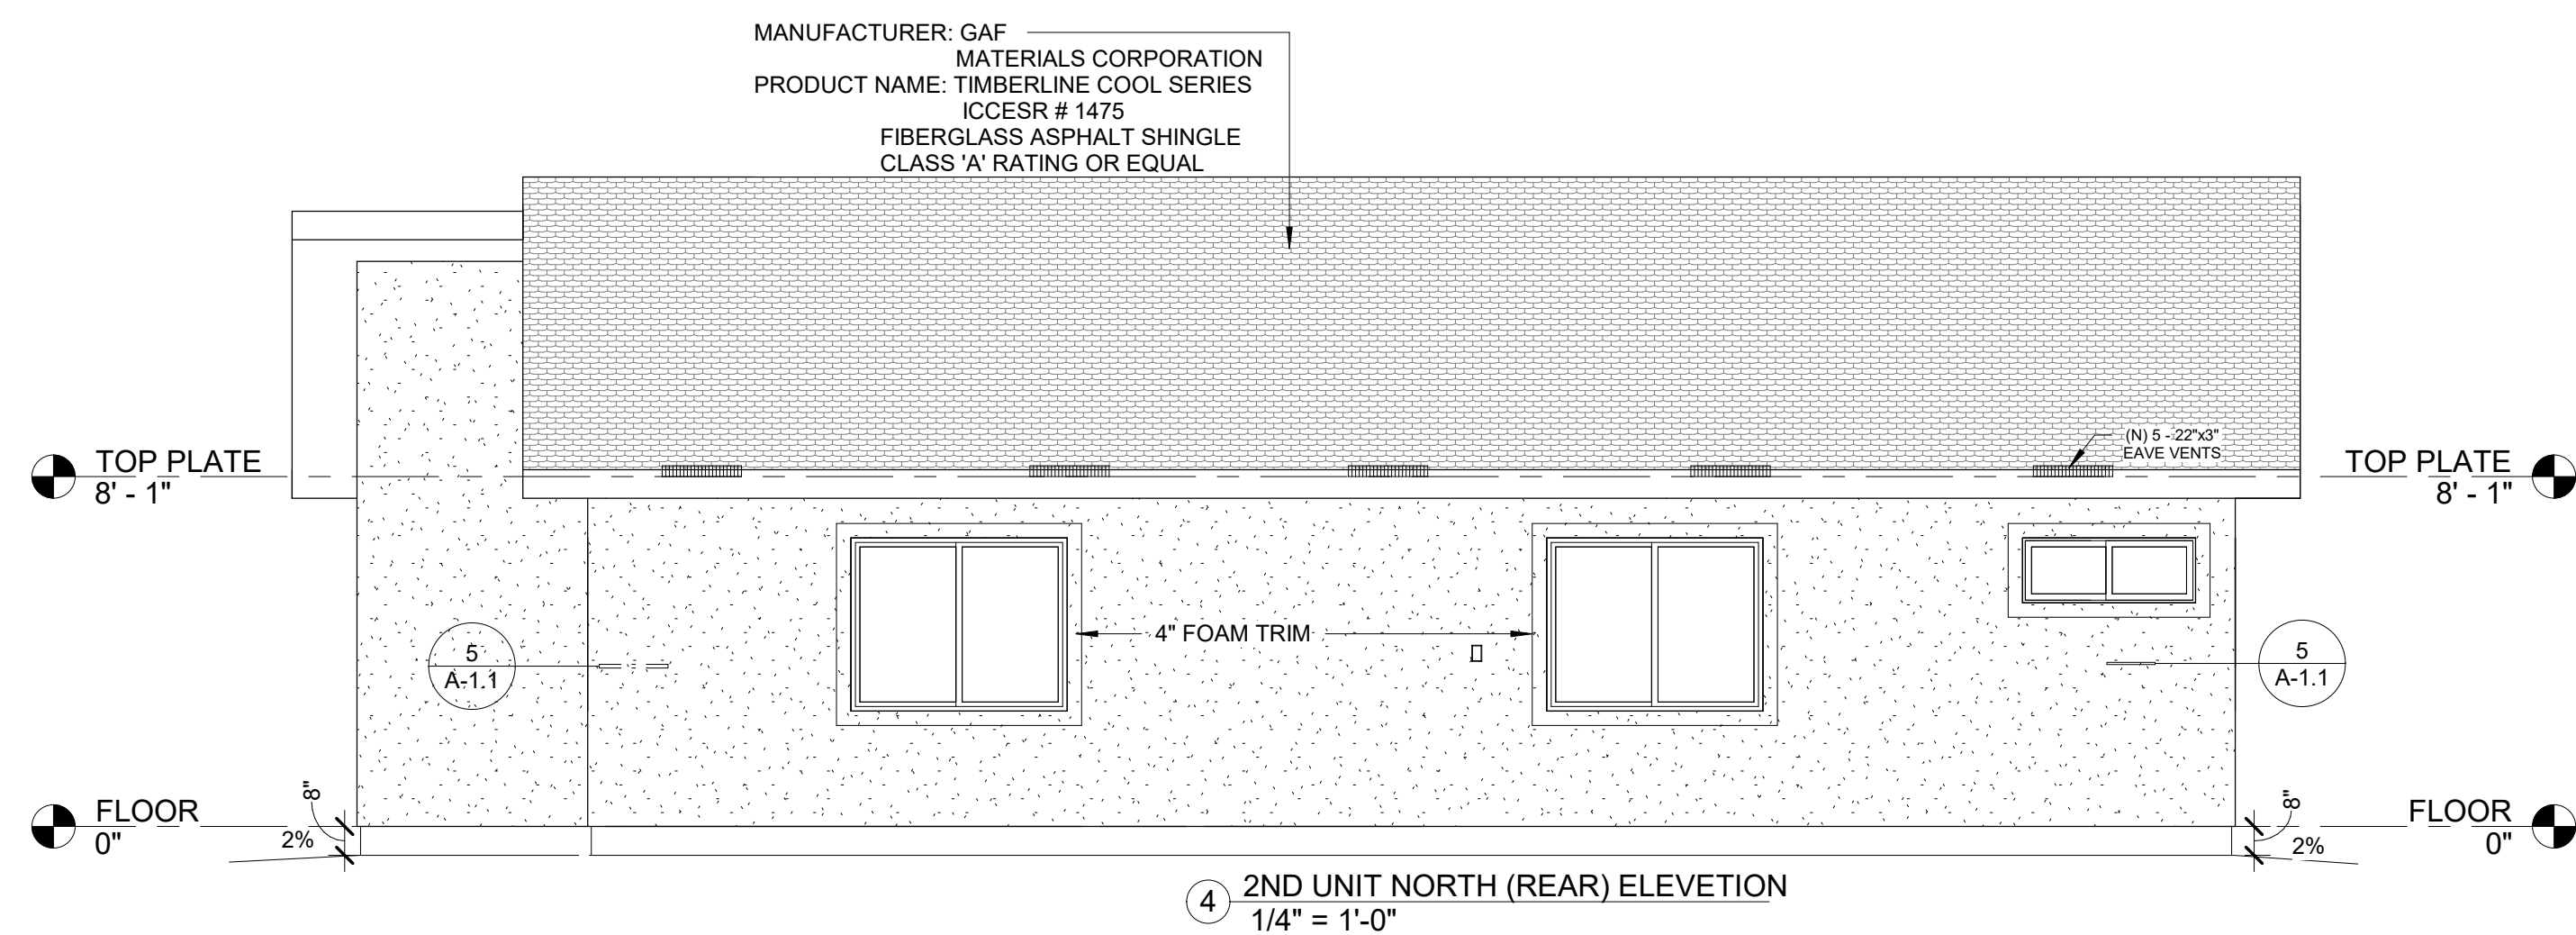


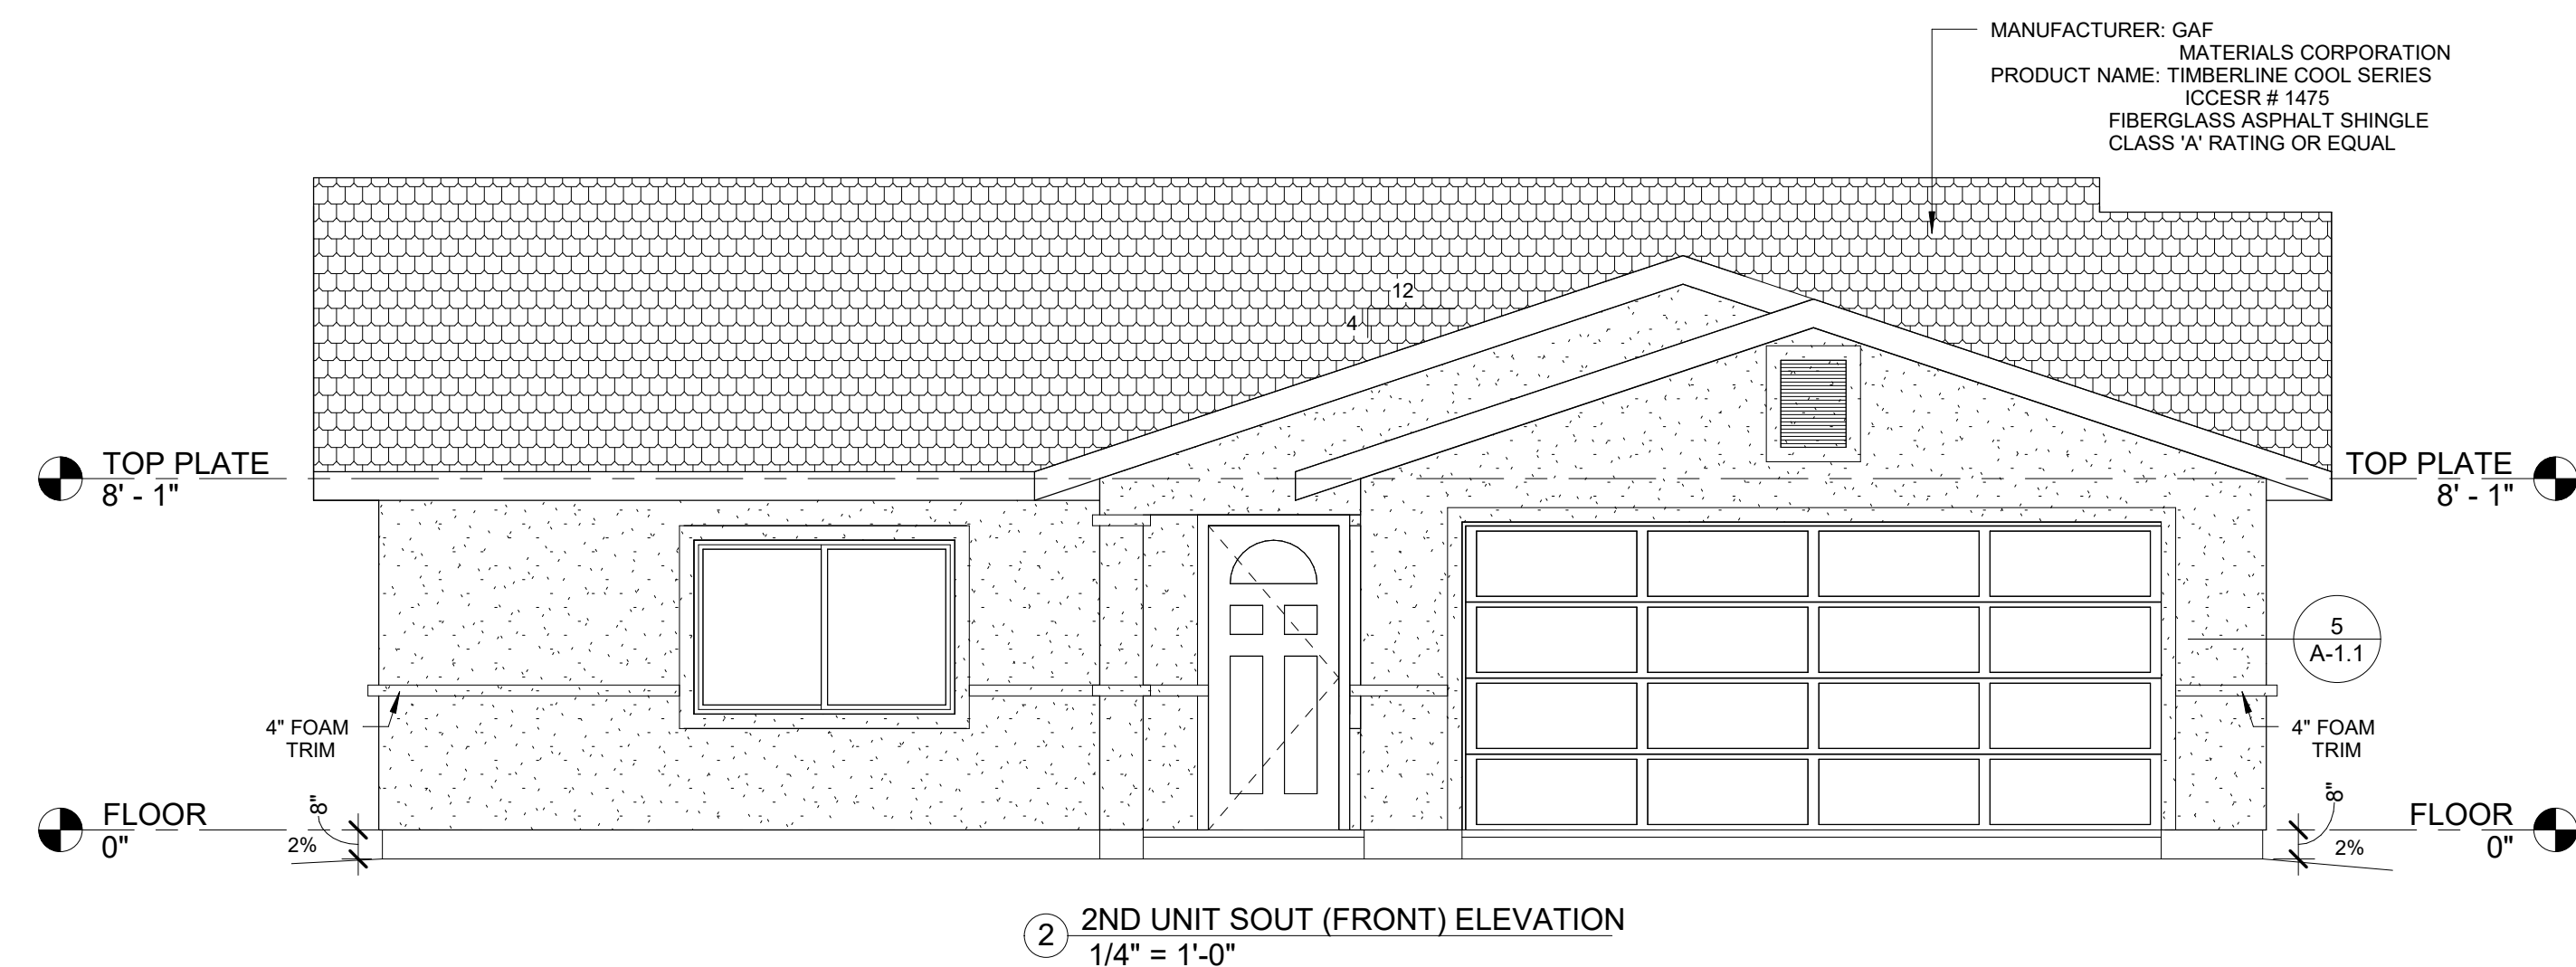

ATTIC VENTILATION CALCULATIONS ROOF W/ ATTIC:
OPENINGS SHALL HAVE CORROSION-RESISTANT WIRE MESH OR OTHER APPROVED MATERIALS WITH 1/16-IN. MINIMUM AND 1/4-IN MAXIMUM OPENING. A MINIMUM OF 1-IN AIRSPACE SHALL BE PROVIDED BETWEEN INSULATION AND ROOF SHEATHING.

PROPOSED ROOF ATTIC AREA: 1,200/150 = 7.6 S.F.
PROVIDE (4) 18"x24" ATTIC VENT (1.5 SQ.) ATTIC VENTS = 6.0 > 7.6

PROPOSED ROOF ATTIC AREA: 462/150 = 3.8 S.F.
PROVIDE (8) 22"x3" ATTIC EAVE VENT (0.19 SQ.) ATTIC VENTS = 1.5 < 7.6
6.0 + 1.5 = 7.5 > 7.6


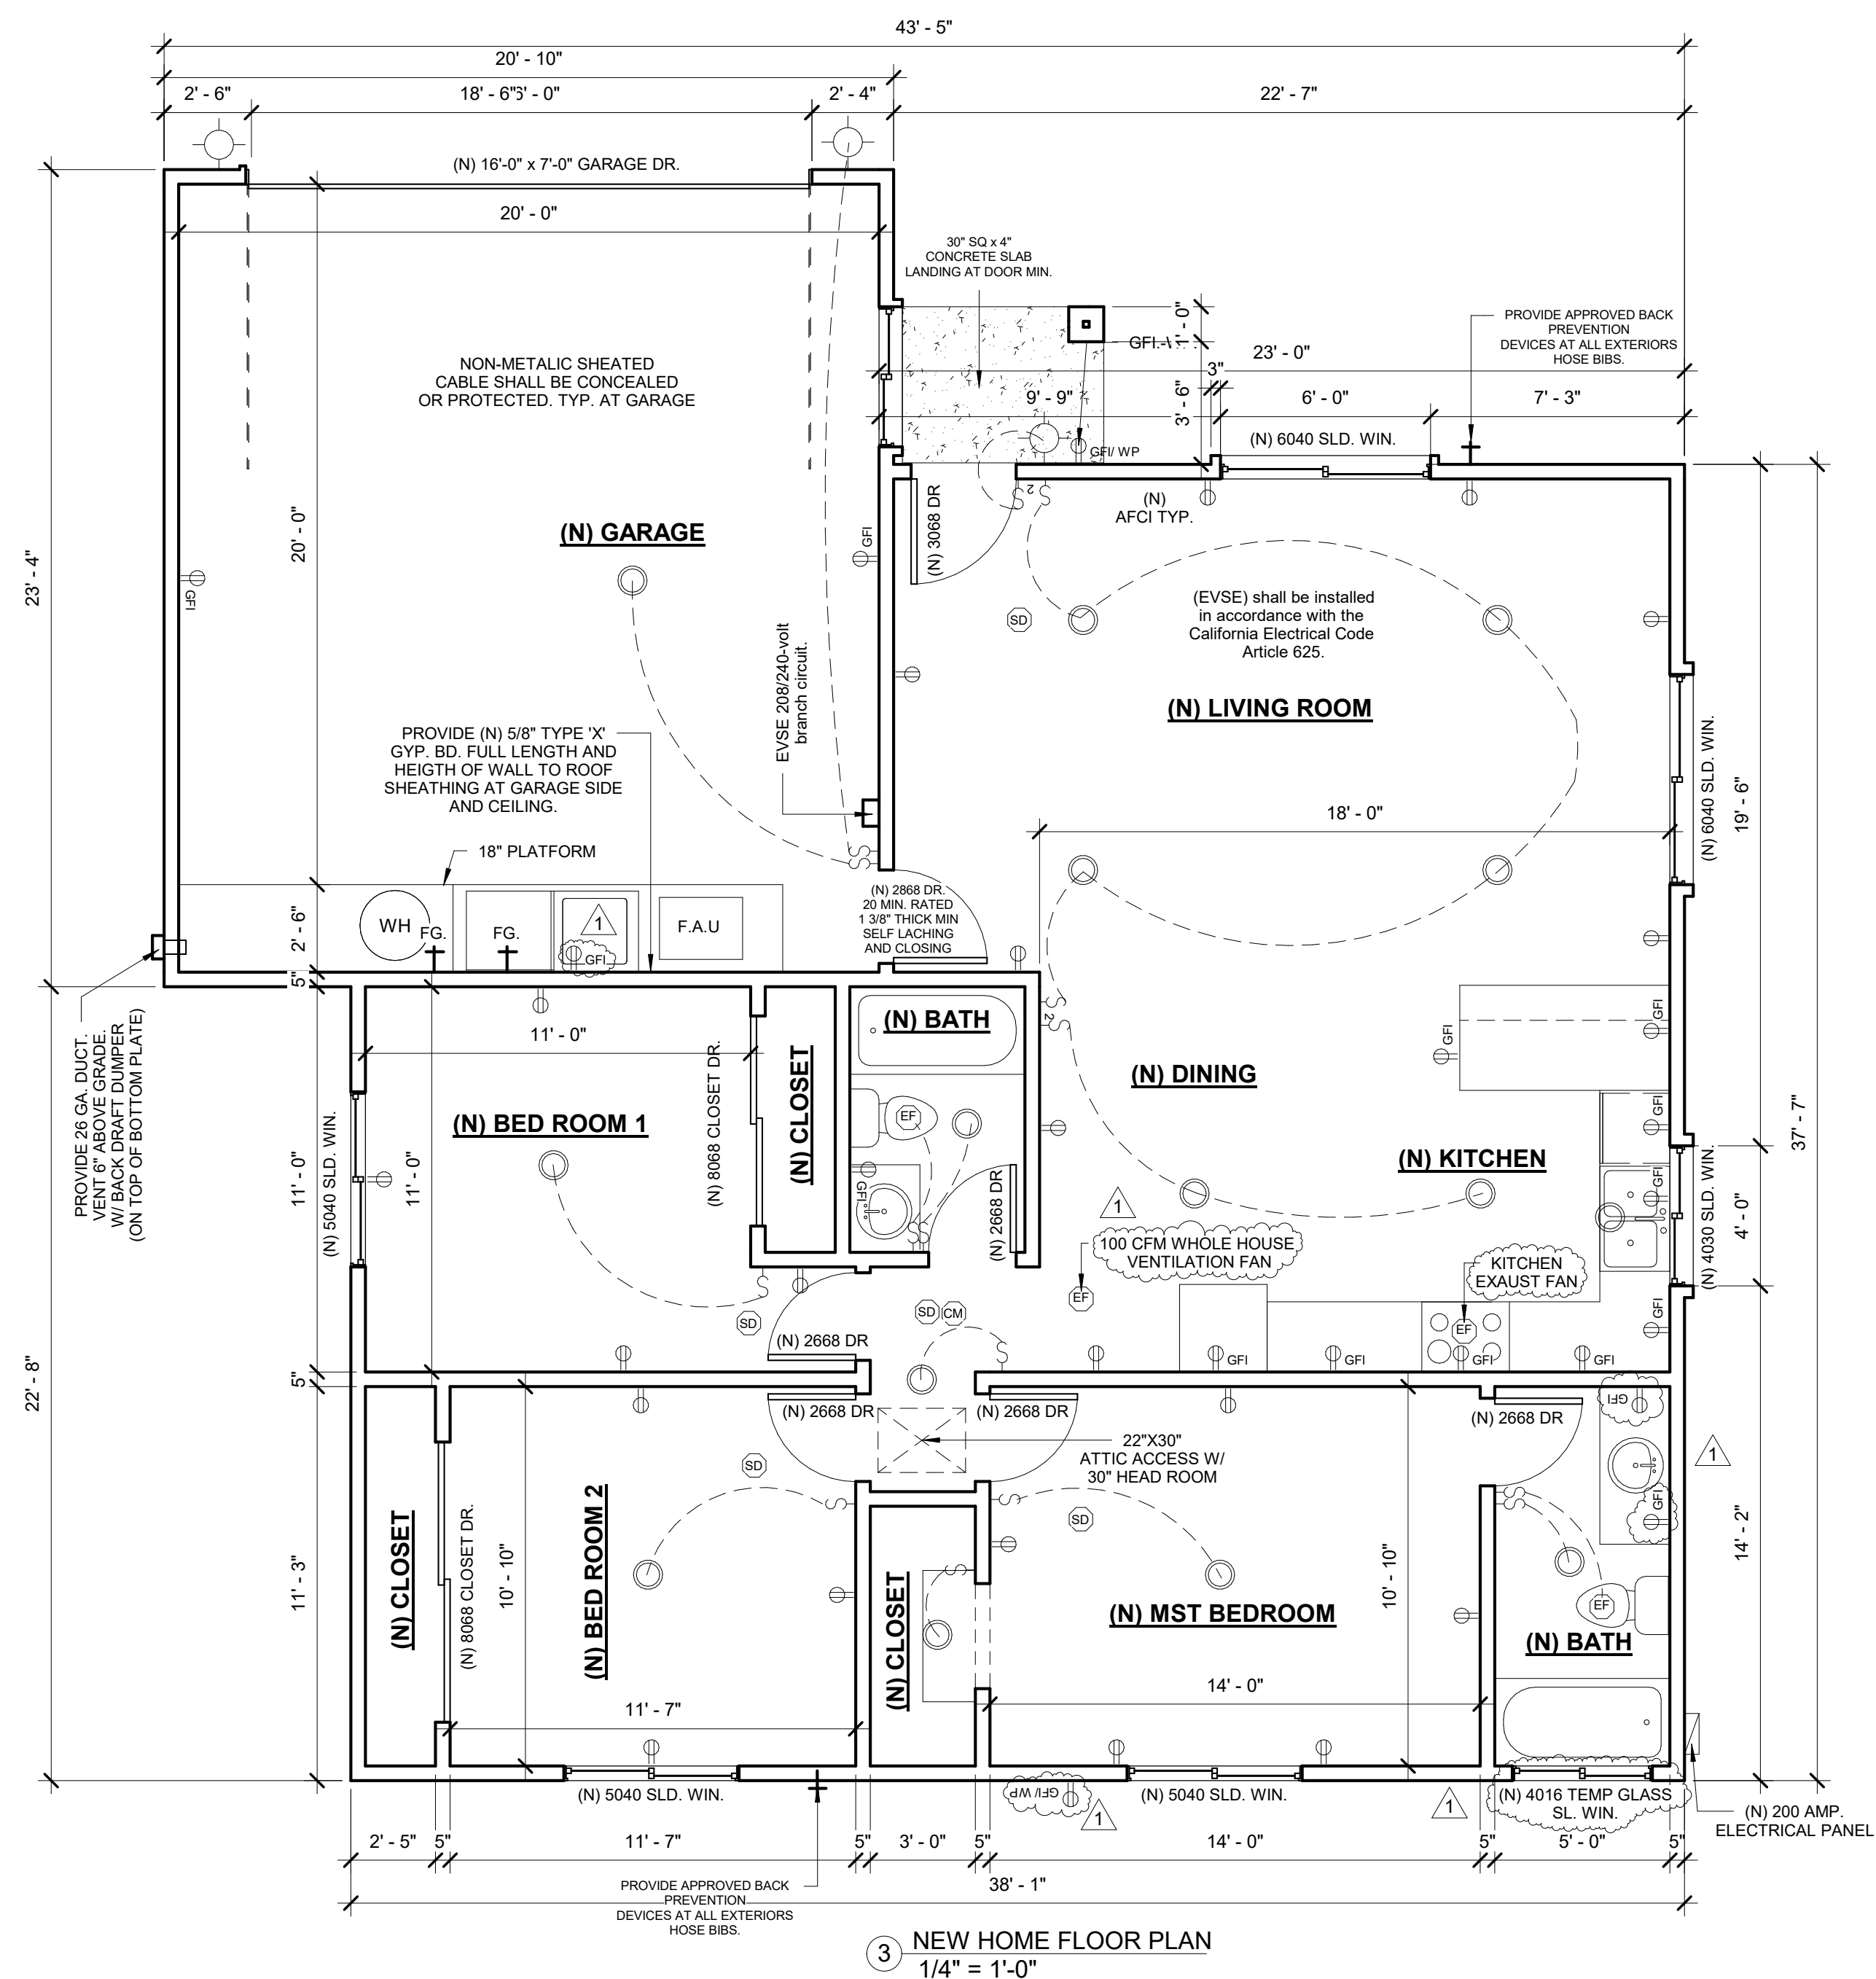


(N) STUCCO SHALL BE 7/8 INCHES AN APPLIED WITH THREE-COAT APPLICATIONPER CBC 2508.1.

STUCCO NOTES

(N) STUCCO SHALL BE 7/8 INCHES AN APPLIED WITH THREE-COAT APPLICATION PER CBC 2508.1. AND INSTALL IN ACCORDANCE WITH CHAPTER 25 ON THE CBC. STUCCO IS APPLIED OVER WOOD BASE SHEATHING TWO LAYERS OF D PAPER SHALL BE APPLIED. A MINIMUM NO. 26 GAGE CORROSION-RESISTANT WEEP SCREED SHALL BE PROVIDED AT OR BELOW THE FOUNDATION PLATE LINE ON ALL EXTERIORS STUD WALLS THE SCREED SHALL BE PLACE A MINIMUM OF 4" INCHES ABOVE THE EARTH OR 2" INCHES ABOVE PAVE AREAS.

5 STUCCO NOTES
1 1/2" = 1'-0"

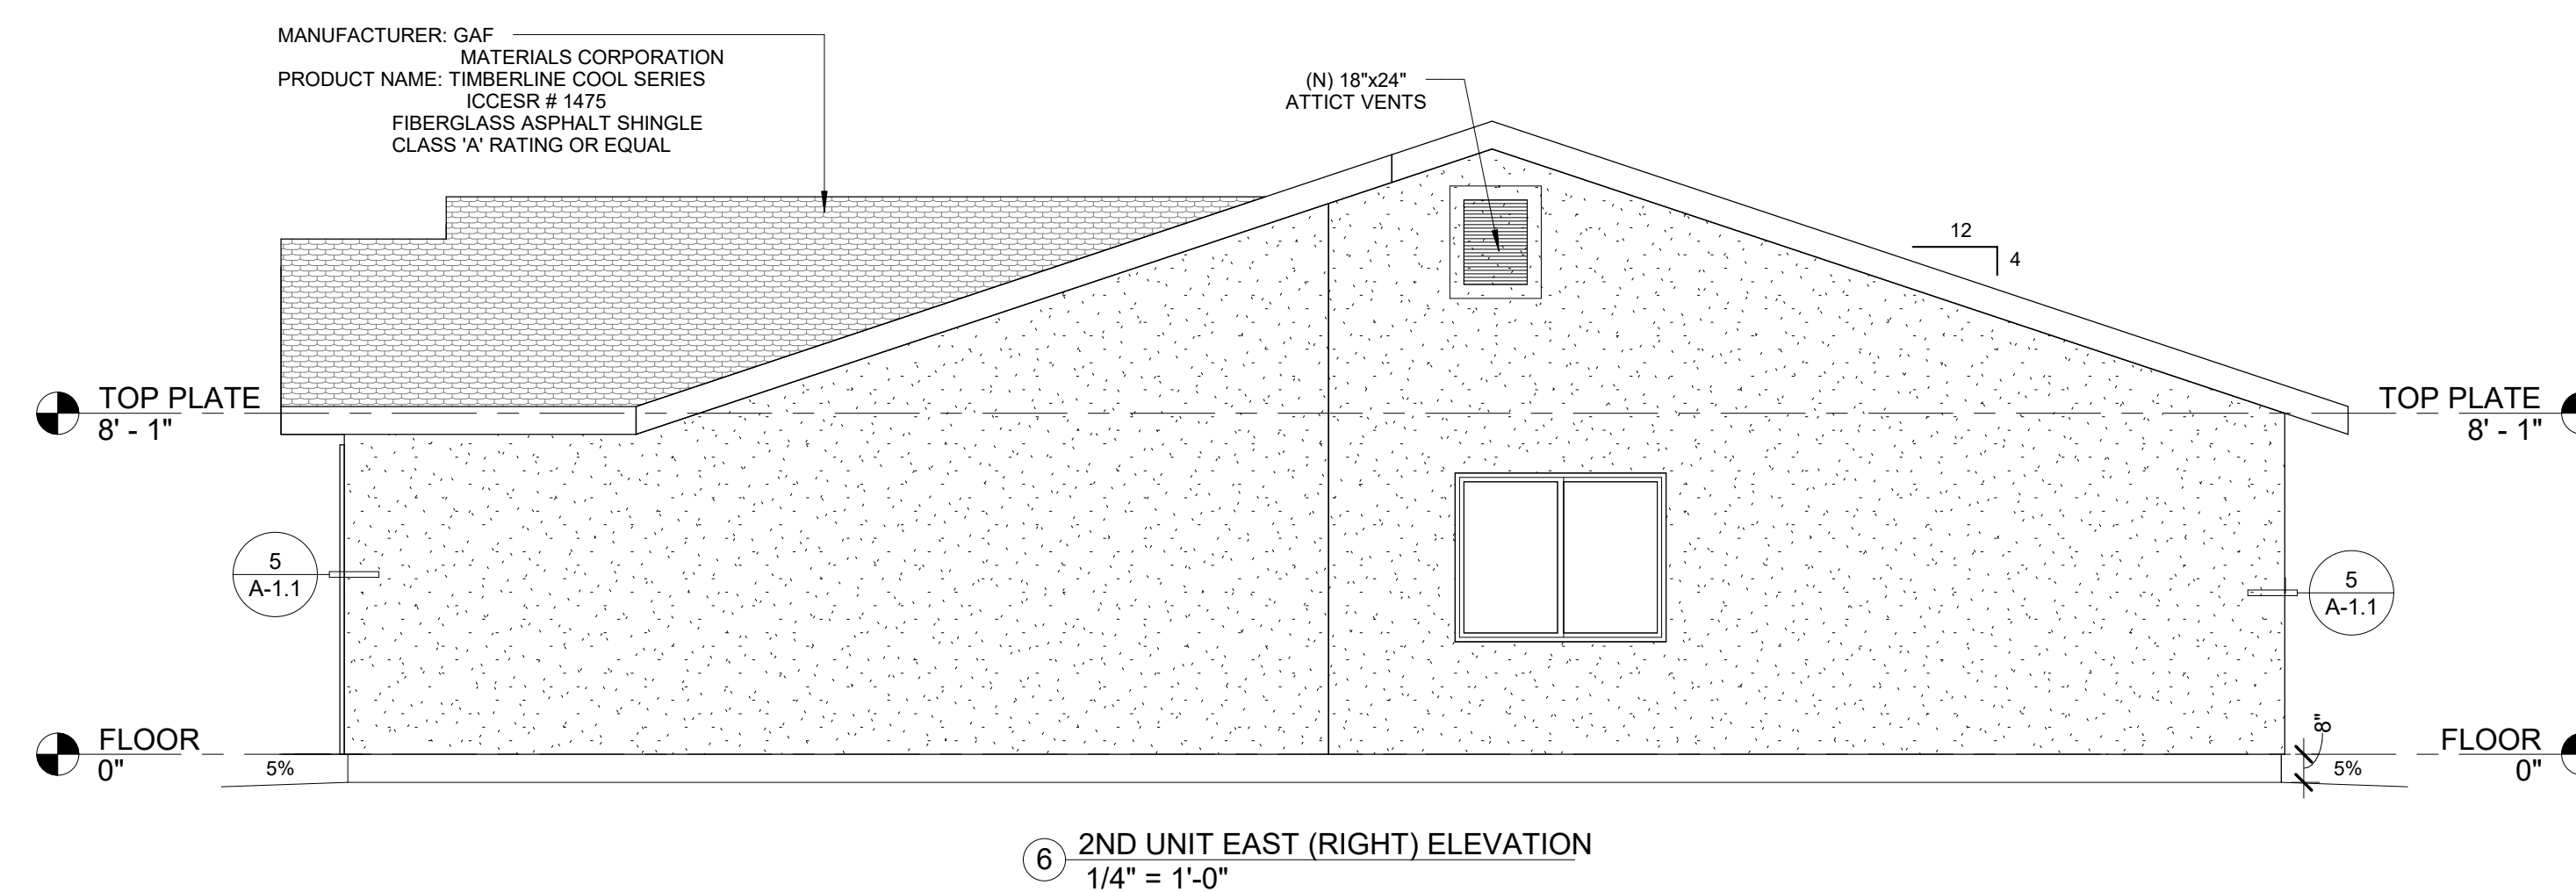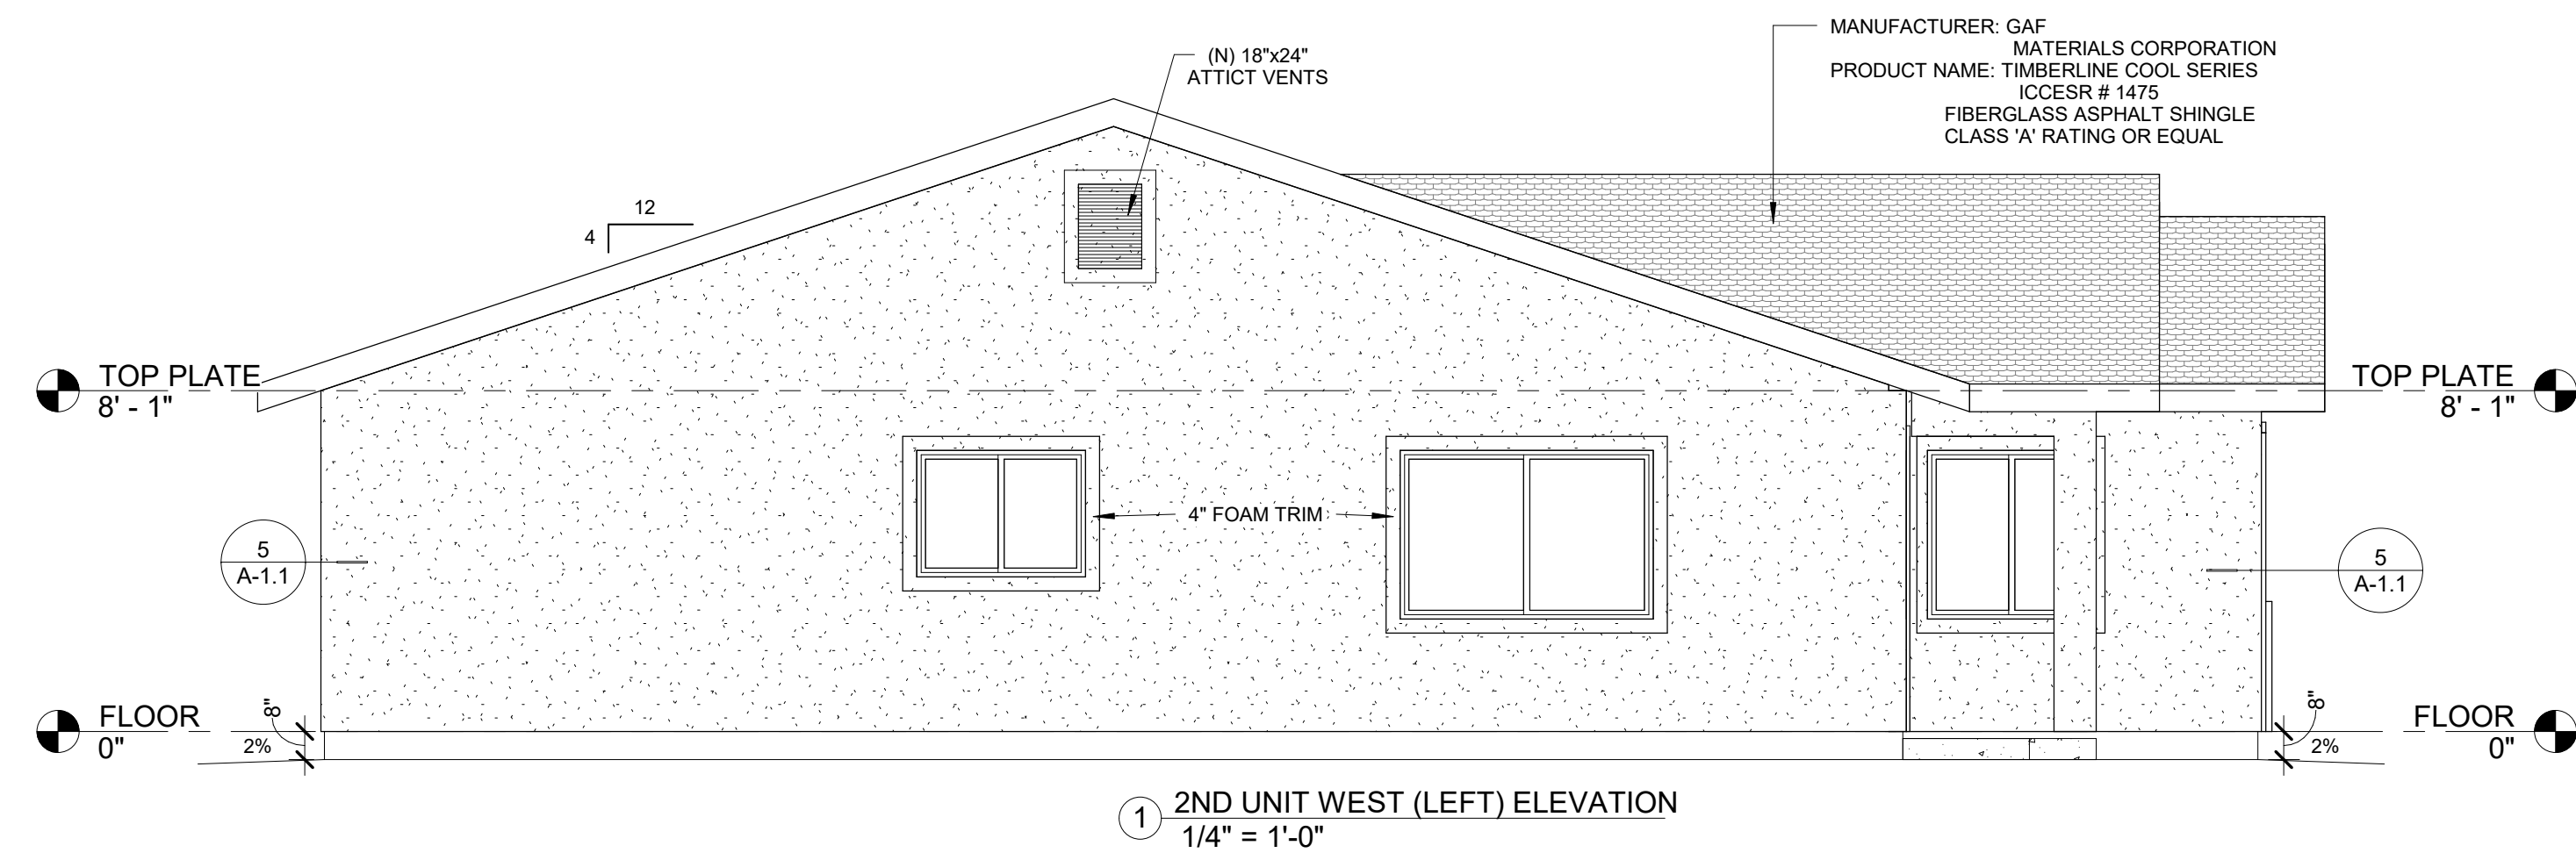[illegible]

NEW SINGLE FAMILY DWELLING
THE REAL STATE GUY
378-156-076 & 77

FLOOR PLAN & ELEVATION 2ND UNIT

Project number	NEW SFR
Date	-
Drawn by	OJM
Checked by	OJM
A-1.1	
Scale	As indicated

- commercial
- engineering
- patios & decks

(909)210.8669

- development
- custom homes
- additions

O.J.M.
-Residencial Design-

783 W Marshall Blvd, San Bernardino, CA 93405 (909)210.8669