

CITY STANDARD ACCESSORY DWELLING UNIT

ADU: 498 SQUARE

CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

Release Date: 03/22/2024

Release #: A

DEVELOPMENT STANDARDS							UTILITY DATA						DESIGN TEAM								LEGAL								SHEET INDEX																																																																						
EXISTING LOT COVERAGE: 'PROPOSED LOT COVERAGE: MAX. LOT COVERAGE: EXISTING FLOOR AREA RATIO: 'PROPOSED FLOOR AREA RATIO: MAX. FLOOR AREA RATIO: PROPOSED BUILDING HEIGHT: NO. OF STORIES: DETACHED MAX SIZE: 1,200 SF HEIGHT LIMIT: 16'-0" *ADU SETBACKS: 4' *ADU TO PDU MIN. DISTANCE: 10' ADDITIONAL PARKING REQUIREMENT ☐ YES☐ NO PER CVMC 19.58.022(C)(7): THE DISTANCE OF THE PROPOSED DETACHED ADU FROM THE TOP AND BOTTOM OF THE SLOPE SHALL MEET CRC SECTION R403.1.7 (SEE SITE PLAN NOTES ON SHEET G101).							EXISTING MAIN SERVICE PANEL BREAKER SIZE: EXISTING MAIN SERVICE PANEL BUS RATING: PROPOSED SUB PANEL ON ADU BREAKER SIZE: 150A PROPOSED SUB PANEL ON ADU BUS RATING: 150A BUS RATING CIRCUIT BREAKER ON MAIN SERVICE PANEL FEEDING THE ADU: 150A EXISTING WATER METER SIZE: EXISTING WATER METER LATERAL SIZE: WATER METER UPGRADE REQUIRED: *CONTACT LOCAL UTILITY COMPANIES REGARDING GAS AND ELECTRIC SERVICES TO THIS DETACHED ADU. **SEE ELECTRICAL SERVICE SELECTION REQUIREMENTS ON SHEET G102.						OWNER CITY OF CHULA VISTA 276 FOURTH AVENUE CHULA VISTA, CA 91910 DESIGNER SnapADU CONTACT: LUIS CALDERON LICENSE#: 1075582 YUCCA ROAD, OCEANSIDE, CA 92054 PHONE: 760.259.2476 EMAIL: PERMITS@SNAPADU.COM STRUCTURAL ENGINEER CONTACT: PAUL CHRISTENSEN LICENSE#: C-057182 PHONE: 760.207.1885 EMAIL: PAUL.PCSD@GMAIL.COM TITLE 24 CONSULTANT SOCAL TITLE-24 CONTACT: KEN PONCE PHONE: 909.294.5822 EMAIL: KEN@SOCALTITLE24.COM								BUILDING OCCUPANCY GROUP: R-3 CONSTRUCTION TYPE: TYPE V-B *FIRE ZONING (CHECK ONE): (N/A) (VHFSZ) EXISTING BUILDING USE: SINGLE FAMILY DWELLING EXISTING BUILDING AREA: SQ. FT. EXISTING GARAGE AREA: SQ. FT. EXISTING BUILDING YEAR BUILT: EXISTING BUILDING SPRINKLERED (YES/NO): PROPOSED BUILDING USE: DETACHED ADU PROPOSED BUILDING AREA: 498 SF PROPOSED BUILDING HEIGHT: 12'-8" PROPOSED BUILDING SPRINKLERED (YES/NO): NUMBER OF STORIES: 1 * WHEN LOCATED IN THE VHFSZ, VHFSZ NOTES ON SHEET G102 AND DETAILS 1 THROUGH 3 ON SHEET A500; 1 THROUGH 6 AND 12 ON SHEET A510; 1 THROUGH 8 AND 12 ON SHEET A520; 1 THROUGH 6 AND 12 ON SHEET A530 ARE APPLICABLE TO THIS PROJECT.																																																																														
PLUMBING FIXTURE SCHEDULE <table><thead><tr><th>FIXTURES</th><th>EXISTING QTY</th><th>NEW QTY</th><th>TOTAL FIXTURES</th><th>MAX WATER CONSUMPTION (CPC TABLE M102.1)</th><th>UNIT WSFU (CPC §10.3)</th><th>WSFU</th></tr></thead><tbody><tr><td>BATHTUB OR COMBINATION BATH/SHOWER</td><td>0</td><td>0</td><td>0</td><td>5.5</td><td>4.0</td><td>0.0</td></tr><tr><td>CLOTHES WASHER</td><td>0</td><td>1</td><td>1</td><td>3.5</td><td>4.0</td><td>4.0</td></tr><tr><td>DISHWASHER, DOMESTIC</td><td>0</td><td>1</td><td>1</td><td>1.3</td><td>1.5</td><td>1.5</td></tr><tr><td>HOSE BIB (USE HIGHEST GPM OF INDOOR WATER FIXTURE)</td><td>0</td><td>1</td><td>1</td><td>3.5</td><td>2.5</td><td>2.5</td></tr><tr><td>HOSE BIB, EACH ADDITIONAL</td><td>0</td><td>0</td><td>0</td><td></td><td>1.0</td><td>0.0</td></tr><tr><td>LAVATORY 1.2 GPM (CPC 407.2.2)</td><td>0</td><td>1</td><td>1</td><td>1.5</td><td>1.0</td><td>1.0</td></tr><tr><td>SHOWER, PER HEAD 1.8 GPM (CPC 408.2.1)</td><td>0</td><td>1</td><td>1</td><td>1.8</td><td>2.0</td><td>2.0</td></tr><tr><td>SINKS (KITCHEN) 1.8 GPM (CPC 420.2.1)</td><td>0</td><td>1</td><td>1</td><td>2.2</td><td>1.5</td><td>1.5</td></tr><tr><td>WATER CLOSET 1.28 GPF (CPC 411.2.1)</td><td>0</td><td>1</td><td>1</td><td>3</td><td>2.5</td><td>2.5</td></tr><tr><td>TOTAL WSFU</td><td></td><td></td><td></td><td></td><td></td><td>15.0</td></tr></tbody></table>							FIXTURES	EXISTING QTY	NEW QTY	TOTAL FIXTURES	MAX WATER CONSUMPTION (CPC TABLE M102.1)	UNIT WSFU (CPC §10.3)	WSFU	BATHTUB OR COMBINATION BATH/SHOWER	0	0	0	5.5	4.0	0.0	CLOTHES WASHER	0	1	1	3.5	4.0	4.0	DISHWASHER, DOMESTIC	0	1	1	1.3	1.5	1.5	HOSE BIB (USE HIGHEST GPM OF INDOOR WATER FIXTURE)	0	1	1	3.5	2.5	2.5	HOSE BIB, EACH ADDITIONAL	0	0	0		1.0	0.0	LAVATORY 1.2 GPM (CPC 407.2.2)	0	1	1	1.5	1.0	1.0	SHOWER, PER HEAD 1.8 GPM (CPC 408.2.1)	0	1	1	1.8	2.0	2.0	SINKS (KITCHEN) 1.8 GPM (CPC 420.2.1)	0	1	1	2.2	1.5	1.5	WATER CLOSET 1.28 GPF (CPC 411.2.1)	0	1	1	3	2.5	2.5	TOTAL WSFU						15.0	GENERAL NOTES 1. COMPLIANCE WITH THE DOCUMENTATION REQUIREMENTS OF THE 2022 ENERGY EFFICIENCY STANDARDS IS NECESSARY FOR THIS PROJECT. REGISTERED, SIGNED, AND DATED COPIES OF THE APPROPRIATE CF1R, CF2R, AND CF3R FORMS SHALL BE MADE AVAILABLE AT NECESSARY INTERVALS FOR BUILDING INSPECTOR REVIEW. FINAL COMPLETED FORMS WILL BE AVAILABLE FOR THE BUILDING OWNER. 2. PRIOR TO FINAL INSPECTION THE LICENSED CONTRACTOR, ARCHITECT OR ENGINEER IN RESPONSIBLE CHARGE OF THE OVERALL CONSTRUCTION MUST PROVIDE TO THE BUILDING DEPARTMENT OFFICIAL WRITTEN VERIFICATION THAT ALL APPLICABLE PROVISIONS FROM THE GREEN BUILDING STANDARDS CODE HAVE BEEN IMPLEMENTED AS PART OF THE CONSTRUCTION. CGC 102.3. 3. REFER TO PLUMBING SPEC SHEETS FOR ADDITIONAL INFORMATION. 4. REFER TO CABINET DRAWINGS AND APPLIANCES PACKAGES. 5. REFER TO TRUSS PACKAGE AND CALC'S FOR ROOF FRAMING. 6. ALL DIMENSIONS ARE TO FACE OF STUD OR EDGE OF CONCRETE UNLESS NOTED OTHERWISE. 7. IF SEWER PUMP REQUIRED, INSTALLATION SHALL CONFIRM TO SECTIONS 710.1-710.13 OF THE CALIFORNIA PLUMBING CODE AND ALL OTHER RELEVANT SECTIONS OF THE CPC. 8. THE APPLICANT UNDERSTANDS THAT IF THE BUILDING INSPECTOR OBSERVES OR SUSPECTS THAT FILL MATERIALS AND/OR EXPANSIVE SOILS ARE PRESENT IN THE BUILDING AREA, A GEOTECHNICAL REPORT PREPARED BY A REGISTERED DESIGN PROFESSIONAL MAY BE REQUIRED. 9. FIELD INSPECTION OF THIS PERMIT WILL NOT BE "FINALIZED" UNTIL A COMPLETE PHOTOVOLTAIC SYSTEM IS INSTALLED, INSPECTED, AND APPROVED.								DEFERRED SUBMITTALS 1. FIRE SPRINKLERS (IF APPLICABLE) *PLANS FOR THE DESIGN AND INSTALLATION OF THE FIRE SPRINKLER SYSTEM(S) ARE A DEFERRED SUBMITTAL AND SHALL BE SUBMITTED AND APPROVED, PRIOR TO ANY INSTALLATION WORK, TO CVFD FIRE PREVENTION DIVISION LOCATED AT (276 FOURTH AVE, BLDG. C (619) 691-5029 *SUBMITTALS REQUIRED FOR THIS PROJECT (IF PRIMARY RESIDENCE IS ALREADY PROTECTED BY FIRE SPRINKLERS): FIRE SPRINKLER - NFPA 13D OR CRC SCOPE OF WORK CONSTRUCTION OF A NEW DETACHED 1-STORY ACCESSORY DWELLING UNIT 498 SF (1-BEDROOM / 1-BATH). IMPERVIOUS AREA: EARTHWORK QUANTITIES: EXISTING: SF CUT: PROPOSED: SF FILL: TOTAL IMPERVIOUS AREA: SF IMPORT: DISTURBED AREA: SF EXPORT: AREA TO BE GRADED:							
FIXTURES	EXISTING QTY	NEW QTY	TOTAL FIXTURES	MAX WATER CONSUMPTION (CPC TABLE M102.1)	UNIT WSFU (CPC §10.3)	WSFU																																																																																													
BATHTUB OR COMBINATION BATH/SHOWER	0	0	0	5.5	4.0	0.0																																																																																													
CLOTHES WASHER	0	1	1	3.5	4.0	4.0																																																																																													
DISHWASHER, DOMESTIC	0	1	1	1.3	1.5	1.5																																																																																													
HOSE BIB (USE HIGHEST GPM OF INDOOR WATER FIXTURE)	0	1	1	3.5	2.5	2.5																																																																																													
HOSE BIB, EACH ADDITIONAL	0	0	0		1.0	0.0																																																																																													
LAVATORY 1.2 GPM (CPC 407.2.2)	0	1	1	1.5	1.0	1.0																																																																																													
SHOWER, PER HEAD 1.8 GPM (CPC 408.2.1)	0	1	1	1.8	2.0	2.0																																																																																													
SINKS (KITCHEN) 1.8 GPM (CPC 420.2.1)	0	1	1	2.2	1.5	1.5																																																																																													
WATER CLOSET 1.28 GPF (CPC 411.2.1)	0	1	1	3	2.5	2.5																																																																																													
TOTAL WSFU						15.0																																																																																													
							APPLICABLE CODES AND REGULATIONS THIS PROJECT SHALL COMPLY WITH THE FOLLOWING BUILDING CODES AND ANY OTHER APPLICABLE REGULATIONS: 1. 2022 CALIFORNIA RESIDENTIAL CODE (CRC) AND/OR 2022 CALIFORNIA BUILDING CODE (CBC) AS APPLICABLE 2. 2022 CALIFORNIA GREEN BUILDING STANDARDS CODE (CALGREEN) 3. 2022 CALIFORNIA ELECTRICAL CODE (CEC) 4. 2022 CALIFORNIA MECHANICAL CODE (CMC) 5. 2022 CALIFORNIA PLUMBING CODE (CPC) 6. 2022 CALIFORNIA FIRE CODE (CFC) 7. 2022 CALIFORNIA BUILDING ENERGY EFFICIENCY STANDARDS (CBEECS) SECTION R106.1. CONTACT THE CITY OF CHULA VISTA FOR DEVELOPMENT STANDARDS, ZONING SETBACKS, & LOT INFORMATION. HERS FEATURE SUMMARY PER CF1R FORM (TITLE 24) • QUALITY INSULATION INSTALLATION (OI1) • INDOOR AIR QUALITY VENTILATION • KITCHEN RANGE HOOD • VERIFIED HEAT PUMP RATED HEATING CAPACITY REQUIRED SPECIAL FEATURES PER CF1R FORM (TITLE 24) • PV EXCEPTION 2: NO PV REQUIRED WHEN MINIMUM PV SIZE (SECTION 150.1(C)14) < 1.8 KWDC (0 kW) • INSULATION BELOW ROOF DECK • NORTHWEST ENERGY EFFICIENCY ALLIANCE (NEEA) RATED HEAT PUMP WATER HEATER; SPECIFIC BRAND / MODEL, OR EQUIVALENT, MUST BE INSTALLED								BUILDING DATA BUILDING OCCUPANCY GROUP: R-3 CONSTRUCTION TYPE: TYPE V-B *FIRE ZONING (CHECK ONE): (N/A) (VHFSZ) EXISTING BUILDING USE: SINGLE FAMILY DWELLING EXISTING BUILDING AREA: SQ. FT. EXISTING GARAGE AREA: SQ. FT. EXISTING BUILDING YEAR BUILT: EXISTING BUILDING SPRINKLERED (YES/NO): PROPOSED BUILDING USE: DETACHED ADU PROPOSED BUILDING AREA: 498 SF PROPOSED BUILDING HEIGHT: 12'-8" PROPOSED BUILDING SPRINKLERED (YES/NO): NUMBER OF STORIES: 1 * WHEN LOCATED IN THE VHFSZ, VHFSZ NOTES ON SHEET G102 AND DETAILS 1 THROUGH 3 ON SHEET A500; 1 THROUGH 6 AND 12 ON SHEET A510; 1 THROUGH 8 AND 12 ON SHEET A520; 1 THROUGH 6 AND 12 ON SHEET A530 ARE APPLICABLE TO THIS PROJECT. VICINITY MAP																																																																																				
							ARCHITECTURE <table><thead><tr><th>REV.</th><th>SHEET #</th><th>DRAWING TITLE</th></tr></thead><tbody><tr><td>A</td><td>G100</td><td>TITLE SHEET</td></tr><tr><td>A</td><td>G101</td><td>GENERAL NOTES</td></tr><tr><td>A</td><td>G102</td><td>CHECKLIST</td></tr><tr><td>A</td><td>G200</td><td>CODE COMPLIANCE NOTES</td></tr><tr><td>A</td><td>G201</td><td>CODE COMPLIANCE NOTES</td></tr><tr><td>A</td><td>G300</td><td>CAL-GREEN REQUIREMENTS</td></tr><tr><td>A</td><td>G301</td><td>CAL-GREEN REQUIREMENTS</td></tr><tr><td>A</td><td>G400</td><td>TITLE 24 - SOG - CZ10</td></tr><tr><td>A</td><td>G401</td><td>TITLE 24 - SOG - CZ10</td></tr><tr><td>A</td><td>G402</td><td>TITLE 24 - SOG - CZ7</td></tr><tr><td>A</td><td>G403</td><td>TITLE 24 - SOG - CZ7</td></tr><tr><td>A</td><td>G410</td><td>TITLE 24 - RF - CZ1</td></tr></tbody></table>								REV.	SHEET #	DRAWING TITLE	A	G100	TITLE SHEET	A	G101	GENERAL NOTES	A	G102	CHECKLIST	A	G200	CODE COMPLIANCE NOTES	A	G201	CODE COMPLIANCE NOTES	A	G300	CAL-GREEN REQUIREMENTS	A	G301	CAL-GREEN REQUIREMENTS	A	G400	TITLE 24 - SOG - CZ10	A	G401	TITLE 24 - SOG - CZ10	A	G402	TITLE 24 - SOG - CZ7	A	G403	TITLE 24 - SOG - CZ7	A	G410	TITLE 24 - RF - CZ1																																														
REV.	SHEET #	DRAWING TITLE																																																																																																	
A	G100	TITLE SHEET																																																																																																	
A	G101	GENERAL NOTES																																																																																																	
A	G102	CHECKLIST																																																																																																	
A	G200	CODE COMPLIANCE NOTES																																																																																																	
A	G201	CODE COMPLIANCE NOTES																																																																																																	
A	G300	CAL-GREEN REQUIREMENTS																																																																																																	
A	G301	CAL-GREEN REQUIREMENTS																																																																																																	
A	G400	TITLE 24 - SOG - CZ10																																																																																																	
A	G401	TITLE 24 - SOG - CZ10																																																																																																	
A	G402	TITLE 24 - SOG - CZ7																																																																																																	
A	G403	TITLE 24 - SOG - CZ7																																																																																																	
A	G410	TITLE 24 - RF - CZ1																																																																																																	



SNAPADU
DESIGN HOUSE

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 498 SQUARE

CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:

LUIS CALDERON
SnapADU


SIGNATURE

[illegible]

TITLE SHEET

G100

22040

[illegible]

ADU: 498 SQUARE
CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:

LUIS CALDERON

SnapADU



SIGNATURE

[illegible]

CHECKLIST
G102
22040

CODE COMPLIANCE NOTES

EXCERPTS FROM THE 2022 CALIFORNIA RESIDENTIAL CODE

CHAPTER 3 - BUILDING PLANNING

R302 FIRE-RESISTANT CONSTRUCTION

R302.1 EXTERIOR WALLS
CONSTRUCTION, PROJECTIONS, OPENINGS AND PENETRATIONS OF EXTERIOR WALLS OF DWELLINGS AND ACCESSORY BUILDINGS SHALL COMPLY WITH TABLE R302.1(1). OR DWELLINGS AND ACCESSORY BUILDINGS EQUIPPED THROUGHOUT WITH AN AUTOMATIC SPRINKLER SYSTEM INSTALLED IN ACCORDANCE WITH SECTION R313 SHALL COMPLY WITH TABLE R302.1(2).

R302.6 DWELLING-GARAGE OPENING AND PENETRATION PROTECTION

OPENINGS AND PENETRATIONS THROUGH THE WALLS OR CEILINGS SEPARATING THE DWELLING FROM THE GARAGE SHALL BE IN ACCORDANCE WITH SECTIONS R302.5.1 THROUGH R302.5.3.

R302.6 DWELLING/GARAGE AND/OR CARPORT FIRE SEPARATION

THE GARAGE AND/OR CARPORT SHALL BE SEPARATED AS REQUIRED BY TABLE R302.6. OPENINGS IN GARAGE WALLS SHALL COMPLY WITH SECTION R302.5. ATTACHMENT OF GYPSUM BOARD SHALL COMPLY WITH TABLE R702.3.5. THE WALL SEPARATION PROVISIONS OF TABLE R302.6 SHALL NOT APPLY TO GARAGE WALLS THAT ARE PERPENDICULAR TO THE ADJACENT DWELLING UNIT WALL. A SEPARATION IS NOT REQUIRED BETWEEN THE DWELLING UNIT AND A CARPORT, PROVIDED THE CARPORT IS ENTIRELY OPEN ON TWO OR MORE SIDES AND THERE ARE NOT ENCLOSED AREAS ABOVE.

R302.7 UNDER-STAIR PROTECTION

ENCLOSED SPACE UNDER STAIRS THAT IS ACCESSED BY A DOOR OR ACCESS PANEL SHALL HAVE WALLS, UNDER-STAIR SPACE AND ANY SOFFITS PROTECTED ON THE ENCLOSED SIDE WITH 1/2-INCH (12.7 MM) GYPSUM BOARD.

R302.11 FIREBLOCKING

IN COMBUSTIBLE CONSTRUCTION, FIREBLOCKING SHALL BE PROVIDED TO CUT OFF BOTH VERTICAL AND HORIZONTAL CONCEALED DRAFT OPENINGS AND TO FORM AN EFFECTIVE FIRE BARRIER BETWEEN STORIES, AND BETWEEN A TOP STORY AND THE ROOF SPACE.

FIREBLOCKING SHALL BE PROVIDED IN WOOD-FRAMED CONSTRUCTION IN THE FOLLOWING LOCATIONS:

- IN CONCEALED SPACES OF STUD WALLS AND PARTITIONS, INCLUDING FURRED SPACES AND PARALLEL ROWS OF STUDS OR STAGGERED STUDS, AS FOLLOWS:
 - VERTICALLY AT THE CEILING AND FLOOR LEVELS.
 - HORIZONTALLY AT INTERVALS NOT EXCEEDING 10 FEET (3048 MM).
- AT INTERCONNECTIONS BETWEEN CONCEALED VERTICAL AND HORIZONTAL SPACES SUCH AS OCCUR AT SOFFITS, DROP CEILINGS AND COVE CEILINGS.
- IN CONCEALED SPACES BETWEEN STAIR STRINGERS AT THE TOP AND BOTTOM OF THE RUN. ENCLOSED SPACES UNDER STAIRS SHALL COMPLY WITH SECTION R302.7.
- AT OPENINGS AROUND VENTS, PIPES, DUCTS, CABLES AND WIRES AT CEILING AND FLOOR LEVEL, WITH AN APPROVED MATERIAL, TO RESIST THE FREE PASSAGE OF FLAME AND PRODUCTS OF COMBUSTION. THE MATERIAL FILLING THIS ANNULAR SPACE SHALL NOT BE REQUIRED TO MEET THE ASTM E136 REQUIREMENTS.
- FOR THE FIREBLOCKING OF CHIMNEYS AND FIREPLACES, SEE SECTION R1003.9.
- FIREBLOCKING OF CORNICES OF A TWO-FAMILY DWELLING IS REQUIRED AT THE LINE OF DWELLING UNIT SEPARATION.

R303 LIGHT, VENTILATION AND HEATING

R303.1 HABITABLE ROOMS
HABITABLE ROOMS SHALL HAVE AN AGGREGATE GLAZING AREA OF NOT LESS THAN 8 PERCENT OF THE FLOOR AREA OF SUCH ROOMS. NATURAL VENTILATION SHALL BE THROUGH WINDOWS, SKYLIGHTS, DOORS, LOUVERS OR OTHER APPROVED OPENINGS TO THE OUTDOOR AIR. SUCH OPENINGS SHALL BE PROVIDED WITH READY ACCESS OR SHALL OTHERWISE BE READILY CONTROLLABLE BY THE BUILDING OCCUPANTS. THE OPENABLE AREA TO THE OUTDOORS SHALL BE NOT LESS THAN 4 PERCENT OF THE FLOOR AREA BEING VENTILATED.

R303.2 ADJOINING ROOMS

FOR THE PURPOSE OF DETERMINING LIGHT AND VENTILATION REQUIREMENTS, ROOMS SHALL BE CONSIDERED TO BE A PORTION OF AN ADJOINING ROOM WHERE NOT LESS THAN 6 INCHES (152 MM) OF FILL WITHIN 10 FEET (3048 MM) IS OPEN AND UNOBSTRUCTED AND PROVIDES AN OPENING OF NOT LESS THAN ONE-TENTH OF THE FLOOR AREA OF THE INTERIOR ROOM AND NOT LESS THAN 25 SQUARE FEET (2.3 M2).

R307 TOILET, BATH AND SHOWER SPACES

R307.2 BATHTUB AND SHOWER SPACES
BATHTUB AND SHOWER FLOORS AND WALLS ABOVE BATHTUBS WITH INSTALLED SHOWER HEADS AND IN SHOWER COMPARTMENTS SHALL BE FINISHED WITH A NONABSORBENT SURFACE. SUCH WALL SURFACES SHALL EXTEND TO A HEIGHT OF NOT LESS THAN 6 FEET (1829 MM) ABOVE THE FLOOR.

R308 GLAZING

R308.1 IDENTIFICATION
EXCEPT AS INDICATED IN SECTION R308.1.1, EACH PANE OF GLAZING INSTALLED IN HAZARDOUS LOCATIONS AS DEFINED IN SECTION R308.4 SHALL BE PROVIDED WITH A MANUFACTURER'S DESIGNATION SPECIFYING WHO APPLIED THE DESIGNATION, THE TYPE OF GLASS AND THE TYPE OF GLAZING STANDARD WITH WHICH IT COMPLIES, AND THAT IS VISIBLE IN THE FINAL INSTALLATION. THE DESIGNATION SHALL BE AID ETCHED, SANDBLASTED, CERAMIC-FIRED, LASER ETCHED, EMBOSSED, OR BE OF A TYPE THAT ONCE APPLIED CANNOT BE REMOVED WITHOUT BEING DESTROYED. A LABEL SHALL BE PERMITTED IN LIEU OF THE MANUFACTURER'S DESIGNATION.

R308.4 HAZARDOUS LOCATIONS

THE LOCATIONS SPECIFIED IN SECTIONS R308.4.1 THROUGH R308.4.7 SHALL BE CONSIDERED TO BE SPECIFIC HAZARDOUS LOCATIONS FOR THE PURPOSES OF GLAZING.

R310 EMERGENCY ESCAPE AND RESCUE OPENINGS

R310.2.1 MINIMUM SIZE
EMERGENCY ESCAPE AND RESCUE OPENINGS SHALL HAVE A NET CLEAR OPENING OF NOT LESS THAN 5.7 SQUARE FEET (0.530 M2).

R310.2.2 MINIMUM DIMENSIONS

THE MINIMUM NET CLEAR OPENING HEIGHT DIMENSION SHALL BE 24 INCHES (610 MM). THE MINIMUM NET CLEAR OPENING WIDTH DIMENSION SHALL BE 20 INCHES (508 MM). THE NET CLEAR OPENING DIMENSIONS SHALL BE THE RESULT OF NORMAL OPERATION OF THE OPENING.

R310.2.3 WINDOW SILL HEIGHT

WHERE A WINDOW IS PROVIDED AS THE EMERGENCY ESCAPE AND RESCUE OPENING, IT SHALL HAVE THE BOTTOM OF THE CLEAR OPENING NOT GREATER THAN 44 INCHES (1118 MM) MEASURED FROM THE FLOOR.

R310.4 AREA WALLS

AN EMERGENCY ESCAPE AND RESCUE OPENING WHERE THE BOTTOM OF THE CLEAR OPENING IS BELOW THE ADJACENT GRADE SHALL BE PROVIDED WITH AN AREA WELL IN ACCORDANCE WITH SECTIONS R310.4.1 THROUGH R310.4.4.

R311 MEANS OF EGRESS

R311.3 FLOORS AND LANDINGS AT EXTERIOR DOORS

THERE SHALL BE A LANDING OR FLOOR ON EACH SIDE OF EACH EXTERIOR DOOR. THE WIDTH OF EACH LANDING SHALL BE NOT LESS THAN THE DOOR SWEPT. LANDINGS SHALL HAVE A DIMENSION OF NOT LESS THAN 36 INCHES (914 MM) MEASURED IN THE DIRECTION OF TRAVEL. THE SLOPE AT EXTERIOR LANDINGS SHALL NOT EXCEED 1/4 UNIT VERTICAL IN 12 UNITS HORIZONTAL (2 PERCENT).

R311.3.1 FLOOR ELEVATIONS AT THE REQUIRED EGRESS DOORS

LANDINGS OR FINISHED FLOORS AT THE REQUIRED EGRESS DOOR SHALL BE NOT MORE THAN 1 1/2 INCHES (38 MM) LOWER THAN THE TOP OF THE THRESHOLD.

EXCEPTION: THE LANDINGS OR FLOOR ON THE EXTERIOR SIDE SHALL BE NOT MORE THAN 7 3/4 INCHES (196 MM) BELOW THE TOP OF THE THRESHOLD PROVIDED THAT THE DOOR DOES NOT SWING OVER THE LANDING OR FLOOR.

WHERE EXTERIOR LANDINGS OR FLOORS SERVING THE REQUIRED EGRESS DOOR ARE NOT AT GRADE, THEY SHALL BE PROVIDED WITH ACCESS TO GRADE BY MEANS OF A RAMP IN ACCORDANCE WITH SECTION R311.8 OR A STAIRWAY IN ACCORDANCE WITH SECTION R311.7.

CHAPTER 3 - BUILDING PLANNING (CON'T)

R314 SMOKE ALARMS

- R314.3 LOCATION
SMOKE ALARMS SHALL BE INSTALLED IN THE FOLLOWING LOCATIONS:
- IN EACH SLEEPING ROOM.
 - OUTSIDE EACH SEPARATE SLEEPING AREA IN THE IMMEDIATE VICINITY OF THE COMMON HALLWAY OR SHOWING.
 - ON EACH ADDITIONAL STORY OF THE DWELLING, INCLUDING BASEMENTS AND HABITABLE ATTICS AND NOT INCLUDING CRAWL SPACES AND UNINHABITABLE ATTICS. IN DWELLINGS OR DWELLING UNITS WITH SPLIT LEVELS AND WITHOUT AN INTERVENING DOOR BETWEEN THE ADJACENT LEVELS, A SMOKE ALARM INSTALLED ON THE UPPER LEVEL SHALL SUFFICE FOR THE ADJACENT LOWER LEVEL PROVIDED THAT THE LOWER LEVEL IS LESS THAN ONE FULL STORY BELOW THE UPPER LEVEL.
 - SMOKE ALARMS SHALL BE INSTALLED NOT LESS THAN 3 FEET (914 MM) HORIZONTALLY FROM THE DOOR OR OPENING OF A BATHROOM THAT CONTAINS A BATHTUB AND LAP SPOD NOT HAVING TUBS AND GROOVE END JOINTS. PLACEMENT OF A SMOKE ALARM REQUIRED BY THIS SECTION.
 - IN THE HALLWAY AND IN THE ROOM OPEN TO THE HALLWAY IN DWELLING UNITS WHERE THE CEILING HEIGHT OF A ROOM OPEN TO A HALLWAY SERVING BEDROOMS EXCEEDS THAT OF THE HALLWAY BY 24 INCHES (610 MM) OR MORE.

R315 CARBON MONOXIDE ALARMS

- R315.3 LOCATION
CARBON MONOXIDE ALARMS IN DWELLING UNITS SHALL BE INSTALLED AND MAINTAINED IN ACCORDANCE WITH THE MANUFACTURER'S PUBLISHED INSTRUCTIONS IN THE FOLLOWING LOCATIONS:
- OUTSIDE OF EACH SEPARATE SLEEPING AREA IN THE IMMEDIATE VICINITY OF THE BEDROOMS.
 - ON EVERY OCCUPABLE LEVEL OF A DWELLING UNIT, INCLUDING BASEMENTS.
 - WHERE A FUEL-BURNING APPLIANCE IS LOCATED WITHIN A BEDROOM OR ITS ATTACHED BATHROOM, A CARBON MONOXIDE ALARM SHALL BE INSTALLED WITHIN THE BEDROOM.

R316 FOAM PLASTIC

R316.4 THERMAL BARRIER
UNLESS OTHERWISE ALLOWED IN SECTION R316.5, FOAM PLASTIC SHALL BE SEPARATED FROM THE INTERIOR OF A BUILDING BY AN APPROVED THERMAL BARRIER OF NOT LESS THAN 1/2-INCH (12.7 MM) GYPSUM WALLBOARD, 23/32-INCH (18.2 MM) WOOD STRUCTURAL PANEL, OR A MATERIAL THAT IS TESTED IN ACCORDANCE WITH AND MEETS THE ACCEPTANCE CRITERIA OF BOTH THE TEMPERATURE TRANSMISSION FIRE TEST AND THE INTEGRITY FIRE TEST OF NFPA 275.

R318 PROTECTION AGAINST SUBTERANEAN TERMITES

- R318.4 FOAM PLASTIC PROTECTION
IN AREAS WHERE THE PROBABILITY OF TERMITE INFESTATION IS "VERY HEAVY" AS INDICATED IN FIGURE R318.4, EXTRUDED AND EXPANDED POLYSTYRENE, POLYISOCYANURATE FOAM PLASTIC, OR OTHER FOAM PLASTIC SHALL BE USED ON THE EXTERIOR FACE OF UNDER INTERIOR OR EXTERIOR FOUNDATION WALLS OR SLAB FOUNDATIONS LOCATED BELOW GRADE. THE CLEARANCE BETWEEN FOAM PLASTICS INSTALLED ABOVE GRADE AND EXPOSED EARTH SHALL BE NOT LESS THAN 6 INCHES (152 MM).
- EXCEPTIONS: BUILDINGS WHERE THE STRUCTURAL MEMBERS OF WALLS, FLOORS, CEILINGS AND ROOFS ARE ENTIRELY OF NONCOMBUSTIBLE MATERIALS OR PRESSURE-PRESERVATIVE-TREATED WOOD. WHERE IN ADDITION TO THE REQUIREMENTS OF SECTION R318.1, AN APPROVED METHOD OF PROTECTING THE FOAM PLASTIC AND STRUCTURE FROM SUBTERANEAN TERMITE DAMAGE IS USED. ON THE INTERIOR SIDE OF BASEMENT WALLS.

CHAPTER 4 - FOUNDATIONS

R401 GENERAL

R401.3 DRAINAGE
SURFACE DRAINAGE SHALL BE DIVERTED TO A STORM SEWER CONVEYANCE OR OTHER APPROVED POINT OF COLLECTION THAT DOES NOT CREATE A HAZARD. LOTS SHALL BE GRADED TO DRAIN SURFACE WATER AWAY FROM FOUNDATION WALLS. THE GRADE SURFACE FALL NOT FEWER THAN 6 INCHES (152 MM) WITHIN THE FIRST 10 FEET.

* SURFACE WATER MUST BE MOVING AWAY FROM THE BUILDING AND ADJACENT PROPERTIES AND TOWARDS THE PUBLIC WAY.

EXCEPTION: WHERE LOT LINES, WALLS, SLOPES OR OTHER PHYSICAL BARRIERS PREVENT DRAINAGE AWAY FROM THE BUILDING, DRAINAGE SWALES SHALL BE CONSTRUCTED TO ENSURE DRAINAGE AWAY FROM THE STRUCTURE. IMPERVIOUS SURFACES WITHIN 10 FEET (3048 MM) OF THE BUILDING FOUNDATION SHALL BE SLOPED NOT LESS THAN 2 PERCENT AWAY FROM THE BUILDING.

CHAPTER 7 - WALL COVERING

R702 INTERIOR COVERING

R702.3.7 WATER-RESISTANT GYPSUM BACKING BOARD
GYPSUM BOARD USED AS THE BASE OR BACKER FOR ADHESIVE APPLICATION OF CERAMIC TILE OR OTHER REQUIRED NONABSORBENT FINISH MATERIAL SHALL CONFORM TO ASTM C1178, C1278 OR C1396. USE OF WATER-RESISTANT GYPSUM BACKING BOARD SHALL BE PERMITTED ON CEILINGS. WATER-RESISTANT GYPSUM BOARD SHALL NOT BE INSTALLED OVER A CLASS I OR I VAPOR RETARDER IN A SHOWER OR TUB COMPARTMENT, CUT OR EXPOSED EDGES, INCLUDING THOSE AT WALL INTERSECTIONS. SHALL BE SEALED AS RECOMMENDED BY THE MANUFACTURER.

R702.4 BACKER BOARDS

MATERIALS USED AS BACKERS FOR WALL TILE IN TUB AND SHOWER AREAS AND WALL PANELS IN SHOWER AREAS SHALL BE OF MATERIALS LISTED IN TABLE R702.4.2, AND INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.

R703 EXTERIOR COVERING

R703.4 FLASHING
APPROVED CORROSION-RESISTANT FLASHING SHALL BE APPLIED SHINGLE-FASHION IN A MANNER TO PREVENT ENTRY OF WATER INTO THE WALL CAVITY OR PENETRATION OF WATER TO THE BUILDING STRUCTURAL FRAMING COMPONENTS. SELF-ADHERED MEMBRANES USED AS FLASHING SHALL COMPLY WITH ASMA 711. FLUID-APPLIED MEMBRANES USED AS FLASHING IN EXTERIOR WALLS SHALL COMPLY WITH ASMA 714. THE FLASHING SHALL EXTEND TO THE SURFACE OF THE EXTERIOR WALL FINISH. APPROVED CORROSION-RESISTANT FLASHINGS SHALL BE INSTALLED AT THE FOLLOWING LOCATIONS:

- EXTERIOR WINDOW AND DOOR OPENINGS. FLASHING AT EXTERIOR WINDOW AND DOOR OPENINGS SHALL EXTEND TO THE SURFACE OF THE EXTERIOR WALL FINISH OR TO THE WATER-RESISTIVE BARRIER COMPLYING WITH SECTION 703.2 FOR SUBSEQUENT DRAINAGE. MECHANICALLY ATTACHED FLEXIBLE FLASHINGS SHALL COMPLY WITH ASMA 712. FLASHING AT EXTERIOR WINDOW AND DOOR OPENINGS SHALL BE INSTALLED IN ACCORDANCE WITH ONE OR MORE OF THE FOLLOWING:
 - THE PENETRATION MANUFACTURER'S INSTALLATION AND FLASHING INSTRUCTIONS, OR FOR APPLICATIONS NOT ADDRESSED IN THE PENETRATION MANUFACTURER'S INSTRUCTIONS, IN ACCORDANCE WITH THE FLASHING MANUFACTURER'S INSTRUCTIONS. WHERE FLASHING INSTRUCTIONS OR DETAILS ARE NOT PROVIDED, PAN FLASHING SHALL BE INSTALLED AT THE SILL OF EXTERIOR WINDOW AND DOOR OPENINGS. PAN FLASHING SHALL BE SEALED OR SLOPED IN SUCH A MANNER AS TO DIRECT WATER TO THE SURFACE OF THE EXTERIOR WALL FINISH OR TO THE WATER-RESISTIVE BARRIER OR SUBSEQUENT DRAINAGE. OPENINGS USING PAN FLASHING SHALL INCORPORATE FLASHING OR PROTECTION AT THE HEAD AND SIDES.
 - IN ACCORDANCE WITH THE FLASHING DESIGN OR METHOD OF A REGISTERED DESIGN PROFESSIONAL.
 - IN ACCORDANCE WITH OTHER APPROVED METHODS.
- AT THE INTERSECTION OF CHIMNEYS OR OTHER MASONRY CONSTRUCTION WITH FRAME OR STUCCO WALLS, WITH PROJECTING LIPS ON BOTH SIDES UNDER STUCCO COPINGS.
- UNDER AND AT THE ENDS OF MASONRY, WOOD OR METAL COPINGS AND SILLS.
- CONTINUOUSLY ABOVE ALL PROJECTING WOOD TRIM.
- WHERE EXTERIOR PORCHES, DECKS OR STAIRS ATTACH TO A WALL OR FLOOR ASSEMBLY OF WOOD-FRAME CONSTRUCTION.
- AT WALL AND ROOF INTERSECTIONS.
- AT BUILT-IN GUTTERS.

R704

R704.3.1 WEEP SCREDS
A MINIMUM 0.015-INCH (0.5 MM) (NO. 26 GALVANIZED SHEET GAGE), CORROSION-RESISTANT WEEP SCREED OR PLASTIC WEEP SCREED, WITH A MINIMUM VERTICAL ATTACHMENT FLANGE OF 3/12 INCHES (89 MM), SHALL BE PROVIDED AT OR BELOW THE FOUNDATION PLATE LINE ON EXTERIOR STUD WALLS IN ACCORDANCE WITH ASTM C626. THE WEEP SCREED SHALL BE PLACED NOT LESS THAN 4 INCHES (102 MM) ABOVE THE EARTH OR 2 INCHES (51 MM) ABOVE PAVED AREAS AS SHALL BE OF A TYPE THAT WILL ALLOW TRAPPED WATER TO DRAIN TO THE EXTERIOR OF THE BUILDING. THE WEATHER-RESISTANT BARRIER SHALL LAP THE ATTACHMENT FLANGE. THE EXTERIOR LATH SHALL COVER AND TERMINATE ON THE ATTACHMENT FLANGE OF THE WEEP SCREED.

CHAPTER 7 - WALL COVERING (CON'T)

R705

R703.10.1 PANEL SIDING
FIBER-CEMENT PANELS SHALL COMPLY WITH THE REQUIREMENTS OF ASTM C1186, TYPE A, MINIMUM GRADE II OR ISO 8336, CATEGORY A. MINIMUM CLASS 2. PANELS SHALL BE INSTALLED WITH THE LONG DIMENSION EITHER PARALLEL OR PERPENDICULAR TO FRAMING. VERTICAL AND HORIZONTAL JOINTS SHALL OCCUR OVER FRAMING MEMBERS AND SHALL BE PROTECTED WITH CAULKING, OR WITH BATTENS OR FLASHING, OR BE VERTICAL OR HORIZONTAL SHIP-LAP, OR OTHERWISE DESIGNED TO COMPLY WITH SECTION R703.1. PANEL SIDING SHALL BE INSTALLED WITH FASTENERS IN ACCORDANCE WITH TABLE R703.3(1) OR THE APPROVED MANUFACTURER'S INSTRUCTIONS.

R706

R703.10.2 LAP SIDING
FIBER-CEMENT LAP SIDING HAVING A MAXIMUM WIDTH OF 12 INCHES (305 MM) SHALL COMPLY WITH THE REQUIREMENTS OF ASTM C1186, TYPE A, MINIMUM GRADE II OR ISO 8336, CATEGORY A, MINIMUM CLASS 2. LAP SIDING SHALL BE LAPPED A MINIMUM OF 11/4 INCHES (32 MM) AND LAP SIDING NOT HAVING TONGUE-AND-GROOVE END JOINTS SHALL HAVE THE ENDS PROTECTED WITH CAULKING, COVERED WITH AN IN-SIDE JOINT COVER, LOCATED OVER A STRIP OF FLASHING, OR SHALL BE DESIGNED TO COMPLY WITH SECTION R703.1. LAP SIDING COURSES SHALL BE INSTALLED WITH THE FASTENERS EDGES EXPOSED OR CONCEALED. IN ACCORDANCE WITH TABLE R703.3(1) OR APPROVED MANUFACTURER'S INSTRUCTIONS.

CHAPTER 8 - ROOF-CEILING CONSTRUCTION

R806 ROOF VENTILATION

R806.2 MINIMUM VENT AREA
THE MINIMUM NET FREE VENTILATING AREA SHALL BE 1/150 OF THE AREA OF THE VENTED SPACE.

EXCEPTION: THE MINIMUM NET FREE VENTILATING AREA SHALL BE 1/300 OF THE VENTED SPACE PROVIDED BOTH OF THE FOLLOWING CONDITIONS ARE MET:

- IN CLIMATE ZONES 6, 7 AND 8, A CLASS I OR I VAPOR RETARDER IS INSTALLED ON THE WARM-IN-WINTER SIDE OF THE CEILING.
- NOT LESS THAN 40 PERCENT AND NOT MORE THAN 50 PERCENT OF THE REQUIRED VENTILATING AREA IS PROVIDED BY VENTILATORS LOCATED IN THE UPPER PORTION OF THE ATTIC OR RAFTER SPACE. UPPER VENTILATORS SHALL BE LOCATED NOT MORE THAN 3 FEET (914 MM) BELOW THE RIDGE OR HIGHEST POINT OF THE SPACE, MEASURED VERTICALLY. THE BALANCE OF THE REQUIRED VENTILATION PROVIDED SHALL BE LOCATED IN THE BOTTOM ONE-THIRD OF THE ATTIC SPACE. WHERE THE LOCATION OF WALL OR ROOF FRAMING MEMBERS CONFLICTS WITH THE INSTALLATION OF UPPER VENTILATORS, INSTALLATION MORE THAN 3 FEET (914 MM) BELOW THE RIDGE OR HIGHEST POINT OF THE SPACE SHALL BE PERMITTED.

R807

R807.1 ATTIC ACCESS
BUILDINGS WITH COMBUSTIBLE CEILING OR ROOF CONSTRUCTION SHALL HAVE AN ATTIC ACCESS OPENING TO ATTIC AREAS THAT HAVE A VERTICAL HEIGHT OF 30 INCHES (762 MM) OR GREATER OVER AN AREA OF NOT LESS THAN 30 SQUARE FEET (2.8 M2). THE VERTICAL HEIGHT SHALL BE MEASURED FROM THE TOP OF THE CEILING FRAMING MEMBERS TO THE UNDERSIDE OF THE ROOF FRAMING MEMBERS.

THE ROUGH-FRAMED OPENING SHALL BE NOT LESS THAN 22 INCHES BY 30 INCHES (559 MM BY 762 MM) AND SHALL BE LOCATED IN A HALLWAY OR OTHER LOCATION WITH READY ACCESS, WHERE LOCATED IN A WALL, THE OPENING SHALL BE NOT LESS THAN 22 INCHES WIDE BY 30 INCHES HIGH (559 MM WIDE BY 762 MM HIGH). WHERE THE ACCESS IS LOCATED IN A CEILING, UNOBSTRUCTED HEADROOM IN THE ATTIC SPACE SHALL BE 30 INCHES (762 MM) AT SOME POINT ABOVE THE ACCESS MEASURED VERTICALLY FROM THE BOTTOM OF CEILING FRAMING MEMBERS. SEE THE CALIFORNIA MECHANICAL CODE FOR ACCESS REQUIREMENTS WHERE MECHANICAL EQUIPMENT IS LOCATED IN ATTICS.

EXCERPTS FROM THE 2022 CALIFORNIA MECHANICAL CODE

CHAPTER 3 - GENERAL REGULATIONS

M304 ACCESSIBILITY FOR SERVICE

M304.4 APPLIANCE ACCESS AND UNDER-FLOOR SPACES
AN ATTIC OR UNDER-FLOOR SPACE IN WHICH AN APPLIANCE IS INSTALLED SHALL BE ACCESSIBLE THROUGH AN OPENING AND PASSAGEWAY NOT LESS THAN THE LARGEST COMPONENT OF THE APPLIANCE, AND NOT LESS THAN 22 INCHES BY 30 INCHES (559 MM BY 762 MM).

M302

M304.4.1 LENGTH OF PASSAGEWAY
WHERE THE HEIGHT OF THE PASSAGEWAY IS LESS THAN 6 FEET (1829 MM), THE DISTANCE FROM THE PASSAGEWAY ACCESS TO THE APPLIANCE SHALL NOT EXCEED 20 FEET (6096 MM) MEASURED ALONG THE CENTERLINE OF THE PASSAGEWAY. (NFPA 54 9.5.1.2)

M303

M304.4.2 WIDTH OF PASSAGEWAY
THE PASSAGEWAY SHALL BE UNOBSTRUCTED AND SHALL HAVE SOLID FLOORING NOT LESS THAN 24 INCHES (610 MM) WIDE FROM THE ENTRANCE OPENING TO THE APPLIANCE. (NFPA 54 9.5.1.2)

M304

M304.4.3 WORK PLATFORM
A LEVEL WORKING PLATFORM NOT LESS THAN 30 INCHES BY 30 INCHES (762 MM BY 762 MM) SHALL BE PROVIDED IN FRONT OF THE SERVICE SIDE OF THE APPLIANCE. (NFPA 54 9.5.2)

EXCEPTION: A WORKING PLATFORM NEED NOT BE PROVIDED WHERE THE FURNACE IS CAPABLE OF BEING SERVICED FROM THE REQUIRED ACCESS OPENING. THE FURNACE SERVICE SIDE SHALL NOT EXCEED 12 INCHES (305 MM) FROM THE ACCESS OPENING.

M305

M304.4.4 LIGHTING AND CONVENIENCE OUTLET
A PERMANENT 120V RECEPTACLE OUTLET AND A LIGHTING FIXTURE SHALL BE INSTALLED NEAR THE APPLIANCE. THE SWITCH CONTROLLING THE LIGHTING FIXTURE SHALL BE LOCATED AT THE ENTRANCE TO THE PASSAGEWAY. (NFPA 54 9.5.3)

CHAPTER 5 - EXHAUST SYSTEMS

M504.0 ENVIRONMENTAL AIR DUCTS

M504.0 CLOTHES DRYERS
A CLOTHES DRYER EXHAUST DUCT SHALL NOT BE CONNECTED TO A VENT CONNECTOR, GAS VENT, CHIMNEY, AND SHALL NOT TERMINATE INTO A CRAWL SPACE, ATTIC, OR OTHER CONCEALED SPACE. EXHAUST DUCTS SHALL NOT BE ASSEMBLED WITH SCREWS OR OTHER FASTENING MEANS THAT EXTEND INTO THE DUCT AND THAT ARE CAPABLE OF CATCHING LINT, AND THAT REDUCE THE EFFICIENCY OF THE EXHAUST SYSTEM. EXHAUST DUCTS SHALL BE CONSTRUCTED OF RIGID METALLIC MATERIAL. TRANSITION DUCTS USED TO CONNECT THE DRYER TO THE EXHAUST DUCT SHALL BE LISTED AND LABELED IN ACCORDANCE WITH UL 2158A, OR INSTALLED IN ACCORDANCE WITH THE CLOTHES DRYER MANUFACTURER'S INSTALLATION INSTRUCTIONS. CLOTHES DRYER EXHAUST DUCTS SHALL TERMINATE TO THE OUTDOOR. THE BUILDING SHALL BE IN ACCORDANCE WITH SECTION 502.2.1 AND SHALL BE EQUIPPED WITH A BACKDRAFT DAMPER. SCREENS SHALL NOT BE INSTALLED AT THE DUCT TERMINATION DEVICES. SUCH AS FIRE OR SMOKE DAMPERS THAT WILL OBSTRUCT THE FLOW OF THE EXHAUST SHALL NOT BE USED. WHERE JOINING OF DUCTS, THE MALE END SHALL BE INSERTED IN THE DIRECTION OF AIRFLOW.

M502

M504.4.1 PROVISIONS FOR MAKEUP AIR
MAKEUP AIR SHALL BE PROVIDED IN ACCORDANCE WITH THE FOLLOWING:

- MAKEUP AIR SHALL BE PROVIDED FOR TYPE 1 CLOTHES DRYERS IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS. (NFPA 54 10.4.3.1) WHERE A CLOSET IS DESIGNED FOR THE INSTALLATION OF A CLOTHES DRYER, AN OPENING OF NOT LESS THAN 100 SQUARE INCHES (0.085 M2) FOR MAKEUP AIR SHALL BE PROVIDED IN THE DOOR OR BY OTHER APPROVED MEANS.
- PROVISION FOR MAKEUP AIR SHALL BE PROVIDED FOR TYPE 2 CLOTHES DRYERS, WITH A FREE AREA OF NOT LESS THAN 1 SQUARE INCH (0.0006 M2) FOR EACH 1000 BRITISH THERMAL UNITS PER HOUR (BTUH) (0.293 KW) TOTAL INPUT RATING OF THE DRYER(S) INSTALLED. (NFPA 54 10.4.3.2)

M503

M504.4.2 DOMESTIC CLOTHES DRYERS
WHERE A COMPARTMENT OR SPACE FOR A TYPE 1 CLOTHES DRYER IS PROVIDED, NOT LESS THAN A 4 INCH DIAMETER (102 MM) EXHAUST DUCT OF APPROVED MATERIAL SHALL BE INSTALLED IN ACCORDANCE WITH SECTION 504.0.

TYPE 1 CLOTHES DRYER EXHAUST DUCTS SHALL BE OF RIGID METAL AND SHALL HAVE SMOOTH INTERIOR SURFACES. THE DIAMETER SHALL BE NOT LESS THAN 4 INCHES NOMINAL (100 MM), AND THE THICKNESS SHALL BE NOT LESS THAN 0.016 OF AN INCH (0.406 MM).

CHAPTER 5 - EXHAUST SYSTEMS (CON'T)

M504

M504.4.2.1 LENGTH LIMITATION
UNLESS OTHERWISE PERMITTED OR REQUIRED BY THE DRYER MANUFACTURER'S INSTRUCTIONS AND APPROVED BY THE AUTHORITY HAVING JURISDICTION, DOMESTIC DRYER MOISTURE EXHAUST DUCTS SHALL NOT EXCEED A TOTAL COMBINED HORIZONTAL AND VERTICAL LENGTH OF 14 FEET (4287 MM), INCLUDING TWO 90 DEGREE (1.57 RAD) ELBOWS. A LENGTH OF 2 FEET (610 MM) SHALL BE DEDUCTED FOR EACH 90 DEGREE (1.57 RAD) ELBOW IN EXCESS OF TWO.

EXCEPTION: WHERE AN EXHAUST DUCT POWER VENTILATOR, IN ACCORDANCE WITH SECTION 504.4.2.3, IS USED, THE MAXIMUM LENGTH OF THE DRYER EXHAUST DUCT SHALL BE 10 FEET (3048 MM). THE DRYER EXHAUST DUCT SHALL BE INSTALLED IN ACCORDANCE WITH THE DRYER MANUFACTURER'S INSTALLATION INSTRUCTIONS.

CHAPTER 11 - REFRIGERATION

M1105.0 GENERAL REQUIREMENTS

M1105.2 SUPPORTS AND ANCHORAGE
SUPPORTS AND ANCHORAGE FOR REFRIGERATION EQUIPMENT AND PIPING SHALL BE DESIGNED IN ACCORDANCE WITH THE BUILDING CODE AS OCCUPANCY CATEGORY H (HAZARDOUS FACILITIES). SUPPORTS SHALL BE MADE OF NONCOMBUSTIBLE MATERIALS.

EXCEPTIONS:
EQUIPMENT CONTAINING GROUP A1 REFRIGERANTS SHALL BE PERMITTED TO BE SUPPORTED BY THE SAME MATERIALS PERMITTED FOR THE BUILDING TYPE. THE USE OF APPROVED VIBRATION ISOLATORS SPECIFICALLY DESIGNED FOR THE NORMAL, WIND, AND SEISMIC LOADS ENCOUNTERED, SHALL BE PERMITTED.

A COMPRESSOR OR PORTION OF A CONDENSING UNIT SUPPORTED FROM THE GROUND SHALL REST ON A CONCRETE OR OTHER APPROVED BASE EXTENDING NOT LESS THAN 3 INCHES (76 MM) ABOVE THE ADJOINING GROUND LEVEL.

M1102

M1105.11 REFRIGERANT PORT PROTECTION
AIR CONDITIONING REFRIGERANT CIRCUIT ACCESS PORTS LOCATED OUTDOORS SHALL BE PROTECTED FROM UNAUTHORIZED ACCESS WITH AN EXISTING TYPE TAMPER-RESISTANT CAPS OR IN A MANNER APPROVED BY THE AUTHORITY HAVING JURISDICTION.

EXCEPTION: REFRIGERANT PORTS IN SECURE LOCATIONS PROTECTED BY WALLS OR FENCING AND REQUIRING KEY ACCESS.

EXCERPTS FROM THE 2022 CALIFORNIA PLUMBING CODE

CHAPTER 4 - PLUMBING FIXTURES AND FIXTURE FITTINGS

P401

P401.2 RESIDENTIAL LAVATORY FAUCETS
[HCD] THE MAXIMUM FLOW RATE OF RESIDENTIAL LAVATORY FAUCETS SHALL NOT EXCEED 1.2 GALLONS (4.5 L) PER MINUTE AT 80 PSI. THE MINIMUM FLOW RATE OF RESIDENTIAL LAVATORY FAUCETS SHALL NOT BE LESS THAN 0.8 GALLONS (3.03 L) PER MINUTE AT 20 PSI.

P402

P402.0 SHOWERS
P402.2.2 RESIDENTIAL LAVATORY FAUCETS
SHOWERHEADS SHALL HAVE A MAXIMUM FLOW RATE OF NOT MORE THAN 1.8 GPM AT 80 PSI (8.1 L/M AT 552 KPA). [HCD] 1) RESIDENTIAL SHOWERHEADS SHALL COMPLY WITH STANDARD 4.3 OF THE CALIFORNIA GREEN BUILDING STANDARDS CODE (CALGREEN).

P403

P402.2.1 SINGLE SHOWERHEAD
[BSC-CG, DSA-SS & DSA-SS(C)] SHOWERHEADS SHALL HAVE A MAXIMUM FLOW RATE OF NOT MORE THAN 1.8 GALLONS (8.1 L) PER MINUTE AT 80 PSI. SHOWERHEADS SHALL BE CERTIFIED TO THE PERFORMANCE CRITERIA OF THE U.S. EPA WATERSENSE SPECIFICATION FOR SHOWERHEADS IN COMPLIANCE WITH CHAPTER 5, DIVISION 5.3. OF THE CALIFORNIA GREEN BUILDING STANDARDS CODE (CAL GREEN).

P404

P402.3 INDIVIDUAL SHOWER AND TUB-SHOWER COMBINATION CONTROL VALVES
SHOWER AND TUB-SHOWER COMBINATION VALVES SHALL BE PROVIDED WITH INDIVIDUAL CONTROL VALVES OF THE PRESSURE-BALANCE, THERMOSTATIC, OR COMBINATION PRESSURE-BALANCE/THERMOSTATIC MIXING VALVE TYPE THAT PROVIDE SCALD AND THERMAL SHOCK PROTECTION FOR THE RATED FLOW RATE OF THE INSTALLED SHOWERHEAD. THESE VALVES SHALL BE INSTALLED AT THE POINT OF USE AND COMPLY WITH ASSE 1016/ASME A112.1016/CSA B125.16 OR ASME A112.16.1/CSA B125.1.

GANG SHOWERS, WHERE SUPPLIED WITH A SINGLE TEMPERATURE-CONTROLLED WATER SUPPLY PIPE, SHALL BE CONTROLLED BY A MIXING VALVE THAT COMPLIES WITH ASSE 1069. HANDLE POSITION STOPS SHALL BE PROVIDED ON SUCH VALVES AND SHALL BE ADJUSTED PER THE MANUFACTURER'S INSTRUCTIONS TO DELIVER MAXIMUM MIXED WATER SETTING OF 120° (49°C). WATER HEATER THERMOSTATS SHALL NOT BE CONSIDERED A SUITABLE CONTROL FOR MEETING THIS PROVISION.

P405

P402.6 SHOWER COMPARTMENTS
SHOWER COMPARTMENTS, REGARDLESS OF SHAPE, SHALL HAVE A MINIMUM FINISHED INTERIOR OF 1024 SQUARE INCHES (66.0668 M2) AND SHALL ALSO BE CAPABLE OF ENCOMPASSING A 30 INCH (762 MM) CIRCLE. THE MINIMUM REQUIRED AREA AND DIMENSIONS SHALL BE MEASURED AT A HEIGHT EQUAL TO THE TOP OF THE THRESHOLD AND A POINT TANGENT TO ITS CENTERLINE. THE AREA AND DIMENSIONS SHALL BE MAINTAINED TO A POINT OF NOT LESS THAN 70 INCHES (1778 MM) ABOVE THE SHOWER DRAIN OR OUTLET WITH NO PROTRUSIONS OTHER THAN THE FIXTURE VALVE OR VALVES, SHOWERHEADS, SOAP DISHES, SHELVES, AND SAFETY GRAB BARS, OR RAILS. FOLD-DOWN SEATS IN ACCESSIBLE SHOWER STALLS SHALL BE PERMITTED TO PROTRUDE INTO THE 30 INCH (762 MM) CIRCLE.

EXCEPTIONS:
SHOWERS THAT ARE DESIGNED TO BE IN ACCORDANCE WITH CHAPTER 11A OF THE

CODE COMPLIANCE NOTES

EXCERPTS FROM THE 2022 CALIFORNIA RESIDENTIAL CODE				EXCERPTS FROM THE 2022 CALIFORNIA PLUMBING CODE																																		
TABLE R302.1(1) EXTERIOR WALLS: DWELLINGS AND ACCESSORY BUILDINGS WITHOUT AUTO RESIDENTIAL FIRE SPRINKLER PROTECTION				TABLE 610.4 FIXTURE UNIT TABLE FOR DETERMINING WATER PIPE AND METER SIZES																			TABLE 703.2 MAXIMUM UNIT LOADING AND MAXIMUM LENGTH OF DRAINAGE AND VENT PIPING															
EXTERIOR WALL ELEMENT		MINIMUM FIRE-RESISTANCE RATING	MINIMUM FIRE SEPARATION DISTANCE	METER AND STREET SERVICE (inches)	BUILDING SUPPLY AND BRANCHES (inches)	MAXIMUM ALLOWABLE LENGTH (feet)																SIZE OF PIPE (inches)	1 ¹ / ₄	1 ¹ / ₂	2	3	4	5	6	8	10	12						
WALLS	FIRE-RESISTANCE RATED	1 HOUR-TESTED IN ACCORDANCE WITH ASTM E119, UL 263 OR SECTION 703.3 OF THE CALIFORNIA BUILDING CODE WITH EXPOSURE FROM BOTH SIDES	0 FEET																			Maximum Units																
	NOT FIRE-RESISTANCE RATED	0 HOURS	≥ 5 FEET	PRESSURE RANGE - 30 to 45 psi ¹																Drainage Piping ¹																		
						40	60	80	100	150	200	250	300	400	500	600	700	800	900	1000	Vertical	1	2 ²	16 ³	48 ⁴	256	600	1380	3600	5600	8400							
																						Horizontal		1	1	8 ³	35 ⁴	216 ⁵	428 ⁵	720 ⁵	2640 ⁵	4680 ⁵	8200 ⁵					
PROJECTIONS	NOT ALLOWED	NA	< 2 FEET	¾	1½ ²	6	5	4	3	2	1	1	1	0	0	0	0	0	0	0	Maximum Length																	
	FIRE-RESISTANCE RATED	1 HOUR ON THE UNDERSIDE, OR HEAVY TIMBER, OR FIRE-RETARDANT-TREATED WOOD ^{A,B}	≥ 2 FEET < 5 FEET	¾	¾	16	16	14	12	9	6	5	5	4	4	3	2	2	2	1	Drainage Piping																	
	NOT FIRE-RESISTANCE RATED	0 HOURS	≥ 5 FEET	¾	1	29	25	23	21	17	15	13	12	10	8	6	6	6	6	6	Vertical, (feet)		45	65	85	212	300	390	510	750	—	—						
																						Horizontal (unlimited)																
OPENINGS IN WALLS	NOT ALLOWED	NA	< 3 FEET	1	1	36	31	27	25	20	17	15	13	12	10	8	6	6	6	6	Vent Piping																	
	25% MAXIMUM OF WALL AREA	0 HOURS	3 FEET	¾	1¼	36	33	31	28	24	23	21	19	17	16	13	12	12	11	11	Horizontal and Vertical ⁶																	
	UNLIMITED	0 HOURS	5 FEET	1	1¼	54	47	42	38	32	28	25	23	19	17	14	12	12	11	11	Maximum Units		1	8 ³	24	84	256	600	1380	3600	—	—						
																						Maximum Lengths, (feet)		45	60	120	212	300	390	510	750							
PENETRATIONS	ALL	COMPLY WITH SECTION R302.4	< 3 FEET	1½	1¼	78	68	57	48	38	32	28	25	21	18	15	12	12	11	11	FOR SI UNITS: 1 INCH = 25 MM, 1 FOOT = 304.8 MM NOTES: 1. EXCLUDING TRAP ARM. 2. EXCEPT FOR SINKS, URINALS, AND DISHWASHERS - EXCEEDING 1 FIXTURE UNIT. 3. EXCEPT FOR SIX-UNIT TRAPS OR WATER CLOSETS. 4. NOT TO EXCEED FIVE WATER CLOSETS OR FIVE SIX-UNIT TRAPS. 5. BASED ON 1/4 INCH PER FOOT (20.8 MM/M) SLOPE, FOR 1/8 OF AN INCH PER FOOT (10.4 MM/M) SLOPE, MULTIPLY HORIZONTAL FIXTURE UNITS BY A FACTOR OF 0.8. 6. THE DIAMETER OF AN INDIVIDUAL VENT SHALL BE NOT LESS THAN 1¼ INCHES (32 MM) NOR LESS THAN ONE-HALF THE DIAMETER OF THE DRAIN TO WHICH IT IS CONNECTED. FIXTURE UNIT LOAD VALUES FOR DRAINAGE AND VENT PIPING SHALL BE COMPUTED FROM TABLE 702.1 AND TABLE 702.2. NOT TO EXCEED ONE-THIRD OF THE TOTAL PERMITTED LENGTH OF A VENT SHALL BE PERMITTED TO BE INSTALLED IN A HORIZONTAL POSITION. WHERE VENTS ARE INCREASED ONE PIPE SIZE FOR THEIR ENTIRE LENGTH, THE MAXIMUM LENGTH LIMITATIONS SPECIFIED IN THIS TABLE DO NOT APPLY. THIS TABLE IS IN ACCORDANCE WITH THE REQUIREMENTS OF SECTION 901.3. 7. UP TO 8 PUBLIC LAVATORIES ARE PERMITTED TO BE INSTALLED ON A 1 1/2 INCH (40 MM) VERTICAL BRANCH OR HORIZONTAL SANITARY BRANCH SLOPED AT 1/4 INCH PER FOOT (20.8 MM/M).																	
		NONE REQUIRED	3 FEET	1	1½	85	84	79	65	56	48	43	38	32	28	26	22	21	20	20																		
FOR SI: 1 FOOT = 304.8 MM. NA = NOT APPLICABLE. A. THE FIRE-RESISTANCE RATING SHALL BE PERMITTED TO BE REDUCED TO 0 HOURS ON THE UNDERSIDE OF THE EAVE OVERHANG IF FIREBLOCKING IS PROVIDED FROM THE WALL TOP PLATE TO THE UNDERSIDE OF THE ROOF SHEATHING. B. THE FIRE-RESISTANCE RATING SHALL BE PERMITTED TO BE REDUCED TO 0 HOURS ON THE UNDERSIDE OF THE RAKE OVERHANG WHERE GABLE VENT OPENINGS ARE NOT INSTALLED.				1½	1½	150	124	105	91	70	57	49	45	36	31	26	23	21	20	20																		
				2	1½	151	129	129	110	80	64	53	46	38	32	27	23	21	20	20	20																	
				1	2	85	85	85	85	85	85	82	80	66	61	57	52	49	46	43	43																	
				1½	2	220	205	190	176	155	138	127	120	104	85	70	61	57	54	51	51																	
				2	2	370	327	292	265	217	185	164	147	124	96	70	61	57	54	51	51																	
				2	2½	445	418	390	370	330	300	280	265	240	220	198	175	158	143	133	133																	
				PRESSURE RANGE - 46 to 60 psi ¹																																		
				¾	1½ ²	7	7	6	5	4	3	2	2	1	1	1	0	0	0	0	0	0																
				¾	¾	20	20	19	17	14	11	9	8	6	5	4	4	3	3	3	3	3																
				¾	1	39	39	36	33	28	23	21	19	17	14	12	10	9	8	8	8	8																
				1	1	39	39	39	36	30	25	23	20	18	15	12	10	9	8	8	8	8																
				¾	1¼	39	39	39	39	39	39	34	32	27	25	22	19	19	17	16	16	16																
				1	1¼	78	78	76	67	52	44	39	36	30	27	24	20	19	17	16	16	16																
				1½	1¼	78	78	78	78	66	52	44	39	33	29	24	20	19	17	16	16	16																
				1	1½	85	85	85	85	85	85	80	67	55	49	41	37	34	32	30	30	30																
				1½	1½	151	151	151	151	128	105	90	78	62	52	42	38	35	32	30	30	30																
				2	1½	151	151	151	151	150	117	98	84	67	55	42	38	35	32	30	30	30																
				1	2	85	85	85	85	85	85	85	85	85	85	85	85	85	85	83	80	80																
				1½	2	370	370	340	318	272	240	220	198	170	150	135	123	110	102	94	94	94																
				2	2	370	370	370	370	368	318	280	250	205	165	142	123	110	102	94	94	94																
				2	2½	654	640	610	580	535	500	470	440	400	365	335	315	285	267	250	250	250																
				PRESSURE RANGE - Over 60 psi ¹																																		
				¾	1½ ²	7	7	7	6	5	4	3	3	2	1	1	1	1	1	0	0	0																
				¾	¾	20	20	20	20	17	13	11	10	8	7	6	6	5	4	4	4	4																
				¾	1	39	39	39	39	35	30	27	24	21	17	14	13	12	12	11	11	11																
				1	1	39	39	39	39	38	32	29	26	22	18	14	13	12	12	11	11	11																
				¾	1¼	39	39	39	39	39	39	39	39	34	28	26	25	23	22	21	21	21																
				1	1¼	78	78	78	78	74	62	53	47	39	31	26	25	23	22	21	21	21																
				1½	1¼	78	78	78	78	78•	74	65	54	43	34	26	25	23	22	21	21	21																
				1	1½	85	85	85	85	85	85	85	85	81	64	51	48	46	43	40	40	40																
1½	1½	151	151	151	151	151	151	130	113	88	73	51	51	46	43	40	40	40																				
2	1½	151	151	151	151	151	151	142	122	98	82	64	51	46	43	40	40	40																				
1	2	85	85	85	85	85	85	85	85	85	85	85	85	85	85	85	85	85																				
1½	2	370	370	370	370	360	335	305	282	244	212	187	172	153	141	129	129	129																				
2	2	370	370	370	370	370	370	370	340	288	245	204	172	153	141	129	129	129																				
2	2½	654	654	654	654	654	650	610	570	510	460	430	404	380	356	329	329	329																				
				FOR SI UNITS: 1 INCH = 25 MM, 1 FOOT = 304.8 MM, 1 POUND-FORCE PER SQUARE INCH = 6.8947 KPA NOTES: 1. AVAILABLE STATIC PRESSURE AFTER HEAD LOSS. 2. BUILDING SUPPLY, NOT LESS THAN ¾ OF AN INCH (20 MM) NOMINAL SIZE.																																		



ADU: 498 SQUARE
CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:
LUIS CALDERON
SnapADU


SIGNATURE

[illegible]

CODE COMPLIANCE NOTES
G201
22040



California

2022 CALIFORNIA GREEN BUILDING STANDARDS CODE

RESIDENTIAL MANDATORY MEASURES, SHEET 1 (January 2023)

Y
RESPON.
PARTY

YES
NOT APPLICABLE
RESPONSIBLE PARTY (i.e. ARCHITECT, ENGINEER,
OWNER, CONTRACTOR, INSPECTOR ETC.)

CHAPTER 3 GREEN BUILDING SECTION 301 GENERAL

301.1 SCOPE. Buildings shall be designed to include the green building measures specified as mandatory in the application checklists contained in this code. Voluntary green building measures are also included in the application checklists and may be included in the design and construction of structures covered by this code, but are not required unless adopted by a city, county, or city and county as specified in Section 101.7.

301.1.1 Additions and alterations. [HCD] The mandatory provisions of Chapter 4 shall be applied to additions or alterations of existing residential buildings where the addition or alteration increases the building's conditioned area, volume, or size. The requirements shall apply only to and/or within the specific area of the addition or alteration.

The mandatory provision of Section 4.106.4.2 may apply to additions or alterations of existing parking facilities or the addition of new parking facilities serving existing multifamily buildings. See Section 4.106.4.3 for application.

Note: Repairs including, but not limited to, resurfacing, restriping and repairing or maintaining existing lighting fixtures are not considered alterations for the purpose of this section.

Note: On and after January 1, 2014, residential buildings undergoing permitted alterations, additions, or improvements shall replace noncompliant plumbing fixtures with water-conserving plumbing fixtures. Plumbing fixture replacement is required prior to issuance of a certificate of final completion, certificate of occupancy or final permit approval by the local building department. See Civil Code Section 1101.1, et seq., for the definition of a noncompliant plumbing fixture, types of residential buildings affected and other important enactment dates.

301.2 LOW-RISE AND HIGH-RISE RESIDENTIAL BUILDINGS. [HCD] The provisions of individual sections of CALGreen may apply to either low-rise residential buildings (high-rise residential buildings, or both. Individual sections will be designated by banners to indicate where the section applies specifically to low-rise only (LR) or high-rise only (HR). When the section applies to both low-rise and high-rise buildings, no banner will be used.

SECTION 302 MIXED OCCUPANCY BUILDINGS

302.1 MIXED OCCUPANCY BUILDINGS. In mixed occupancy buildings, each portion of a building shall comply with the specific green building measures applicable to each specific occupancy.

- Exceptions:
- [HCD] Accessory structures and accessory occupancies serving residential buildings shall comply with Chapter 4 and Appendix A4, as applicable.
 - [HCD] For purposes of CALGreen, live/work units, complying with Section 419 of the *California Building Code*, shall not be considered mixed occupancies. Live/Work units shall comply with Chapter 4 and Appendix A4, as applicable.

DIVISION 4.1 PLANNING AND DESIGN

ABBREVIATION DEFINITIONS:

HCD	Department of Housing and Community Development
BSC	California Building Standards Commission
DSA-SS	Division of the State Architect, Structural Safety
OSHPD	Office of Statewide Health Planning and Development
LR	Low Rise
HR	High Rise
AA	Additions and Alterations
N	New

CHAPTER 4 RESIDENTIAL MANDATORY MEASURES

SECTION 4.102 DEFINITIONS

4.102.1 DEFINITIONS
The following terms are defined in Chapter 2 (*and are included here for reference*)

FRENCH DRAIN. A trench, hole or other depressed area loosely filled with rock, gravel, fragments of brick or similar pervious material used to collect or channel drainage or runoff water.

WATTLES. Wattles are used to reduce sediment in runoff. Wattles are often constructed of natural plant materials such as hay, straw or similar material shaped in the form of tubes and placed on a downflow slope. Wattles are also used for perimeter and inlet controls.

4.106 SITE DEVELOPMENT

4.106.1 GENERAL. Preservation and use of available natural resources shall be accomplished through evaluation and careful planning to minimize negative effects on the site and adjacent areas. Preservation of slopes, management of storm water drainage and erosion controls shall comply with this section.

4.106.2 STORM WATER DRAINAGE AND RETENTION DURING CONSTRUCTION. Projects which disturb less than one acre of soil and are not part of a larger common plan of development which in total disturbs one acre or more, shall manage storm water drainage during construction. In order to manage storm water drainage during construction, one or more of the following measures shall be implemented to prevent flooding of adjacent property, prevent erosion and retain soil runoff on the site.

- Retention basins of sufficient size shall be utilized to retain storm water on the site.
- Where storm water is conveyed to a public drainage system, collection point, gutter or similar disposal method, water shall be filtered by use of a barrier system, wattle or other method approved by the enforcing agency.
- Compliance with a lawfully enacted storm water management ordinance.

Note: Refer to the State Water Resources Control Board for projects which disturb one acre or more of soil, or are part of a larger common plan of development which in total disturbs one acre or more of soil.

(Website: https://www.waterboards.ca.gov/water_issues/programs/stormwater/construction.html)

4.106.3 GRADING AND PAVING. Construction plans shall indicate how the site grading or drainage system will manage all surface water flows to keep water from entering buildings. Examples of methods to manage surface water include, but are not limited to, the following:

- Swales
- Water collection and disposal systems
- French drains
- Water retention gardens
- Other water measures which keep surface water away from buildings and aid in groundwater recharge.

Exception: Additions and alterations not altering the drainage path.

4.106.4 Electric vehicle (EV) charging for new construction. New construction shall comply with Sections 4.106.4.1 or 4.106.4.2 to facilitate future installation and use of EV chargers. Electric vehicle supply equipment (EVSE) shall be installed in accordance with the *California Electrical Code*, Article 625.

Exceptions:

- On a case-by-case basis, where the local enforcing agency has determined EV charging and infrastructure are not feasible based upon one or more of the following conditions:
 - Where there is no local utility power supply or the local utility is unable to supply adequate power.
 - Where there is evidence suitable to the local enforcing agency substantiating that additional local utility infrastructure design requirements, directly related to the implementation of Section 4.106.4, may adversely impact the construction cost of the project.
- Accessory Dwelling Units (ADU) and Junior Accessory Dwelling Units (JADU) without additional parking facilities.

4.106.4.1 New one- and two-family dwellings and townhouses with attached private garages. For each dwelling unit, installed raceway to accommodate a dedicated 208/240-volt branch circuit. The raceway shall not be less than trade size 1 (nominal 1-inch inside diameter). The raceway shall originate at the main service or subpanel and shall terminate into a listed cabinet, box or other enclosure in close proximity to the proposed location of an EV charger. Raceways are required to be continuous at enclosed, inaccessible or concealed areas and spaces. The service panel and/or subpanel shall provide capacity to install a 40-ampere 208/240-volt minimum dedicated branch circuit and space(s) reserved to permit installation of a branch circuit overcurrent protective device.

Exception: A raceway is not required if a minimum 40-ampere 208/240-volt dedicated EV branch circuit is installed in close proximity to the proposed location of an EV charger at the time of original construction in accordance with the *California Electrical Code*.

4.106.4.1.1 Identification. The service panel or subpanel circuit directory shall identify the overcurrent protective device space(s) reserved for future EV charging as "EV CAPABLE". The raceway termination location shall be permanently and visibly marked as "EV CAPABLE".

4.106.4.2 New multifamily dwellings, hotels and motels and new residential parking facilities.

When parking is provided, parking spaces for new multifamily dwellings, hotels and motels shall meet the requirements of Sections 4.106.4.2.1 and 4.106.4.2.2. Calculations for spaces shall be rounded up to the nearest whole number. A parking space served by electric vehicle supply equipment or designed as a future EV charging space shall count as at least one standard automobile parking space only for the purpose of complying with any applicable minimum parking space requirements established by a local jurisdiction. See Vehicle Code Section 22511.2 for further details.

4.106.4.2.1 Multifamily development projects with less than 20 dwelling units; and hotels and motels with less than 20 sleeping units or guest rooms.
The number of dwelling units, sleeping units or guest rooms shall be based on all buildings on a project site subject to this section.

1. EV Capable. Ten (10) percent of the total number of parking spaces on a building site, provided for all types of parking facilities, shall be electric vehicle charging spaces (EV spaces) capable of supporting future Level 2 EVSE. Electrical load calculations shall demonstrate that the electrical panel service capacity and electrical system, including any on-site distribution transformer(s), have sufficient capacity to simultaneously charge all EVs at all required EV spaces at a minimum of 40 amperes.

The service panel or subpanel circuit directory shall identify the overcurrent protective device space(s) reserved for future EV charging purposes as "EV CAPABLE" in accordance with the *California Electrical Code*.

Exceptions:

- When EV chargers (Level 2 EVSE) are installed in a number equal to or greater than the required number of EV capable spaces.
- When EV chargers (Level 2 EVSE) are installed in a number less than the required number of EV capable spaces, the number of EV capable spaces required may be reduced by a number equal to the number of EV chargers installed.

Notes:

a. Construction documents are intended to demonstrate the project's capability and capacity for facilitating future EV charging.

b. There is no requirement for EV spaces to be constructed or available until receptacles for EV charging or EV chargers are installed for use.

2. EV Ready. Twenty-five (25) percent of the total number of parking spaces shall be equipped with low power Level 2 EV charging receptacles. For multifamily parking facilities, no more than one receptacle is required per dwelling unit when more than one parking space is provided for use by a single dwelling unit.

Exception: Areas of parking facilities served by parking lifts.

4.106.4.2.2 Multifamily development projects with 20 or more dwelling units, hotels and motels with 20 or more sleeping units or guest rooms.
The number of dwelling units, sleeping units or guest rooms shall be based on all buildings on a project site subject to this section.

1. EV Capable. Ten (10) percent of the total number of parking spaces on a building site, provided for all types of parking facilities, shall be electric vehicle charging spaces (EV spaces) capable of supporting future Level 2 EVSE. Electrical load calculations shall demonstrate that the electrical panel service capacity and electrical system, including any on-site distribution transformer(s), have sufficient capacity to simultaneously charge all EVs at all required EV spaces at a minimum of 40 amperes.

The service panel or subpanel circuit directory shall identify the overcurrent protective device space(s) reserved for future EV charging purposes as "EV CAPABLE" in accordance with the *California Electrical Code*.

Exception: When EV chargers (Level 2 EVSE) are installed in a number greater than five (5) percent of parking spaces required by Section 4.106.4.2.2, item 3, the number of EV capable spaces required may be reduced by a number equal to the number of EV chargers installed over the five (5) percent required.

Notes:

a. Construction documents shall show locations of future EV spaces.

b. There is no requirement for EV spaces to be constructed or available until receptacles for EV charging or EV chargers are installed for use.

2. EV Ready. Twenty-five (25) percent of the total number of parking spaces shall be equipped with low power Level 2 EV charging receptacles. For multifamily parking facilities, no more than one receptacle is required per dwelling unit when more than one parking space is provided for use by a single dwelling unit.

Exception: Areas of parking facilities served by parking lifts.

3. EV Chargers. Five (5) percent of the total number of parking spaces shall be equipped with Level 2 EVSE. Where common use parking is provided, at least one EV charger shall be located in the common use parking area and shall be available for use by all residents or guests.

When low power Level 2 EV charging receptacles or Level 2 EVSE are installed beyond the minimum required, an automatic load management system (ALMS) may be used to reduce the maximum required electrical capacity to each space served by the ALMS. The electrical system and any on-site distribution transformers shall have sufficient capacity to deliver at least 3.3 kW simultaneously to each EV charging station (EVCS) served by the ALMS. The branch circuit shall have a minimum capacity of 40 amperes, and installed EVSE shall have a capacity of not less than 30 amperes. ALMS shall not be used to reduce the minimum required electrical capacity to the required EV capable spaces.

4.106.4.2.2.1 Electric vehicle charging stations (EVCS).

Electric vehicle charging stations required by Section 4.106.4.2.2, item 3, shall comply with Section 4.106.4.2.2.1.

Exception: Electric vehicle charging stations serving public accommodations, public housing, motels and hotels shall not be required to comply with this section. See California Building Code, Chapter 11B, for applicable requirements.

4.106.4.2.2.1.1 Location.

EVCS shall comply with at least one of the following options:

- The charging space shall be located adjacent to an accessible parking space meeting the requirements of the California Building Code, Chapter 11A, to allow use of the EV charger from the accessible parking space, Chapter 2, to the building.
- The charging space shall be located on an accessible route, as defined in the California Building Code, Chapter 2, to the building.

Exception: Electric vehicle charging stations designed and constructed in compliance with the California Building Code, Chapter 11B, are not required to comply with Section 4.106.4.2.2.1.1 and Section 4.106.4.2.2.1.2, item 3.

4.106.4.2.2.1.2 Electric vehicle charging stations (EVCS) dimensions.

The charging spaces shall be designed to comply with the following:

- The minimum length of each EV space shall be 18 feet (5486 mm).

- The minimum width of each EV space shall be 9 feet (2743 mm).

- One in every 25 charging spaces, but not less than one, shall also have an 8-foot (2438 mm) wide minimum aisle. A 5-foot (1524 mm) wide minimum aisle shall be permitted provided the minimum width of the EV space is 12 feet (3658 mm).

a. Surface slope for this EV space and the aisle shall not exceed 1 unit vertical in 48 units horizontal (2.083 percent slope) in any direction.

4.106.4.2.2.1.3 Accessible EV spaces.

In addition to the requirements in Sections 4.106.4.2.2.1.1 and 4.106.4.2.2.1.2, all EVSE, when installed, shall comply with the accessibility provisions for EV chargers in the California Building Code, Chapter 11B. EV ready spaces and EVCS in multifamily developments shall comply with California Building Code, Chapter 11A, Section 1109A.

4.106.4.2.3 EV space requirements.

1. Single EV space required. Install a listed raceway capable of accommodating a 208/240-volt dedicated branch circuit. The raceway shall not be less than trade size 1 (nominal 1-inch inside diameter). The raceway shall originate at the main service or subpanel and shall terminate into a listed cabinet, box or enclosure in close proximity to the proposed location of the EV space. Construction documents shall identify the raceway termination point, receptacle or charger location, as applicable. The service panel and/or subpanel shall have a 40-ampere minimum dedicated branch circuit, including branch circuit overcurrent protective device installed, or space(s) reserved to permit installation of a branch circuit overcurrent protective device.

Exception: A raceway is not required if a minimum 40-ampere 208/240-volt dedicated EV branch circuit is installed in close proximity to the location or the proposed location of the EV space, at the time of original construction in accordance with the *California Electrical Code*.

2. Multiple EV spaces required. Construction documents shall indicate the raceway termination point and the location of installed or future EV spaces, receptacles or EV chargers. Construction documents shall also provide information on amperage of installed or future receptacles or EVSE, raceway method(s), wiring schematics and electrical load calculations. Plan design shall be based upon a 40-ampere minimum branch circuit. Required raceways and related components that are planned to be installed underground, enclosed, inaccessible or in concealed areas and spaces shall be installed at the time of original construction.

Exception: A raceway is not required if a minimum 40-ampere 208/240-volt dedicated EV branch circuit is installed in close proximity to the location or the proposed location of the EV space at the time of original construction in accordance with the *California Electrical Code*.

4.106.4.2.4 Identification.

The service panel or subpanel circuit directory shall identify the overcurrent protective device space(s) reserved for future EV charging purposes as "EV CAPABLE" in accordance with the California Electrical Code.

4.106.4.2.5 Electric Vehicle Ready Space Signage.

Electric vehicle ready spaces shall be identified by signage or pavement markings, in compliance with Caltrans Traffic Operations Policy Directive 13-01 (Zero Emission Vehicle Signs and Pavement Markings) or its successor(s).

4.106.4.3 Electric vehicle charging for additions and alterations of parking facilities serving existing multifamily buildings.

When new parking facilities are added, or electrical systems or lighting of existing parking facilities are added or altered and the work requires a building permit, ten (10) percent of the total number of parking spaces added or altered shall be electric vehicle charging spaces (EV spaces) capable of supporting future Level 2 EVSE.

Notes:

1. Construction documents are intended to demonstrate the project's capability and capacity for facilitating future EV charging.

2. There is no requirement for EV spaces to be constructed or available until EV chargers are installed for use.

DIVISION 4.2 ENERGY EFFICIENCY

4.201 GENERAL

4.201.1 SCOPE. For the purposes of mandatory energy efficiency standards in this code, the California Energy Commission will continue to adopt mandatory standards.

DIVISION 4.3 WATER EFFICIENCY AND CONSERVATION

4.303 INDOOR WATER USE

4.303.1 WATER CONSERVING PLUMBING FIXTURES AND FITTINGS. Plumbing fixtures (water closets and urinals) and fittings (faucets and showerheads) shall comply with the sections 4.303.1.1, 4.303.1.2, 4.303.1.3, and 4.303.1.4.

Note: All noncompliant plumbing fixtures in any residential real property shall be replaced with water-conserving plumbing fixtures. Plumbing fixture replacement is required prior to issuance of a certificate of final completion, certificate of occupancy, or final permit approval by the local building department. See Civil Code Section 1101.1, et seq., for the definition of a noncompliant plumbing fixture, types of residential buildings affected and other important enactment dates.

4.303.1.1 Water Closets. The effective flush volume of all water closets shall not exceed 1.28 gallons per flush. Tank-type water closets shall be certified to the performance criteria of the U.S. EPA WaterSense Specification for Tank-type Toilets.

Note: The effective flush volume of dual flush toilets is defined as the composite, average flush volume of two reduced flushes and one full flush.

4.303.1.2 Urinals. The effective flush volume of wall mounted urinals shall not exceed 0.125 gallons per flush. The effective flush volume of all other urinals shall not exceed 0.5 gallons per flush.

4.303.1.3 Showerheads.

4.303.1.3.1 Single Showerhead. Showerheads shall have a maximum flow rate of not more than 1.8 gallons per minute at 80 psi. Showerheads shall be certified to the performance criteria of the U.S. EPA WaterSense Specification for Showerheads.

4.303.1.3.2 Multiple showerheads serving one shower. When a shower is served by more than one showerhead, the combined flow rate of all the showerheads and/or other shower outlets controlled by a single valve shall not exceed 1.8 gallons per minute at 80 psi, or the shower shall be designed to only allow one shower outlet to be in operation at a time.

Note: A hand-held shower shall be considered a showerhead.

4.303.1.4 Faucets.

4.303.1.4.1 Residential Lavatory Faucets. The maximum flow rate of residential lavatory faucets shall not exceed 1.2 gallons per minute at 60 psi. The minimum flow rate of residential lavatory faucets shall not be less than 0.8 gallons per minute at 20 psi.

4.303.1.4.2 Lavatory Faucets in Common and Public Use Areas. The maximum flow rate of lavatory faucets installed in common and public use areas (outside of dwellings or sleeping units) in residential buildings shall not exceed 0.5 gallons per minute at 60 psi.

4.303.1.4.3 Metering Faucets. Metering faucets when installed in residential buildings shall not deliver more than 0.2 gallons per cycle.

4.303.1.4.4 Kitchen Faucets. The maximum flow rate of kitchen faucets shall not exceed 1.8 gallons per minute at 60 psi. Kitchen faucets may temporarily increase the flow above the maximum rate, but not to exceed 2.2 gallons per minute at 60 psi, and must default to a maximum flow rate of 1.8 gallons per minute at 60 psi.

Note: Where complying faucets are unavailable, aerators or other means may be used to achieve reduction.

4.303.1.4.5 Pre-rinse spray valves.

When installed, shall meet the requirements in the *California Code of Regulations*, Title 20 (Appliance Efficiency Regulations), Sections 1605.1 (h)(4) Table H-2, Section 1605.3 (h)(4)(A), and Section 1607 (d)(7) and shall be equipped with an integral automatic shutoff.

FOR REFERENCE ONLY: The following table and code section have been reprinted from the *California Code of Regulations*, Title 20 (Appliance Efficiency Regulations), Section 1605.1 (h)(4) and Section 1605.3 (h)(4)(A).

TABLE H-2

STANDARDS FOR COMMERCIAL PRE-RINSE SPRAY
VALUES MANUFACTURED ON OR AFTER JANUARY 28, 2019

PRODUCT CLASS [spray force in ounce force (ozf)]	MAXIMUM FLOW RATE (gpm)
Product Class 1 (≤ 5.0 ozf)	1.00
Product Class 2 (> 5.0 ozf and ≤ 8.0 ozf)	1.20
Product Class 3 (> 8.0 ozf)	1.28

Title 20 Section 1605.3 (h)(4)(A). Commercial prerinse spray valves manufactured on or after January 1, 2006, shall have a minimum spray force of not less than 4.0 ounces-force (ozf)[113 grams-force(gf)]

4.303.2 Submersers for multifamily buildings and dwelling units in mixed-used residential-commercial buildings.

Submersers shall be installed to measure water usage of individual rental dwelling units in accordance with the *California Plumbing Code*.

4.303.3 Standards for plumbing fixtures and fittings. Plumbing fixtures and fittings shall be installed in accordance with the *California Plumbing Code*, and shall meet the applicable standards referenced in Table T701.1 of the *California Plumbing Code*.

NOTE:

THIS TABLE COMPILES THE DATA IN SECTION 4.303.1, AND IS INCLUDED AS A CONVENIENCE FOR THE USER.

FIXTURE TYPE	FLOW RATE
SHOWER HEADS (RESIDENTIAL)	1.8 GMP @ 80 PSI
LAVATORY FAUCETS (RESIDENTIAL)	MAX. 1.2 GPM @ 60 PSI MIN. 0.8 GPM @ 20 PSI
LAVATORY FAUCETS IN COMMON & PUBLIC USE AREAS	0.5 GPM @ 60 PSI
KITCHEN FAUCETS	1.8 GPM @ 60 PSI
METERING FAUCETS	0.2 GAL/CYCLE
WATER CLOSET	1.28 GAL/FLUSH
URINALS	0.125 GAL/FLUSH

4.304 OUTDOOR WATER USE

4.304.1 OUTDOOR POTABLE WATER USE IN LANDSCAPE AREAS. Residential developments shall comply with a local water efficient landscape ordinance or the current California Department of Water Resources' Model Water Efficient Landscape Ordinance (MWELO), whichever is more stringent.

NOTES:

- The Model Water Efficient Landscape Ordinance (MWELO) is located in the *California Code Regulations*, Title 23, Chapter 2.7, Division 2. MWELO and supporting documents, including water budget calculator, are available at: <https://www.water.ca.gov/>

DIVISION 4.4 MATERIAL CONSERVATION AND RESOURCE EFFICIENCY

4.406 ENHANCED DURABILITY AND REDUCED MAINTENANCE

4.406.1 RODENT PROOFING. Annular spaces around pipes, electric cables, conduits or other openings in sole/bottom plates at exterior walls shall be protected against the passage of rodents by closing such openings with cement mortar, concrete masonry or a similar method acceptable to the enforcing agency.

4.408 CONSTRUCTION WASTE REDUCTION, DISPOSAL AND RECYCLING

4.408.1 CONSTRUCTION WASTE MANAGEMENT. Recycle and/or salvage for reuse a minimum of 65 percent of the non-hazardous construction and demolition waste in accordance with either Section 4.408.2, 4.408.3 or 4.408.4, or meet a more stringent local construction and demolition waste management ordinance.

Exceptions:

- Excavated soil and land-clearing debris.
- Alternate waste reduction methods developed by working with local agencies if diversion or recycle facilities capable of compliance with this item do not exist or are not located reasonably close to the jobsite.
- The enforcing agency may make exceptions to the requirements of this section when isolated jobsites are located in areas beyond the haul boundaries of the diversion facility.

4.408.2 CONSTRUCTION WASTE MANAGEMENT PLAN. Submit a construction waste management plan in conformance with Items 1 through 5. The construction waste management plan shall be updated as necessary and shall be available during construction for examination by the enforcing agency.

- Identify the construction and demolition waste materials to be diverted from disposal by recycling, reuse on the project or salvage for future use or sale.
- Specify if construction and demolition waste materials will be sorted on-site (source separated) or bulk mixed (single stream).
- Identify diversion facilities where the construction and demolition waste material collected will be taken.
- Identify construction methods employed to reduce the amount of construction and demolition waste generated.
- Specify that the amount of construction and demolition waste materials diverted shall be calculated by weight or volume, but not by both.

4.408.3 WASTE MANAGEMENT COMPANY. Utilize a waste management company, approved by the enforcing agency, which can provide verifiable documentation that the percentage of construction and demolition waste material diverted from the landfill complies with Section 4.408.1.

Note: The owner or contractor may make the determination if the construction and demolition waste materials will be diverted by a waste management company.

4.408.4 WASTE STREAM REDUCTION ALTERNATIVE [LR]. Projects that generate a total combined weight of construction and demolition waste disposed of in landfills, which do not exceed 3.4 lbs./sq.ft. of the building area shall meet the minimum 65% construction waste reduction requirement in Section 4.408.1.

4.408.4.1 WASTE STREAM REDUCTION ALTERNATIVE. Projects that generate a total combined weight of construction and demolition waste disposed of in landfills, which do not exceed 2 pounds per square foot of the building area, shall meet the minimum 65% construction waste reduction requirement in Section 4.408.1.

4.408.5 DOCUMENTATION. Documentation shall be provided to the enforcing agency which demonstrates compliance with Section 4.408.2, Items 1 through 5, Section 4.408.3 or Section 4.408.4.

NOTES:

- Sample forms found in "A Guide to the California Green Building Standards Code (Residential)" located at www.hcd.ca.gov/CALGreen.html may be used to assist in documenting compliance with this section.
- Mixed construction and demolition debris (C & D) processors can be located at the California Department of Resources Recycling and Recovery (CalRecycle).

4.410 BUILDING MAINTENANCE AND OPERATION

4.410.1 OPERATION AND MAINTENANCE MANUAL. At the time of final inspection, a manual, compact disc, web-based reference or other media acceptable to the enforcing agency which includes all of the following shall be placed in the building:

- Directions to the owner or occupant that the manual shall remain with the building throughout the life cycle of the structure.
- Operation and maintenance instructions for the following:
 - Equipment and appliances, including water-saving devices and systems, HVAC systems, photovoltaic systems, electric vehicle chargers, water-heating systems and other major appliances and equipment.
 - Roof and yard drainage, including gutters and downspouts.
 - Space conditioning systems, including condensers and air filters.
 - Landscape irrigation systems.
 - Water reuse systems.
- Information from local utility, water and waste recovery providers on methods to further reduce resource consumption, including recycle programs and locations.</



Y	=	YES
N/A	=	NOT APPLICABLE
RESPON. PARTY	=	RESPONSIBLE PARTY (ie: ARCHITECT, ENGINEER, OWNER, CONTRACTOR, INSPECTOR ETC.)

DISCLAIMER: THIS DOCUMENT IS PROVIDED AND INTENDED TO BE USED AS A MEANS TO INDICATE AREAS OF COMPLIANCE WITH THE CALIFORNIA GREEN BUILDING STANDARDS (CALGREEN) CODE. DUE TO THE VARIABLES BETWEEN BUILDING DEPARTMENT JURISDICTIONS, THIS CHECKLIST IS TO BE USED ON AN INDIVIDUAL PROJECT BASIS AND MAY BE MODIFIED BY THE END USER TO MEET THOSE INDIVIDUAL NEEDS. THE END USER ASSUMES ALL RESPONSIBILITY ASSOCIATED WITH THE USE OF THIS DOCUMENT, INCLUDING VERIFICATION WITH THE FULL CODE.



YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 498 SQUARE
CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:
LUIS CALDERON
SnapADU


SIGNATURE

[illegible]

CAL-GREEN REQUIREMENTS

G301

22040

Autodesk Docs \| 22040_City of Chula Vista\22040_City of Chula Vista_498
Square_V2_CD_RV7222.rvt
3/24/2024 7:24:21 AM

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD
Project Name: 2310-22-0616 Chula-Vista ADU -- 498 Square -- Standard 1BR RF
Calculation Description: Title 24 Analysis
Calculation Date/Time: 2023-10-31T14:17:25-07:00
Input File Name: 2310-22-0616 Chula-Vista ADU -- 498 Square -- Standard 1BR RF.rbd22x
CF1R-PRF-01E
(Page 1 of 11)

GENERAL INFORMATION													
01	Project Name 2310-22-0616 Chula-Vista ADU -- 498 Square -- Standard 1BR RF												
02	Run Title Title 24 Analysis												
03	Project Location 276 4th Avenue												
04	City	Chula Vista	05	Standards Version 2022									
06	Zip code	91910	07	Software Version EnergyPro 9.2									
08	Climate Zone	7	09	Front Orientation (deg/ Cardinal) All orientations									
10	Building Type	Single family	11	Number of Dwelling Units 1									
12	Project Scope	Newly Constructed	13	Number of Bedrooms 1									
14	Addition Cond. Floor Area (ft²)		0	15	Number of Stories 1								
16	Existing Cond. Floor Area (ft²)		n/a	17	Fenestration Average U-factor 0.3								
18	Total Cond. Floor Area (ft²)		498	19	Glazing Percentage (%) 14.76%								
20	ADU Bedroom Count		n/a	21	ADU Conditioned Floor Area n/a								
22	Fuel Type		Natural gas	23	No Dwelling Unit: No								

COMPLIANCE RESULTS	
01	Building Complies with Computer Performance
02	This building incorporates features that require field testing and/or verification by a certified HERS rater under the supervision of a CEC-approved HERS provider.
03	This building incorporates one or more Special Features shown below

Registration Number: 423-P010198370A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance
Registration Date/Time: 11/01/2023 09:47
Report Version: 2022.0.000
Schema Version: rev 20220901
HERS Provider: CHEERS
Report Generated: 2023-10-31 14:18:01

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD
Project Name: 2310-22-0616 Chula-Vista ADU -- 498 Square -- Standard 1BR RF
Calculation Description: Title 24 Analysis
Calculation Date/Time: 2023-10-31T14:17:25-07:00
Input File Name: 2310-22-0616 Chula-Vista ADU -- 498 Square -- Standard 1BR RF.rbd22x
CF1R-PRF-01E
(Page 4 of 11)

Energy Use	Standard Design Source Energy (EDR1) (kBtu/ft² · yr)	Standard Design TDV Energy (EDR2) (kTDV/ft² · yr)	Proposed Design Source Energy (EDR1) (kBtu/ft² · yr)	Proposed Design TDV Energy (EDR2) (kTDV/ft² · yr)	Compliance Margin (EDR1)	Compliance Margin (EDR2)
Space Heating	0.02	0.13	0.3	2.26	-0.28	-2.13
Space Cooling	1.74	31.19	0.82	16.95	0.92	14.24
IAQ Ventilation	0.46	4.95	0.46	4.95	0	0
Water Heating	3.1	36.29	2.39	27.93	0.71	8.36
Self Utilization/Flexibility Credit				0		0
South Facing Efficiency Compliance Total	5.32	72.56	3.97	52.09	1.35	20.47
Space Heating	0.02	0.13	0.24	1.85	-0.22	-1.72
Space Cooling	1.74	31.19	0.78	16.07	0.96	15.12
IAQ Ventilation	0.46	4.95	0.46	4.95	0	0
Water Heating	3.1	36.29	2.38	27.88	0.72	8.41
Self Utilization/Flexibility Credit				0		0
West Facing Efficiency Compliance Total	5.32	72.56	3.86	50.75	1.46	21.81

Registration Number: 423-P010198370A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance
Registration Date/Time: 11/01/2023 09:47
Report Version: 2022.0.000
Schema Version: rev 20220901
HERS Provider: CHEERS
Report Generated: 2023-10-31 14:18:01

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD
Project Name: 2310-22-0616 Chula-Vista ADU -- 498 Square -- Standard 1BR RF
Calculation Description: Title 24 Analysis
Calculation Date/Time: 2023-10-31T14:17:25-07:00
Input File Name: 2310-22-0616 Chula-Vista ADU -- 498 Square -- Standard 1BR RF.rbd22x
CF1R-PRF-01E
(Page 7 of 11)

OPAQUE SURFACES							
01	02	03	04	05	06	07	08
Name	Zone	Construction	Azimuth	Orientation	Gross Area (ft²)	Window and Door Area (ft2)	Tilt (deg)
New Front Wall	New ADU	R-21 Wall	0	Front	181	32	90
New Left Wall	New ADU	R-21 Wall	90	Left	192	13.5	90
New Back Wall	New ADU	R-21 Wall	180	Back	166	0	90
New Right Wall	New ADU	R-21 Wall	270	Right	192	48	90
New Roof Attic	New ADU	R-30 Roof Attic	n/a	n/a	498	n/a	n/a
New Raised Floor	New ADU	R-19 Floor Crawlspace	n/a	n/a	498	n/a	n/a

01	02	03	04	05	06	07	08
Name	Construction	Type	Roof Rise (x in 12)	Roof Reflectance	Roof Emittance	Radiant Barrier	Cool Roof
Attic New ADU	Attic RoofNew ADU	Ventilated	4.5	0.1	0.85	Yes	No

FENESTRATION / GLAZING													
01	02	03	04	05	06	07	08	09	10	11	12	13	14
Name	Type	Surface	Orientation	Azimuth	Width (ft)	Height (ft)	Mult.	Area (ft²)	U-factor	U-factor Source	SHGC	SHGC Source	Exterior Shading
Window W5	Window	New Front Wall	Front	0			1	12	0.3	NFRC	0.23	NFRC	Bug Screen
Window W4	Window	New Left Wall	Left	90			1	10.5	0.3	NFRC	0.23	NFRC	Bug Screen
Window W3	Window	New Left Wall	Left	90			1	3	0.3	NFRC	0.23	NFRC	Bug Screen
Window W2	Window	New Right Wall	Right	270			1	24	0.3	NFRC	0.23	NFRC	Bug Screen
Window W1	Window	New Right Wall	Right	270			1	24	0.3	NFRC	0.23	NFRC	Bug Screen

Registration Number: 423-P010198370A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance
Registration Date/Time: 11/01/2023 09:47
Report Version: 2022.0.000
Schema Version: rev 20220901
HERS Provider: CHEERS
Report Generated: 2023-10-31 14:18:01

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD
Project Name: 2310-22-0616 Chula-Vista ADU -- 498 Square -- Standard 1BR RF
Calculation Description: Title 24 Analysis
Calculation Date/Time: 2023-10-31T14:17:25-07:00
Input File Name: 2310-22-0616 Chula-Vista ADU -- 498 Square -- Standard 1BR RF.rbd22x
CF1R-PRF-01E
(Page 2 of 11)

ENERGY DESIGN RATINGS						
Standard Design	Energy Design Ratings			Compliance Margins		
	Source Energy (EDR1)	Efficiency ¹ EDR (EDR2efficiency)	Total ² EDR (EDR2total)	Source Energy (EDR1)	Efficiency ¹ EDR (EDR2efficiency)	Total ² EDR (EDR2total)
Standard Design	46.6	50.1	64.5			
Proposed Design						
North Facing	43.9	36.2	58.5	2.7	13.9	.6
East Facing	43.5	34.5	57.8	3.1	15.6	6.7
South Facing	43.7	35.9	58.4	2.9	14.2	6.1
West Facing	43.5	35	58.1	3.1	15.1	6.4
RESULT ³ : PASS						
¹ Efficiency EDR includes improvements like a better building envelope and more efficient equipment ² Total EDR includes efficiency and demand response measures such as photovoltaic (PV) system and batteries ³ Building complies when source energy, efficiency and total compliance margins are greater than or equal to zero and unmet load hour limits are not exceeded						
• Standard Design PV Capacity: 0.00 kWdc • Proposed PV Capacity Scaling: North (0.00 kWdc) East (0.00 kWdc) South (0.00 kWdc) West (0.00 kWdc)						

Registration Number: 423-P010198370A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance
Registration Date/Time: 11/01/2023 09:47
Report Version: 2022.0.000
Schema Version: rev 20220901
HERS Provider: CHEERS
Report Generated: 2023-10-31 14:18:01

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD
Project Name: 2310-22-0616 Chula-Vista ADU -- 498 Square -- Standard 1BR RF
Calculation Description: Title 24 Analysis
Calculation Date/Time: 2023-10-31T14:17:25-07:00
Input File Name: 2310-22-0616 Chula-Vista ADU -- 498 Square -- Standard 1BR RF.rbd22x
CF1R-PRF-01E
(Page 5 of 11)

ENERGY USE INTENSITY				
	Standard Design (kBtu/ft² · yr)	Proposed Design (kBtu/ft² · yr)	Compliance Margin (kBtu/ft² · yr)	Margin Percentage
North Facing				
Gross EU1	30.83	28.37	2.46	7.98
Net EU1	30.83	28.37	2.46	7.98
East Facing				
Gross EU1	30.83	28.09	2.74	8.89
Net EU1	30.83	28.09	2.74	8.89
South Facing				
Gross EU1	30.83	28.36	2.47	8.01
Net EU1	30.83	28.36	2.47	8.01
West Facing				
Gross EU1	30.83	28.15	2.68	8.69
Net EU1	30.83	28.15	2.68	8.69
Notes	1. Gross EU1 is Energy Use Total (not including PV) / Total Building Area. 2. Net EU1 is Energy Use Total (including PV) / Total Building Area.			

Registration Number: 423-P010198370A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance
Registration Date/Time: 11/01/2023 09:47
Report Version: 2022.0.000
Schema Version: rev 20220901
HERS Provider: CHEERS
Report Generated: 2023-10-31 14:18:01

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD
Project Name: 2310-22-0616 Chula-Vista ADU -- 498 Square -- Standard 1BR RF
Calculation Description: Title 24 Analysis
Calculation Date/Time: 2023-10-31T14:17:25-07:00
Input File Name: 2310-22-0616 Chula-Vista ADU -- 498 Square -- Standard 1BR RF.rbd22x
CF1R-PRF-01E
(Page 8 of 11)

OPAQUE DOORS			
01	02	03	04
Name	Side of Building	Area (ft²)	U-factor
Front Door D1	New Front Wall	20	0.2

OPAQUE SURFACE CONSTRUCTIONS							
01	02	03	04	05	06	07	08
Construction Name	Surface Type	Construction Type	Framing	Total Cavity R-value	Interior / Exterior Continuous R-value	U-factor	Assembly Layers
R-21 Wall	Exterior Walls	Wood Framed Wall	2x6 @ 16 in. O. C.	R-21	None / None	0.069	Inside Finish: Gypsum Board Cavity / Frame: R-21 / 2x6 Exterior Finish: 3 Coat Stucco
Attic RoofNew ADU	Attic Roofs	Wood Framed Ceiling	2x4 @ 24 in. O. C.	R-0	None / 0	0.644	Roofing: Light Roof (Asphalt Shingle) Roof Deck: Wood Siding/sheathing/decking Cavity / Frame: no insul. / 2x4
R-19 Floor Crawlspace	Floors Over Crawlspace	Wood Framed Floor	2x10 @ 16 in. O. C.	R-19	None / None	0.046	Floor Surface: Carpeted Floor Deck: Wood Siding/sheathing/decking Cavity / Frame: R-19 / 2x10
R-30 Roof Attic	Ceilings (below attic)	Wood Framed Ceiling	2x4 @ 24 in. O. C.	R-30	None / None	0.032	Over Ceiling Joists: R-20.9 Insul. Cavity / Frame: R-9.1 / 2x4 Inside Finish: Gypsum Board

BUILDING ENVELOPE - HERS VERIFICATION				
01	02	03	04	05
Quality Insulation Installation (QII)	High R-value Spray Foam Insulation	Building Envelope Air Leakage	CFM50	CFM50
Required	Not Required	N/A	n/a	n/a

Registration Number: 423-P010198370A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance
Registration Date/Time: 11/01/2023 09:47
Report Version: 2022.0.000
Schema Version: rev 20220901
HERS Provider: CHEERS
Report Generated: 2023-10-31 14:18:01

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD
Project Name: 2310-22-0616 Chula-Vista ADU -- 498 Square -- Standard 1BR RF
Calculation Description: Title 24 Analysis
Calculation Date/Time: 2023-10-31T14:17:25-07:00
Input File Name: 2310-22-0616 Chula-Vista ADU -- 498 Square -- Standard 1BR RF.rbd22x
CF1R-PRF-01E
(Page 3 of 11)


ENERGY USE SUMMARY						
Energy Use	Standard Design Source Energy (EDR1) (kBtu/ft² · yr)	Standard Design TDV Energy (EDR2) (kTDV/ft² · yr)	Proposed Design Source Energy (EDR1) (kBtu/ft² · yr)	Proposed Design TDV Energy (EDR2) (kTDV/ft² · yr)	Compliance Margin (EDR1)	Compliance Margin (EDR2)
Space Heating	0.02	0.13	0.39	3.06	-0.37	-2.93
Space Cooling	1.74	31.19	0.84	16.44	0.9	14.75
IAQ Ventilation	0.46	4.95	0.46	4.95	0	0
Water Heating	3.1	36.29	2.39	28	0.71	8.29
Self Utilization/Flexibility Credit				0		0
North Facing Efficiency Compliance Total	5.32	72.56	4.08	52.45	1.24	20.11
Space Heating	0.02	0.13	0.39	2.99	-0.37	-2.86
Space Cooling	1.74	31.19	0.67	13.91	1.07	17.28
IAQ Ventilation	0.46	4.95	0.46	4.95	0	0
Water Heating	3.1	36.29	2.4	28.09	0.7	8.2
Self Utilization/Flexibility Credit				0		0
East Facing Efficiency Compliance Total	5.32	72.56	3.92	49.94	1.4	22.62

Registration Number: 423-P010198370A-000-000-0000000-0000
NOTICE: This document has been generated by California Home Energy Efficiency Rating Services (CHEERS) using information uploaded by third parties not affiliated with or related to CHEERS. Therefore, CHEERS is not responsible for, and cannot guarantee, the accuracy or completeness of the information contained in this document.
CA Building Energy Efficiency Standards - 2022 Residential Compliance
Registration Date/Time: 11/01/2023 09:47
Report Version: 2022.0.000
Schema Version: rev 20220901
HERS Provider: CHEERS
Report Generated: 2023-10-31 14:18:01

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD
Project Name: 2310-22-0616 Chula-Vista ADU -- 498 Square -- Standard 1BR RF
Calculation Description: Title 24 Analysis
Calculation Date/Time: 2023-10-31T14:17:25-07:00
Input File Name: 2310-22-0616 Chula-Vista ADU -- 498 Square -- Standard 1BR RF.rbd22x
CF1R-PRF-01E
(Page 6 of 11)

REQUIRED PV SYSTEMS											
01	02	03	04	05	06	07	08	09	10	11	12
DC System Size (kWdc)	Exception	Module Type	Array Type	Power Electronics	CFI	Azimuth (deg)	Tilt Input	Array Angle (deg)	Tilt: (x in 12)	Inverter Eff. (%)	Annual Solar Access (%)
0		Standard (14-17%)	Fixed	none	true	n/a	n/a	n/a	n/a	n/a	

REQUIRED SPECIAL FEATURES	
The following are features that must be installed as condition for meeting the modeled energy performance for this computer analysis.	
•	PV exception 2: No PV required when minimum PV size (Section 150.1(c)(14) < 1.8 kWdc (0 kW)
•	Northwest Energy Efficiency Alliance (NEEA) rated heat pump water heater; specific brand/model, or equivalent, must be installed





Building Envelope

Building Envelope

5/6/225/6/22

*Exceptions may apply

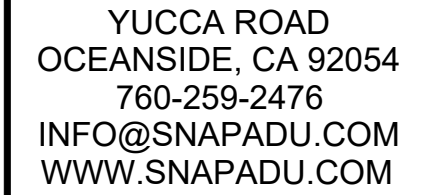5/6/225/6/225/6/22

ADU: 498 SQUARE
CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:
LUIS CALDERON
SnapADU


SIGNATURE

[illegible]

SFR MANDATORY MEASURES

G420

22040

KEYNOTES:


KEYNOTE	DESCRIPTION

EXISTING SITE PLAN LEGEND

	(E) STRUCTURES		PROPERTY LINE
			TO BE REMOVED
			SETBACK LINE
	(E) NATIVE LANDSCAPING		EASEMENT LINE
			STREET CENTERLINE
			(E) WATER LINE
	(E) ASPHALT		(E) ELECTRICAL LINE
			(E) NATURAL GAS LINE
			(E) SEWAGE LINE
	(E) PAVERS		COUNTOUR LINE
			(E) PERIMETER FENCING

GENERAL NOTES

1. THIS PROJECT PROPOSES NO WORK WITHIN THE PUBLIC RIGHT-OF-WAY.
2. ALL DRAINAGE FROM IMPERVIOUS AREAS & DOWNSPOUTS TO BE ROUTED TO LANDSCAPE AREAS & PLANTER BOXES.
3. A BOUNDARY SURVEY OR A BUILDING VERIFICATION SURVEY, TO DETERMINE EXACT LOCATION OF PROPERTY LINES, INCLUDING THE RELATION OF THOSE LINES TO THE ADJACENT LOCATION IS REQUIRED AS PART OF THIS PLAN SET. WITHOUT CONDUCTING A BOUNDARY SURVEY IT IS NOT POSSIBLE TO PERFORM A BUILDING VERIFICATION SURVEY FROM A LICENSE PROFESSIONAL LAND SURVEYOR.

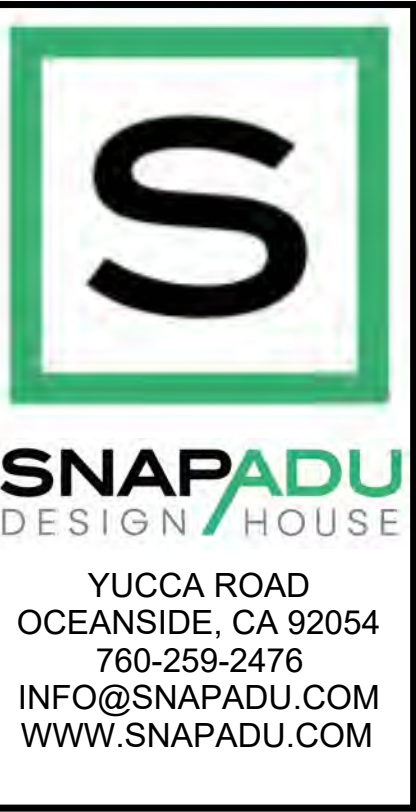

ADU: 498 SQUARE
CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:
LUIS CALDERON
SnapADU


SIGNATURE


[illegible]

EXISTING SITE PLAN
A010
22040


MARK	WIDTH	HEIGHT	R.O. WIDTH	R.O. HEIGHT	TYPE	COMMENTS
D7	6' - 0"	6' - 8"	6' - 2"	6' - 10"	EXTERIOR SLIDING GLASS DOOR	TEMPERED
D8	3' - 0"	6' - 8"	3' - 2"	6' - 10"	INTERIOR SINGLE PANEL DOOR	
D9	3' - 0"	6' - 8"	3' - 2"	6' - 10"	INTERIOR SINGLE PANEL DOOR	
D10	3' - 0"	6' - 8"	3' - 2"	6' - 10"	INTERIOR SINGLE PANEL DOOR	
D11	3' - 6"	6' - 8"	3' - 8 1/2"	3' - 8"	INTERIOR DOUBLE PANEL DOOR	100 SQ. IN. MIN. AIR TRANSFER GRILLE ABOVE DOOR

MARK	WIDTH	HEIGHT	R.O. WIDTH	R.O. HEIGHT	SILL HEIGHT	HEADER HEIGHT	TYPE	COMMENTS


1. FIELD VERIFY ALL DIMENSIONS PRIOR TO ORDERING.
2. DOOR SWING DIRECTION PER PLAN.
3. DIMENSIONS DO NOT INCLUDE DOOR FRAME, U.O.
4. PROVIDE SUITABLE ISOLATOR BETWEEN DIS-SIMILAR METALS (I.E. ALUMINUM & STEEL).
5. ALL GLAZING IN DOORS SHALL BE TEMPERED.
6. ALL WINDOWS (U.O.) SHALL BE GLAZED PER TITLE 24 REQUIREMENTS.
7. ALL MANUFACTURED WINDOWS SHALL HAVE A LABEL ATTACHED CERTIFIED BY AN INDEPENDENT TESTING AGENCY SUCH AS COUNCIL (NFRC) AND SHOWING COMPLIANCE WITH THE TITLE 24 ENERGY REPORT.
8. ALL WINDOWS SHOULD HAVE A MAX U-FACTOR OF: .30, A MAXIMUM SHGC OF: .23.
9. PROVIDE TEMPERED GLASS ("TEMP") AT WINDOWS WITH A 24-INCH ARCH OF A DOOR JAMB, AND AT GLAZING UNITS ABOVE THE SHOWER OR BATHTUB. IN SAUNAS OR STEAM BATHS WHERE THE 36" IS WITHIN 60 INCHES MEASURED VERTICALLY FROM THE WET STANDING SURFACE.
10. TEMPERED GLASS AT THE FOLLOWING LOCATIONS REQUIRING SAFETY GLAZING:
 - A. GLAZING IN SWINGING, SLIDING, AND BI-FOLD DOORS (CRC R308.4.1).
 - B. GLAZING WITHIN 60 INCHES - VERTICALLY AND HORIZONTALLY - OF SHOWERS, BATHTUBS, HOT TUBS, SWIMMING POOLS, AND SAUNAS (CRC R308.4.5).
11. PER CBC SECTION 708A.2, EXTERIOR WINDOWS, EXTERIOR GLAZED SHALL COMPLY WITH THE FOLLOWING:
 - A. MULTI-PANE GLAZING WITH A MINIMUM OF ONE TEMPERED PANE MEETING THE REQUIREMENTS OF SECTION 2406 SAFETY GLAZING, AND WHERE ANY GLAZING FRAMES MADE OF VINYL MATERIALS SHALL HAVE WELDED CORNERS, METAL REINFORCEMENT IN INTERLOCK AREA, AND BE CERTIFIED TO AAMA/WDMA/CSA 1011.5.2/A440.
12. PER CBC SECTION 708A.3, EXTERIOR DOORS SHALL BE CONSTRUCTED WITH A NON-COMBUSTIBLE CLADDING MATERIAL OR BE CONSTRUCTED WITH A SOLID CORE, STILES/RAILS NO LESS THAN 1-3/8" THICK, AND PANELS NO LESS THAN 1-1/4" THICK, EXCEPT FOR THE EXTERIOR GLAZING AREA OF THE PANEL THAT SHALL BE PERMITTED TO TAPER TO THE TONGUE NO LESS THAN 3/8" THICK.
13. PER CBC SECTION 708A.2, GLAZED DOORS TO BE CONSTRUCTED WITH MULTI-PANE GLAZING WITH A MINIMUM OF ONE TEMPERED PANE CONFORMING TO SECTION 2406.
14. SKYLIGHTS SHALL BE TESTED BY AN APPROVED INDEPENDENT LABORATORY, AND BE LABELED FOR THE EXTERIOR MANUFACTURER'S PERFORMANCE GRADE RATING AND APPROVED INSPECTION AGENCY TO INDICATE COMPLIANCE WITH THE REQUIREMENTS OF AAMA/WDMA/CSA 1011.5.2/A440.

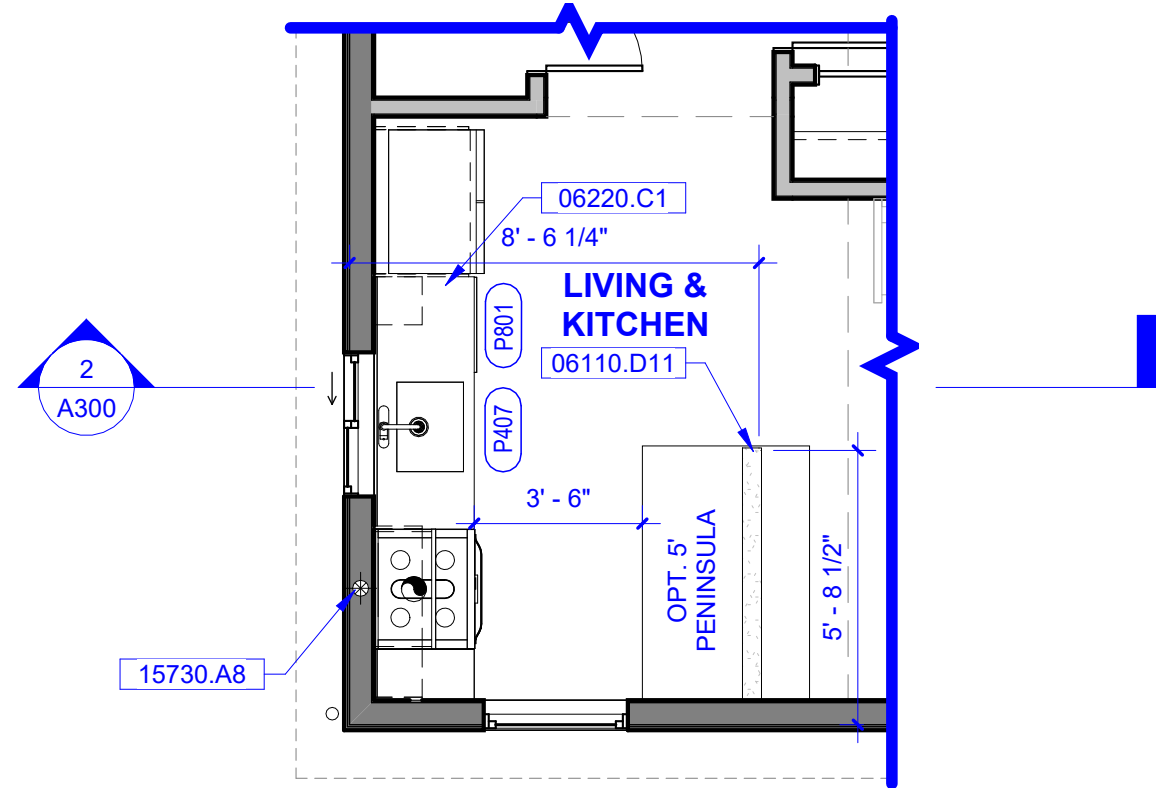

SCALE: 1/4" = 1'-0"

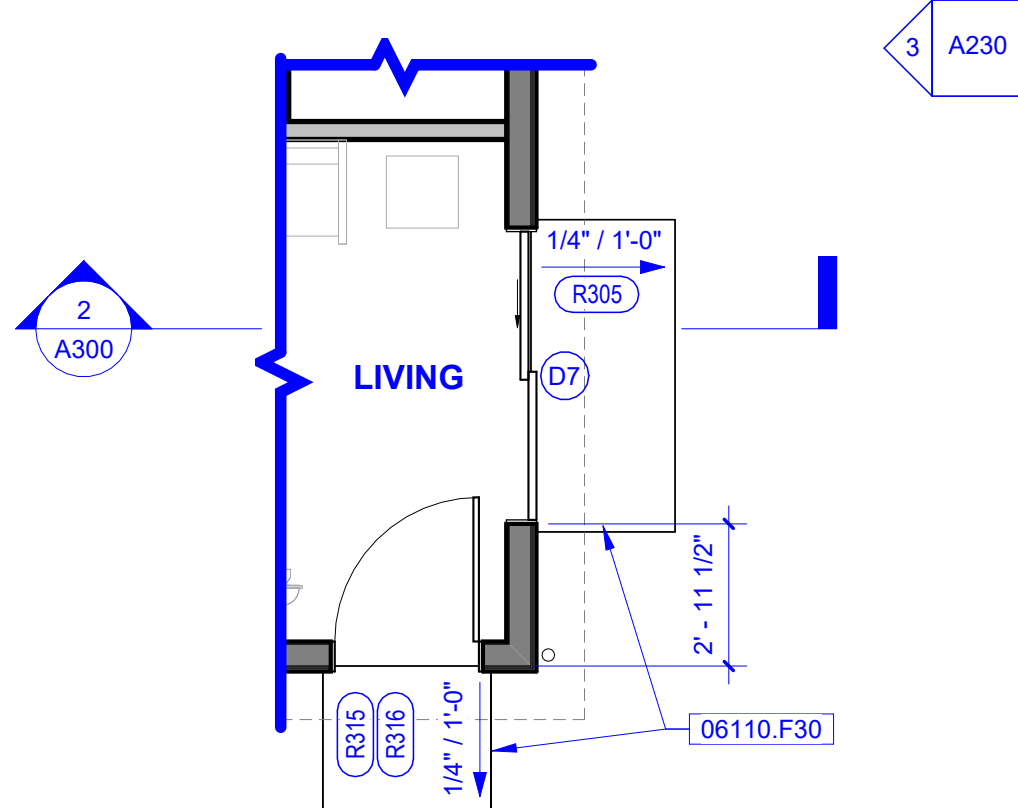

SCALE: 1/4" = 1'-0"

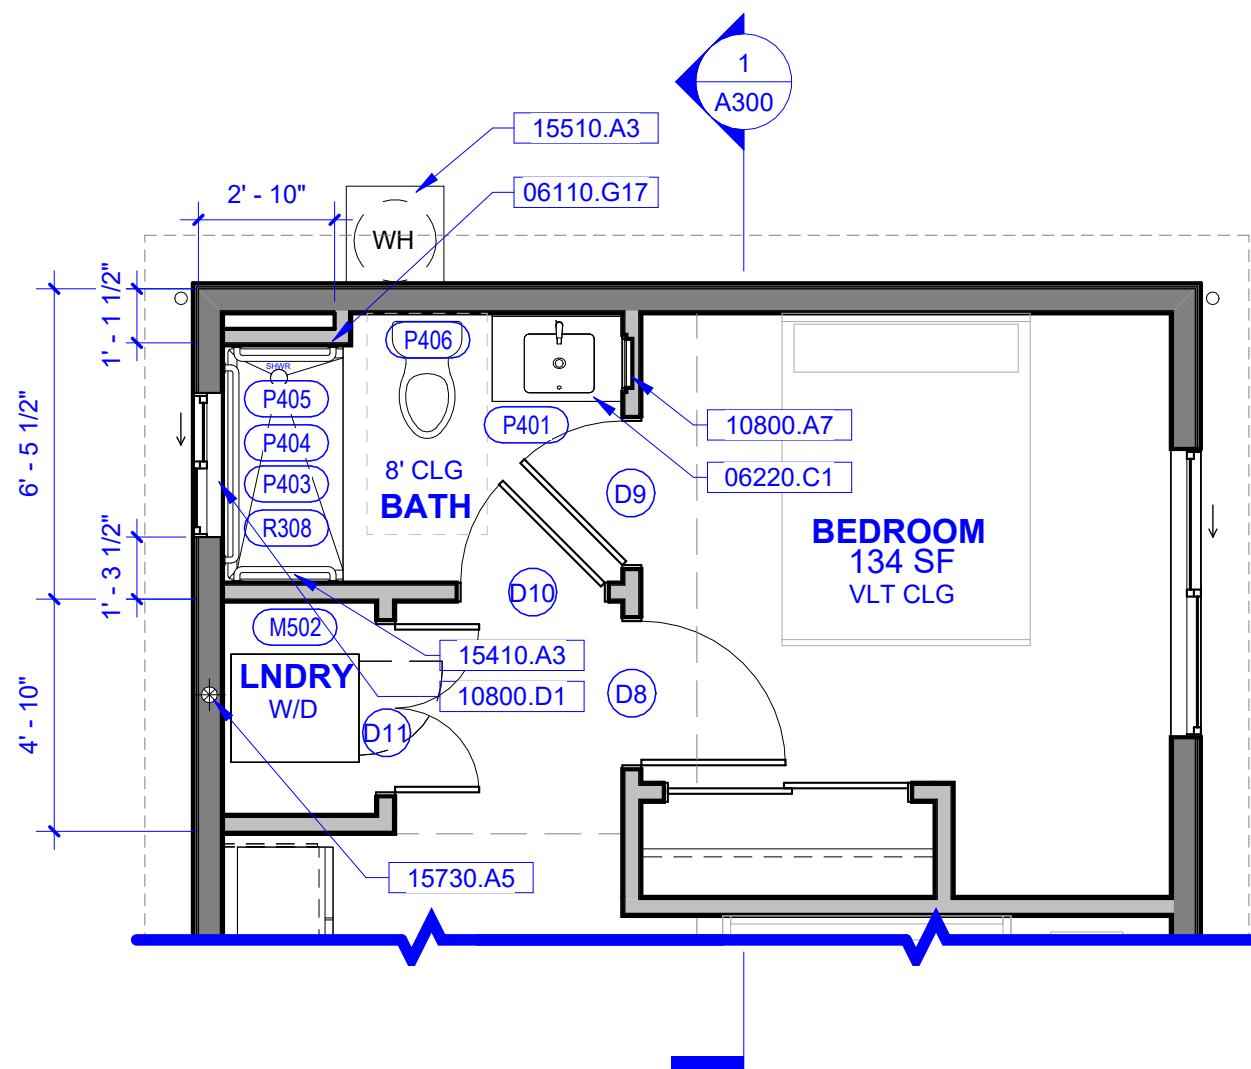

SCALE: 1/4" = 1'-0"

KEYNOTE	DESCRIPTION
06110.D11	34" TALL 2X4 PONY WALL
06110.F30	WOOD STEEP EXTERIOR DOOR LANDING
06110.G17	X28 MIN. SOLID INTERIOR CORNER LOCATED BETWEEN 32" AND 39 1/4" AFF. SEE SHEETS G101 AND A501 FOR MORE INFORMATION ABOUT AGING-IN-PLACE DESIGN
06220.C1	MILLWORK SHOWN FOR REFERENCE ONLY. SEE SHOP DRAWINGS
10800.A7	PROVIDE 1/4" X 25 1/4" R/O. FRAMING FOR MEDICINE CABINET. NO ELECTRICAL WIRING WITHIN FRAMING FOR MEDICINE CABINET PERMITTED
10800.D1	PROVIDE FRAMING FOR 16"x12" NICHE. BOTTOM OF NICHE TO BE 60" ABOVE SLAB AND CENTERED ALONG WALL
15410.A3	SHOWER HEAD AND CONTROLS
15510.A3	APPLICANT/OWNER TO PROVIDE CUT SHEET FOR WATER HEATER TO MEET MINIMUM REQUIREMENTS OF TITLE 24 CALCULATIONS
15730.A5	4" DRIVER VENT. SEE SHEET GAS CODE EXCERPTS CHAPTER 5: EXHAUST SYSTEMS FOR MORE INFORMATION
15730.A8	HOOD EXHAUST FAN ABOVE ELECTRIC RANGE 160 CFM OR 65% CE MIN. (GAS RANGE 280 CFM OR 85% CE MIN.); 2022 BEES TABLE 150.0-G

	EXTERIOR 2X6 WOOD STUDS @ 16" O.C.
	INTERIOR 2X6 WOOD STUDS @ 16" O.C.
	INTERIOR 2X4 WOOD STUDS @ 16" O.C.
----	OVERHEAD LINES
----	VAULTED CEILING
8' CLG	8' FLAT CEILING
VLT CLG	VAULTED CEILING

	WALL AREA (SF)	DOOR OPENING AREA (SF)	WINDOW OPENING AREA (SF)	TOTAL OPENING AREA (SF)	% OPENING AREA
NORTH	167.73	-	-	-	0%
SOUTH	167.73	21.38	12.00	33.38	19.90%
EAST	194.34	*40.00	24.00	64.00	32.93%
WEST	194.34	-	13.50	13.50	6.95%

***OPENING AREA PER 6' - 0" X 6' -8" SLIDING GLASS DOOR OPTION**



ADU: 498 SQUARE
CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910


DESIGNER:
LUIS CALDERON
SnapADU

SIGNATURE

[illegible]

A102

22040

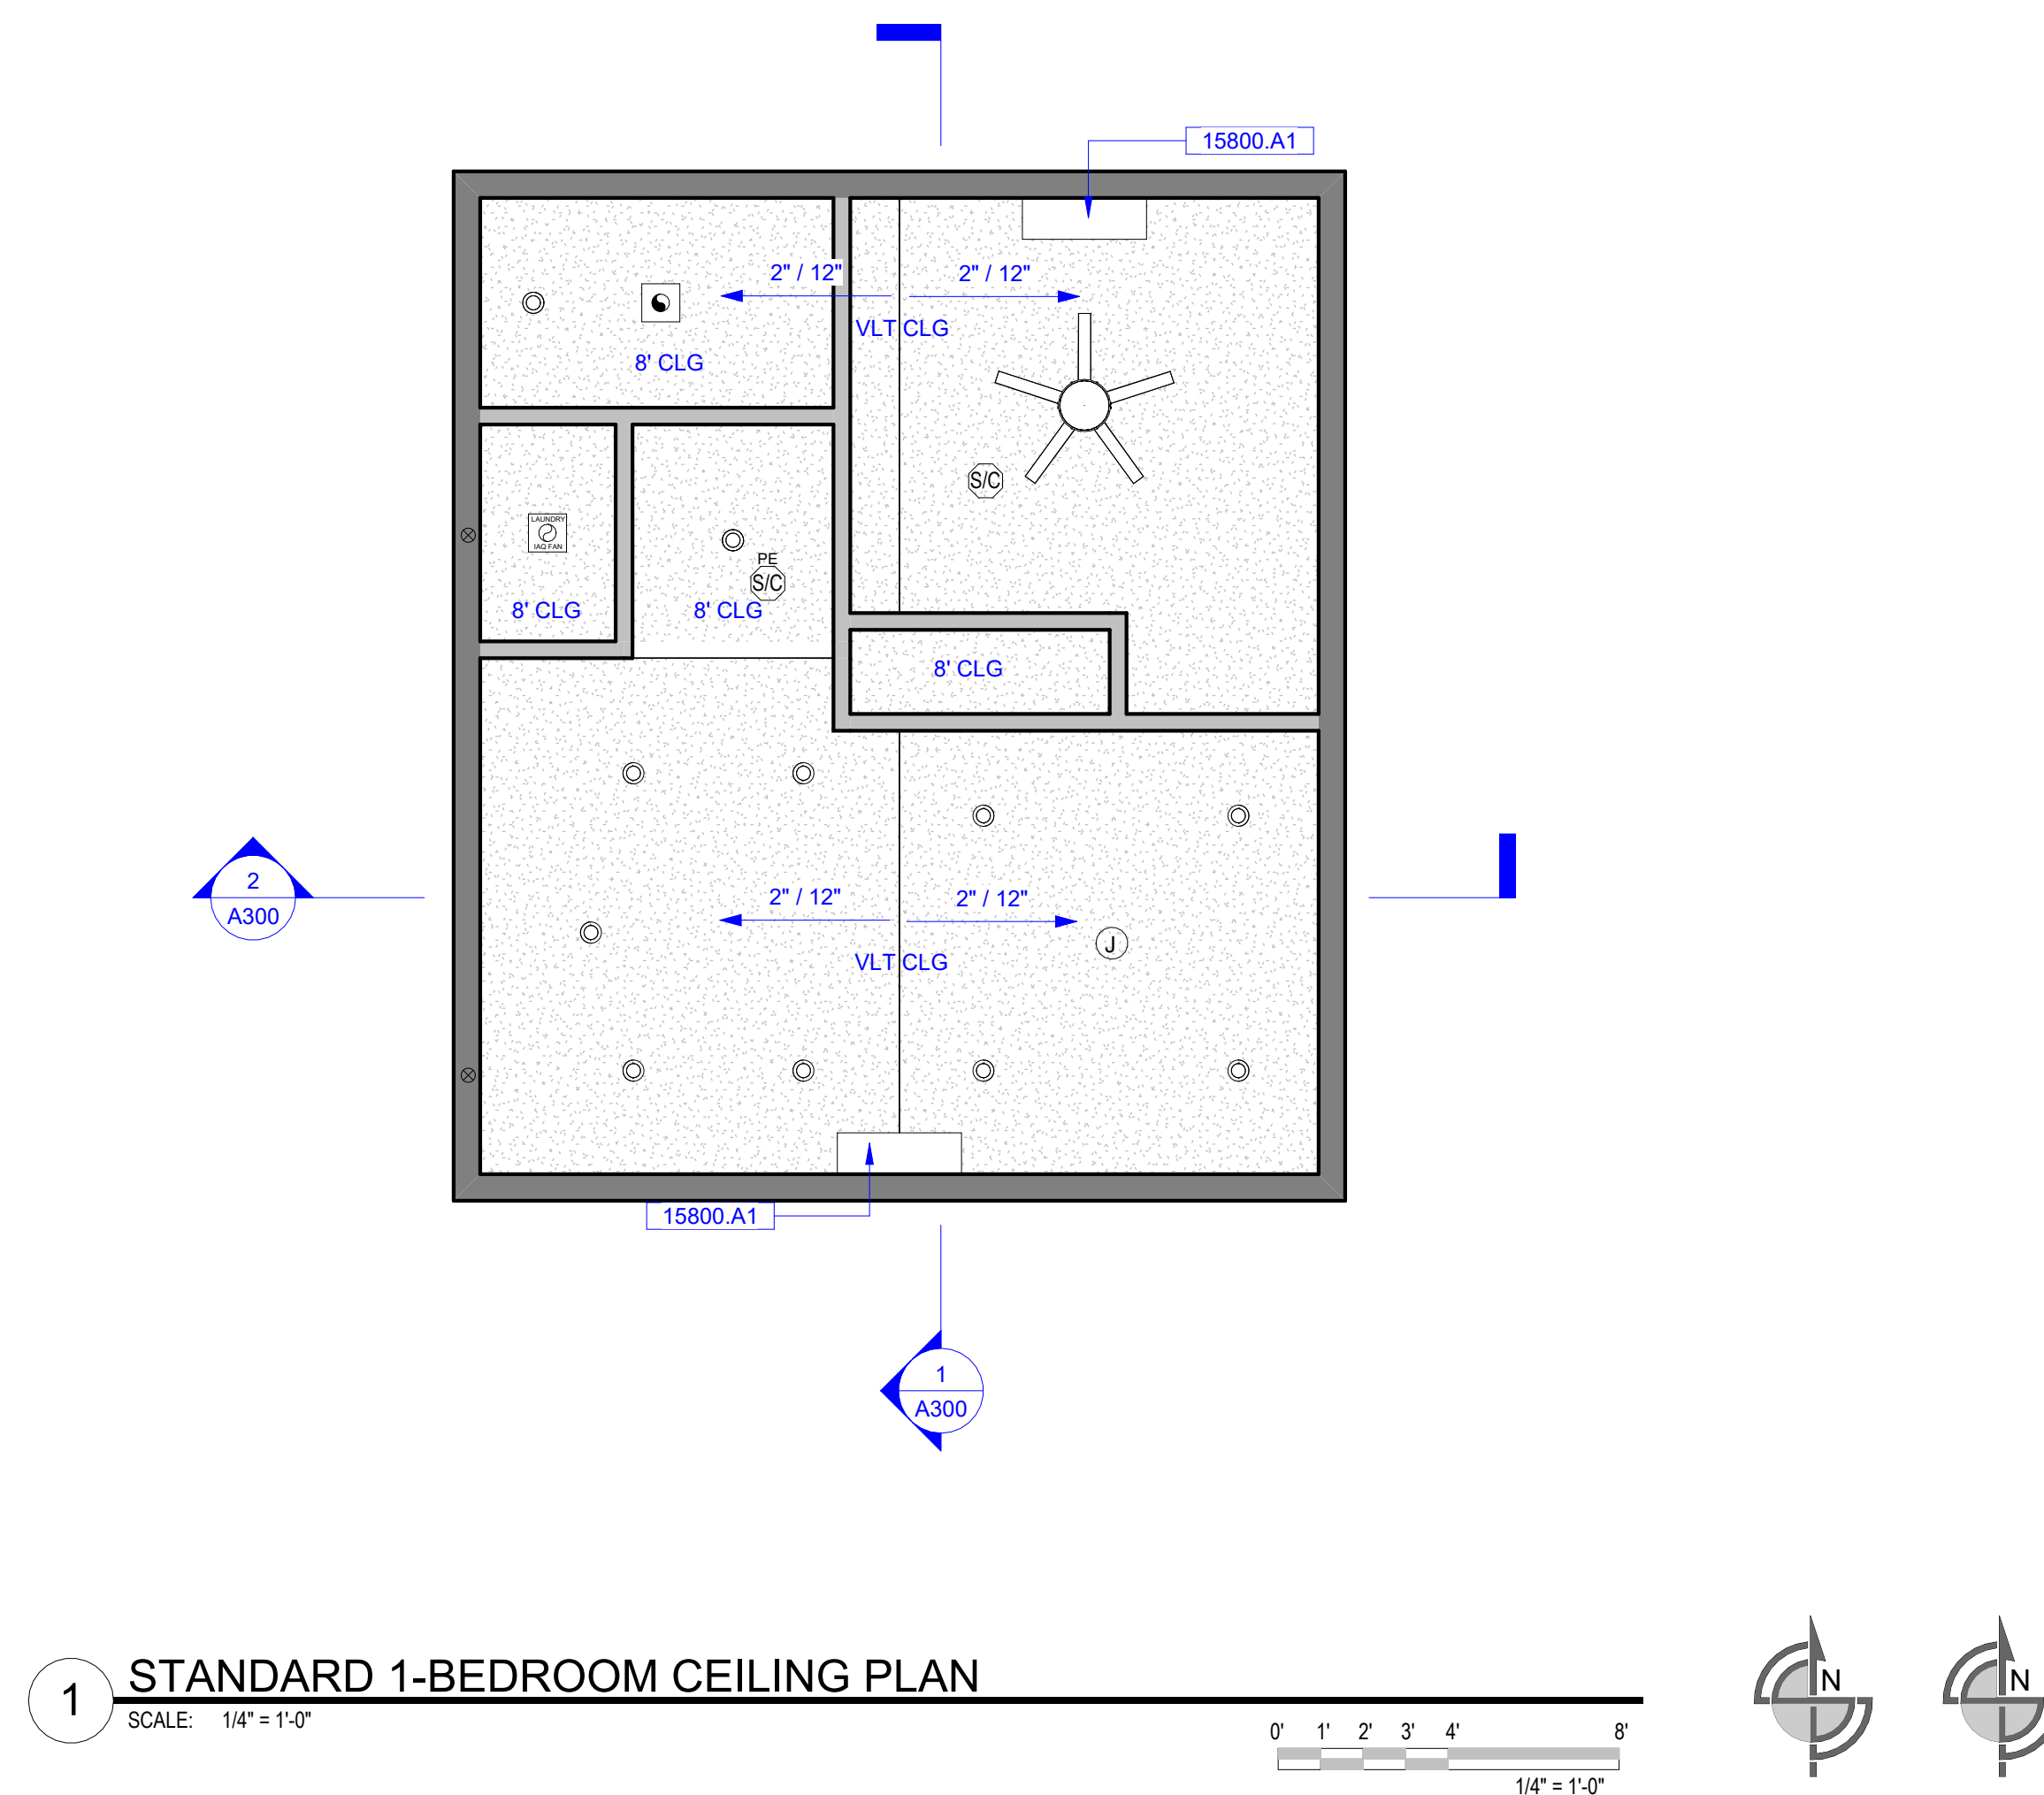


KEYNOTES:

KEYNOTE	DESCRIPTION
15800.A1	MINI SPLIT SYSTEM; APPLICANT/OWNER TO PROVIDE CUT SHEET TO MEET MINIMUM REQUIREMENTS OF TITLE 24 CALCULATIONS

REFLECTED CEILING PLAN LEGEND

	DRYWALL CEILING
	JUNCTION BOX
	SMOKE / CARBON MONOXIDE DETECTOR HARDWIRED W/ BATTERY BACKUP
	PHOTOELECTRIC SMOKE / CARBON MONOXIDE DETECTOR HARDWIRED W/ BATTERY BACKUP
	RECESSED LIGHT
	MICROWAVE-HOOD EXHAUST FAN COMBO 160 CFM MIN (IF GAS RANGE 280 CFM MIN. TO BE PROVIDED)
	EXHAUST VENT FAN - INTERMITTENT 50 CFM MIN / CONTINUOUS 20 CFM MIN
	EXHAUST VENT FAN SHALL BE USED TO MEET THE REQUIREMENTS FOR INDOOR AIR QUALITY (IAQ) PER T24 REPORT
	LAUNDRY EXHAUST VENT FAN SHALL BE USED TO MEET THE REQUIREMENTS FOR INDOOR AIR QUALITY (IAQ) PER T24 REPORT



← SLOPE DIRECTION OF CEILING SLOPE

8' CLG 8' FLAT CEILING

VLT CLG VAULTED CEILING



SNAPADU
DESIGN HOUSE

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 498 SQUARE
CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:

LUIS CALDERON
SnapADU



SIGNATURE

[illegible]

REFLECTED
CEILING PLAN - 1
BEDROOM

A110

22040

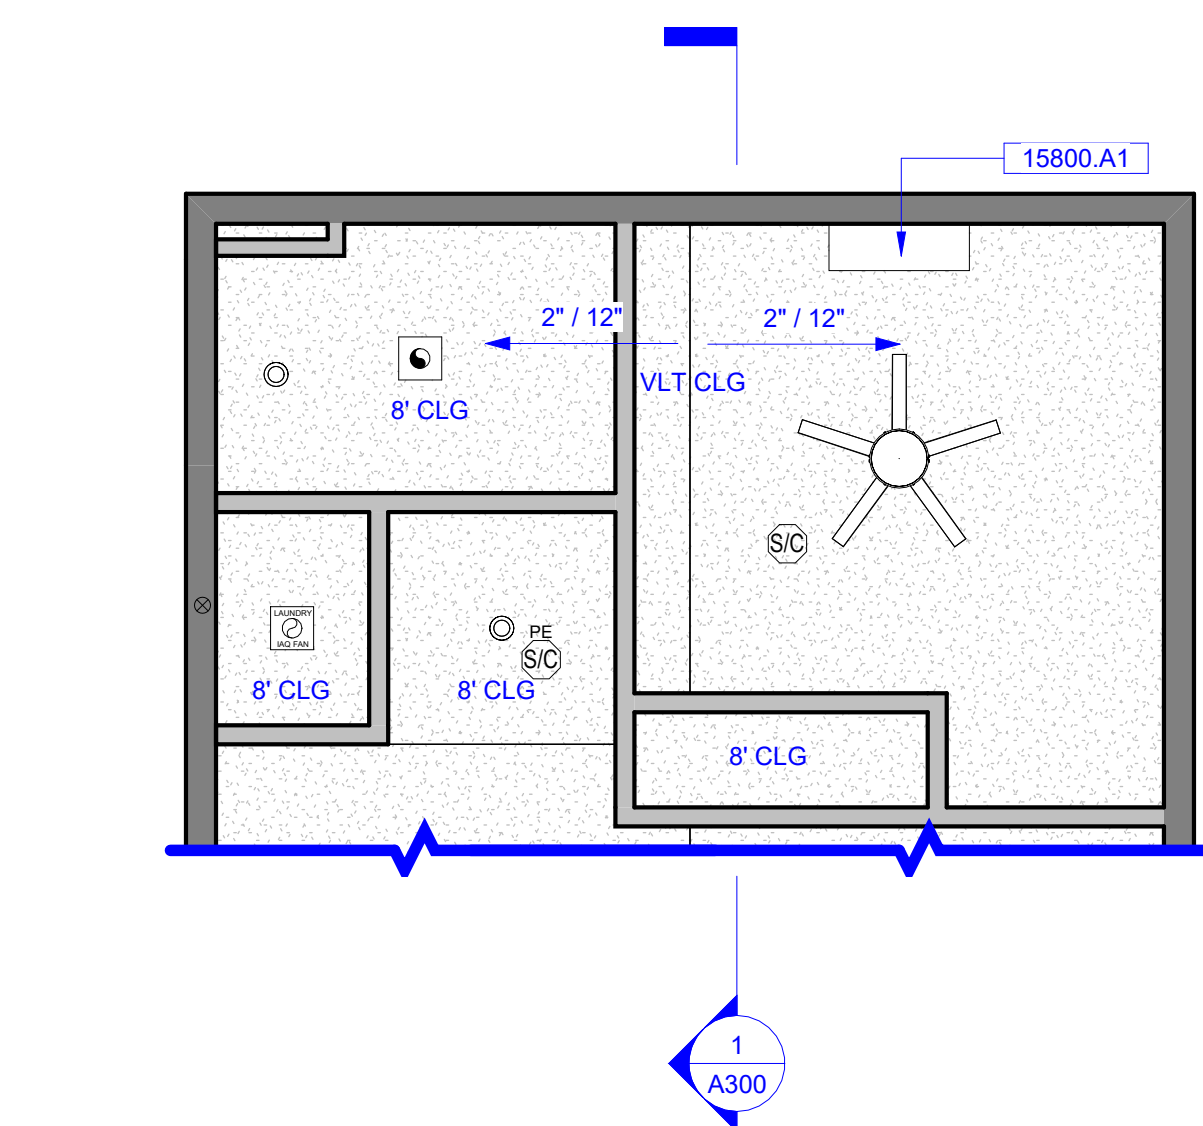


**1 ELARGED BEDROOM & BATH DOOR OPTION AT
STANDARD 1-BEDROOM REFLECTED CEILING PLAN**
SCALE: 1/4" = 1'-0"

KEYNOTES:

KEYNOTE	DESCRIPTION
15800.A1	MINI SPLIT SYSTEM; APPLICANT/OWNER TO PROVIDE CUT SHEET TO MEET MINIMUM REQUIREMENTS OF TITLE 24 CALCULATIONS

REFLECTED CEILING PLAN LEGEND

	DRYWALL CEILING
	JUNCTION BOX
	SMOKE / CARBON MONOXIDE DETECTOR HARDWIRED W/ BATTERY BACKUP
	PHOTOELECTRIC SMOKE / CARBON MONOXIDE DETECTOR HARDWIRED W/ BATTERY BACKUP
	RECESSED LIGHT
	MICROWAVE-HOOD EXHAUST FAN COMBO 160 CFM MIN (IF GAS RANGE 280 CFM MIN. TO BE PROVIDED)
	EXHAUST VENT FAN - INTERMITTENT 50 CFM MIN / CONTINUOUS 20 CFM MIN
	EXHAUST VENT FAN SHALL BE USED TO MEET THE REQUIREMENTS FOR INDOOR AIR QUALITY (IAQ) PER T24 REPORT
	LAUNDRY EXHAUST VENT FAN SHALL BE USED TO MEET THE REQUIREMENTS FOR INDOOR AIR QUALITY (IAQ) PER T24 REPORT
	CEILING FAN WITH LIGHT
	SLOPE DIRECTION OF CEILING SLOPE
	8' FLAT CEILING
	VAULTED CEILING

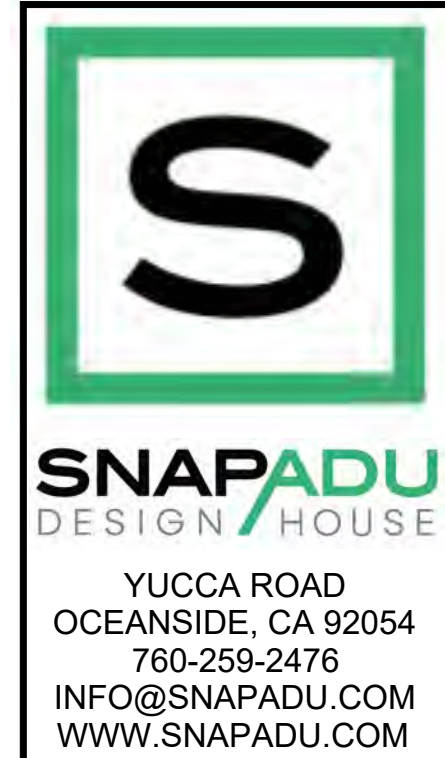

ADU: 498 SQUARE
CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:
LUIS CALDERON
SnapADU


SIGNATURE

[illegible]

REFLECTED
CEILING PLAN -
OPTIONS

A111

22040

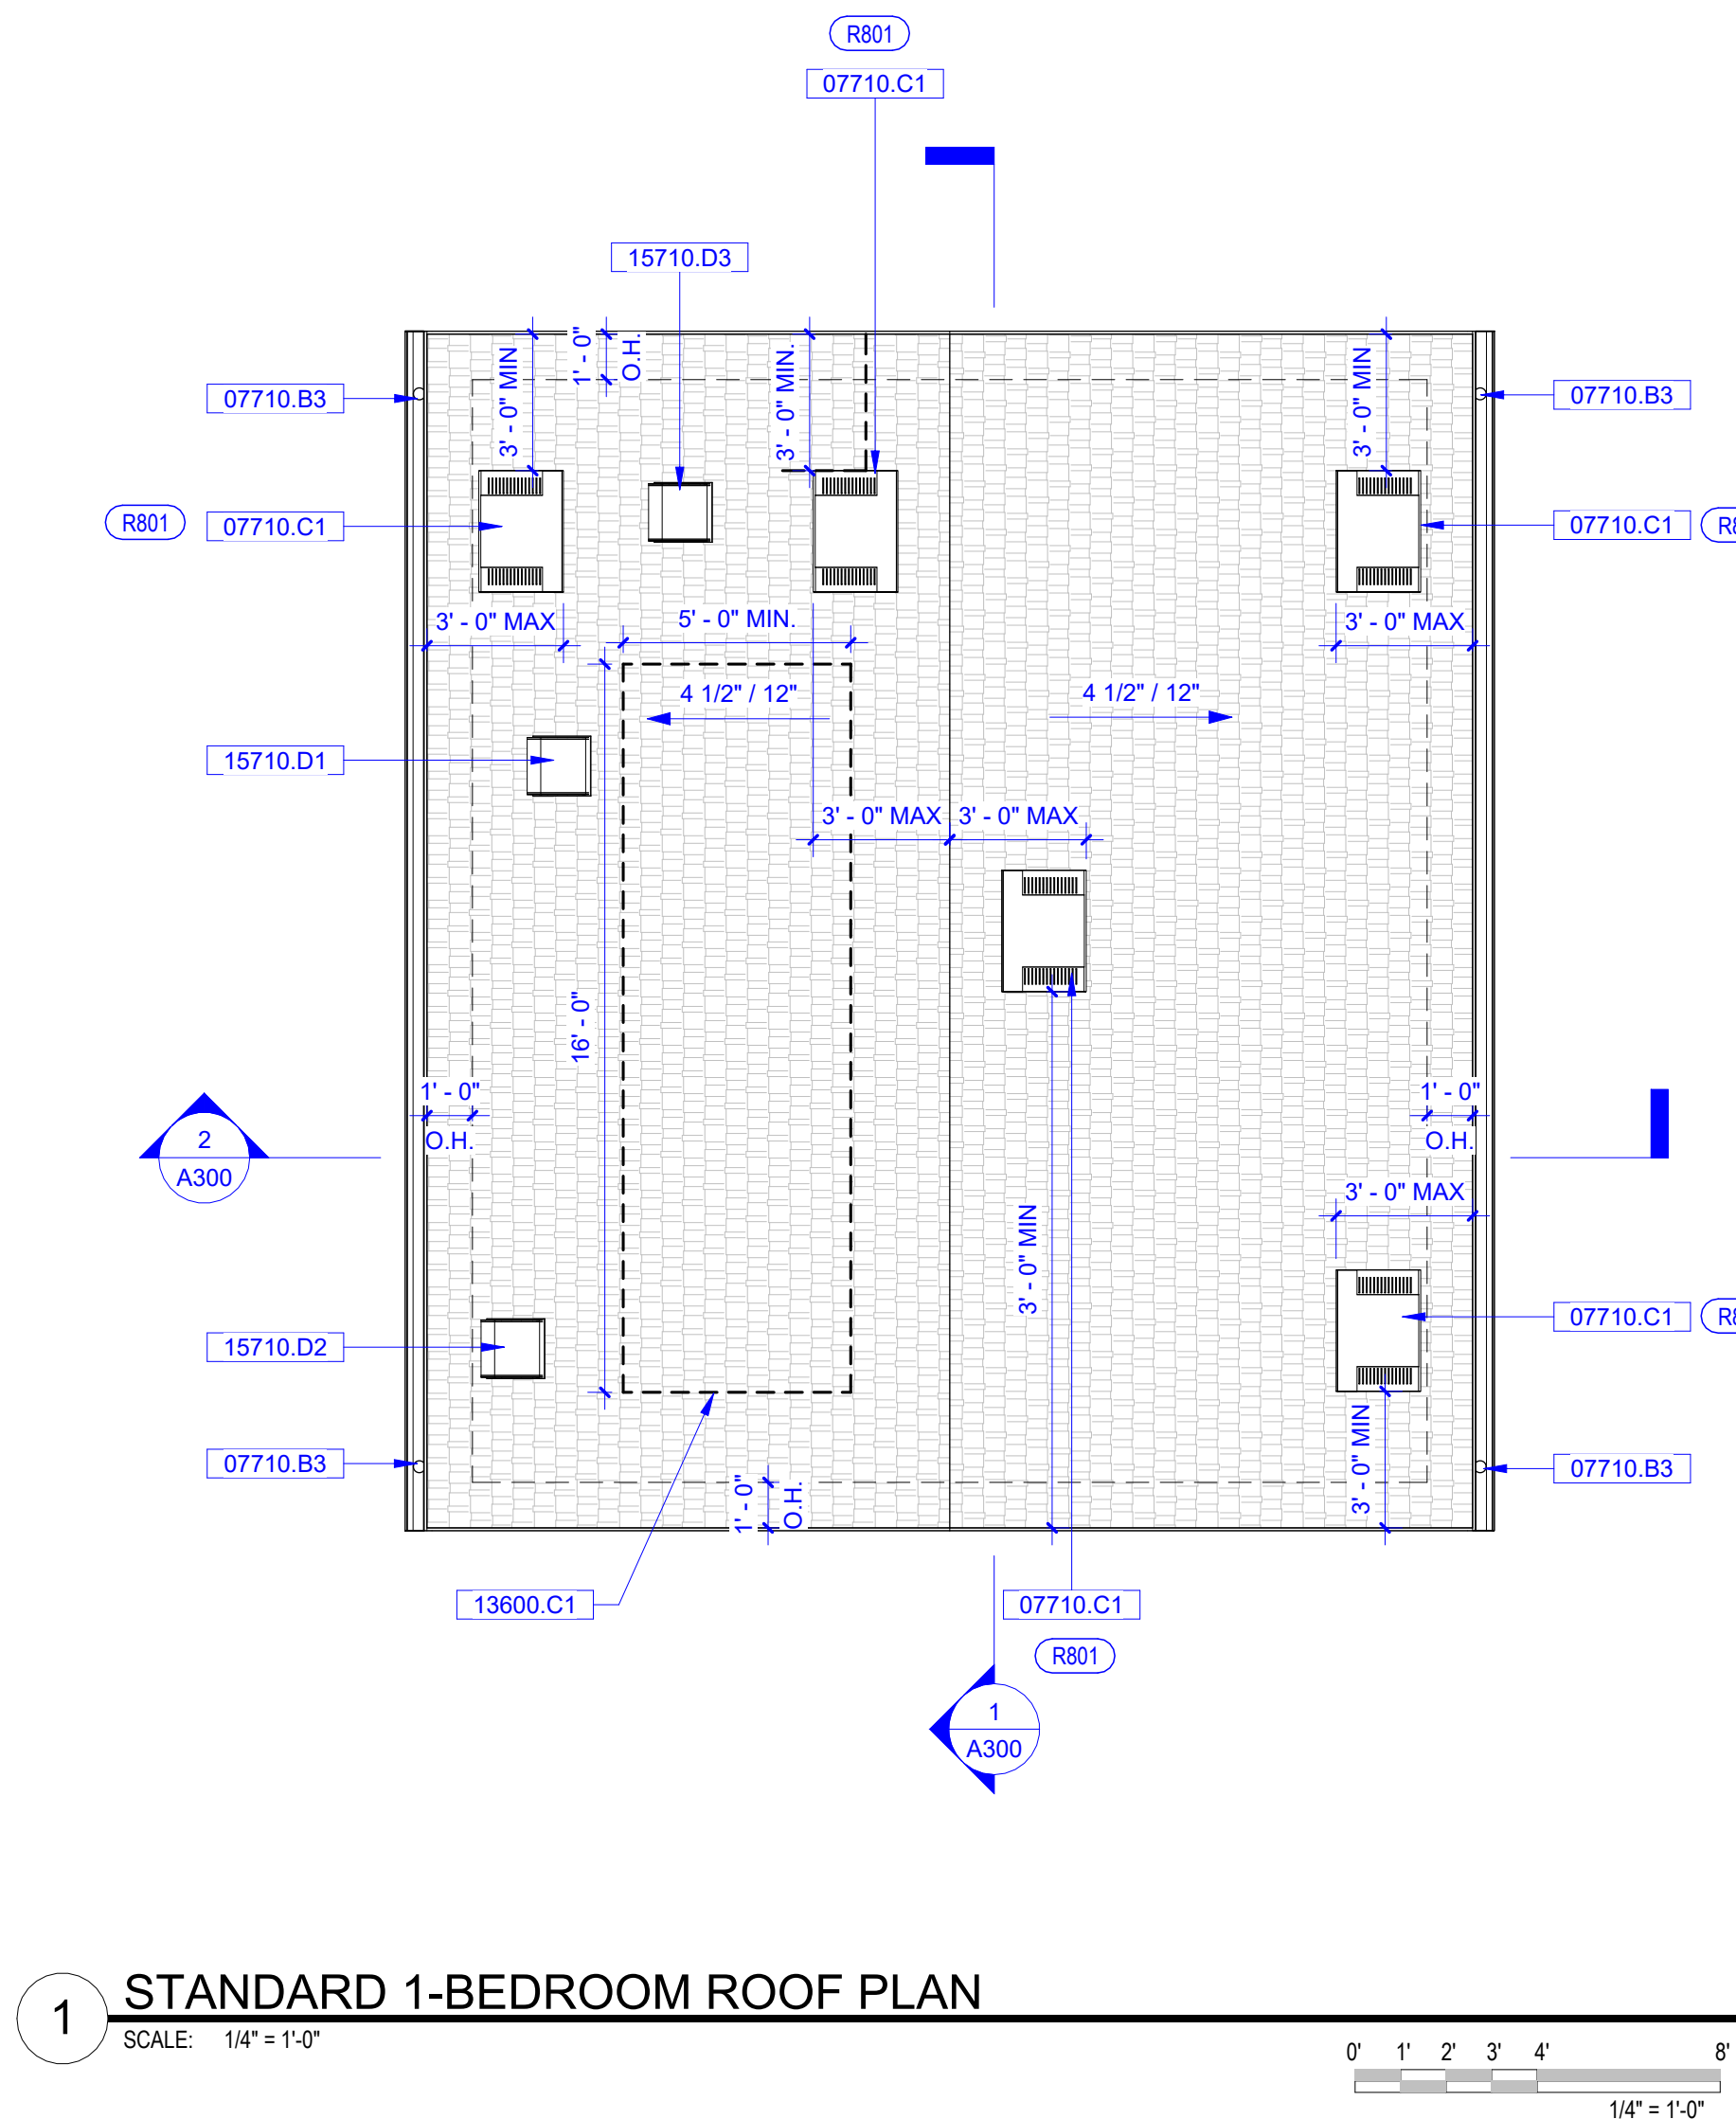

KEYNOTES:

KEYNOTE	DESCRIPTION
07710.B3	DOWNSPOUT
07710.C1	O'HAGIN STANDARD LOW PROFILE ATTIC VENTS, 0.68 SF NFVA
13600.C1	SOLAR ZONE FOR PV SYSTEM (SEE G102 CHECKLIST FOR SIZING PER T24 CALCULATIONS). SOLAR ZONE LOCATION MIGHT VARY PER SITE CONDITIONS
15710.D1	DRYER EXHAUST ROOF EXHAUST VENT
15710.D2	RANGE HOOD ROOF EXHAUST VENT
15710.D3	BATH EXHAUST FAN ROOF VENT

ROOF PLAN LEGEND

	ROOFING PER CHECKLIST SELECTION ON SHEET G102
	WALL LINE BELOW
	SOLAR ZONE OUTLINE (CEC 110.10(B)1A)
	SLOPE
	DIRECTION OF DRAINAGE
	ROOF VENT
	EXHAUST ROOF JACK VENT
	SOLAR PV PANEL

ROOF NOTES:

- ROOF MATERIAL PER CHECKLIST SELECTION ON SHEET G102.
 - ROOF TYPE 1 - 242 HIGHLANDER NEX AR ASPHALT SHINGLE, MANUFACTURED BY MALARKEY ROOFING PRODUCTS; ICC APPROVAL: ESR-3150; UL RATING 2218; OR EQUAL APPROVED.
 - SEE DETAILS: 1/A500, 4/A500, 1/A510, 1/A520, 4/A520, 1/A530, 4/A530.
 - ROOF TYPE 2 - LOW PROFILE 'BEL AIR' CONCRETE ROOF TILE BY EAGLE ROOFING; IAPMO ER-1900; OR EQUAL APPROVED.
 - SEE DETAILS 2/A500, 5/A500, 2/A510, 5/A510, 2/A520, 2/A530, 5/A530.
 - ROOF TYPE 3 - HIGH PROFILE 'CAPISTRANO' CONCRETE S-TILE ROOF BY EAGLE ROOFING; IAPMO ER-1900; OR EQUAL APPROVED.
 - SEE DETAILS 3/A500, 6/A500, 3/A510, 6/A510, 3/A520, 6/A520, 3/A530, 6/A530.
 - OTHER ROOF TYPE MODEL:
 - MAKE:
 - MODEL:
 - ICC ESR NUMBER:
- ROOF UNDERLAYMENT SHALL BE DOUBLE NEX POLYMER MODIFIED FIBERGLASS UNDERLAYMENT ON ROOF SLOPES EQUAL OR LESS TO 4:12 PER P905.1.1(2); ICC APPROVAL: ESR-1561; OR EQUAL APPROVED
- ROOF GUTTERS SHALL BE PROVIDED WITH THE MEANS TO PREVENT THE ACCUMULATION OF LEAVES AND DEBRIS IN THE GUTTER. (CBC 92.1.705A.4)
- ALL VENTS (ROOF, FOUNDATION, COMBUSTION-AIR, ETC.) SHALL RESIST THE INTRUSION OF FLAMES AND EMBERS. (CBC 92.1.706A.1)
- VENTILATION OPENING FOR ENCLOSED ATTICS, EAVE SOFFIT SPACES, ENCLOSED RAFTER SPACES FORMED WHERE CEILINGS ARE APPLIED DIRECTLY TO THE UNDERSIDE OF ROOF RAFTERS, UNDERFLOOR VENTILATION OPENINGS, AND VENT OPENINGS IN EXTERIOR WALLS AND EXTERIOR DOORS SHALL BE LISTED TO ASTM E 2886 AND COMPLY WITH ALL OF THE FOLLOWING: (CBC 92.1.706A.2, CBC 92.1.707A5)
 - THERE SHALL BE NO FLAMING IGNITION OF THE COTTON MATERIAL DURING THE EMBER ENTRUSION TEST.
 - THERE SHALL BE NO FLAMING IGNITION DURING THE INTEGRITY TEST PORTION OF THE FLAME INTRUSION TEST.
 - THE MAXIMUM TEMPERATURE OF THE UNEXPOSED SIDE OF THE VENT SHALL NOT EXCEED 662 DEGREES FAHRENHEIT (350 DEGREES CELSIUS)
- EXHAUST DUCT TERMINATION IS AS FOLLOWS PER CMC 502.2:
 - 3 FEET FROM A PROPERTY LINE,
 - 10 FEET FROM A FORCED AIR INLET, AND
 - 3 FEET FROM OPENINGS INTO THE BUILDING.
- EXHAUST DUCT SHALL NOT DISCHARGE ONTO A PUBLIC WAY. CMC 502.2
- UNLESS OTHERWISE PERMITTED OR REQUIRED BY THE DRYER MANUFACTURER'S INSTALLATION INSTRUCTIONS AND APPROVED BY THE CITY, DOMESTIC DRYER MOISTURE EXHAUST DUCTS SHALL NOT EXCEED A TOTAL COMBINED HORIZONTAL AND VERTICAL LENGTH OF FOURTEEN FEET, INCLUDING TWO 90-DEGREE ELBOWS. TWO FEET SHALL BE DEDUCTED FOR EACH 90 DEGREE ELBOW IN EXCESS OF TWO. CMC 504.2.2

ROOF VENT CALCULATION

CLASS-1 VAPOR BARREIR PROVIDED ON WINTER-WARM-SIDE: NO
TOTAL ROOF VENT AREA REQUIRED: ROOF AREA / 150 SF

CALCULATIONS:

DESCRIPTION	AREA	REQ. ROOF VENT
ATTIC AREA	498 SF	3.32 SF

TOTAL NET FREE VENTILATION AREA (NFVA) PROVIDE:

O'HAGIN CONC.TILE LOW PROF.VENT NFVA = 98.75 SQ.IN.=0.68 SF./V.
3.32 SF. / 0.68 SF./VENT = 4.88 5 VENTS WILL BE PROVIDED AS FOLLOWS:

2 EXHAUST VENTS WITHIN 3 FT. BELOW THE RIDGE HIGHEST POINT
& 3 INTAKE VENTS AT THE BOTTOM THIRD OF THE ATTIC SPACE

TOTAL VENT AREA = 5 VENTS X 0.68 SF./VENT = 3.40 SF.
TOTAL PROVIDE = 3.40 SF > 3.32 SF REQ. ROOF VENT.

SNAPADU
DESIGN HOUSE

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 498 SQUARE
CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:

LUIS CALDERON
SnapADU


SIGNATURE

RELEASE	DATE	BY	APP.	RELEASED FOR...
A	03/22/2024	LAG		


ROOF PLAN - 1
BEDROOM

A120


22040

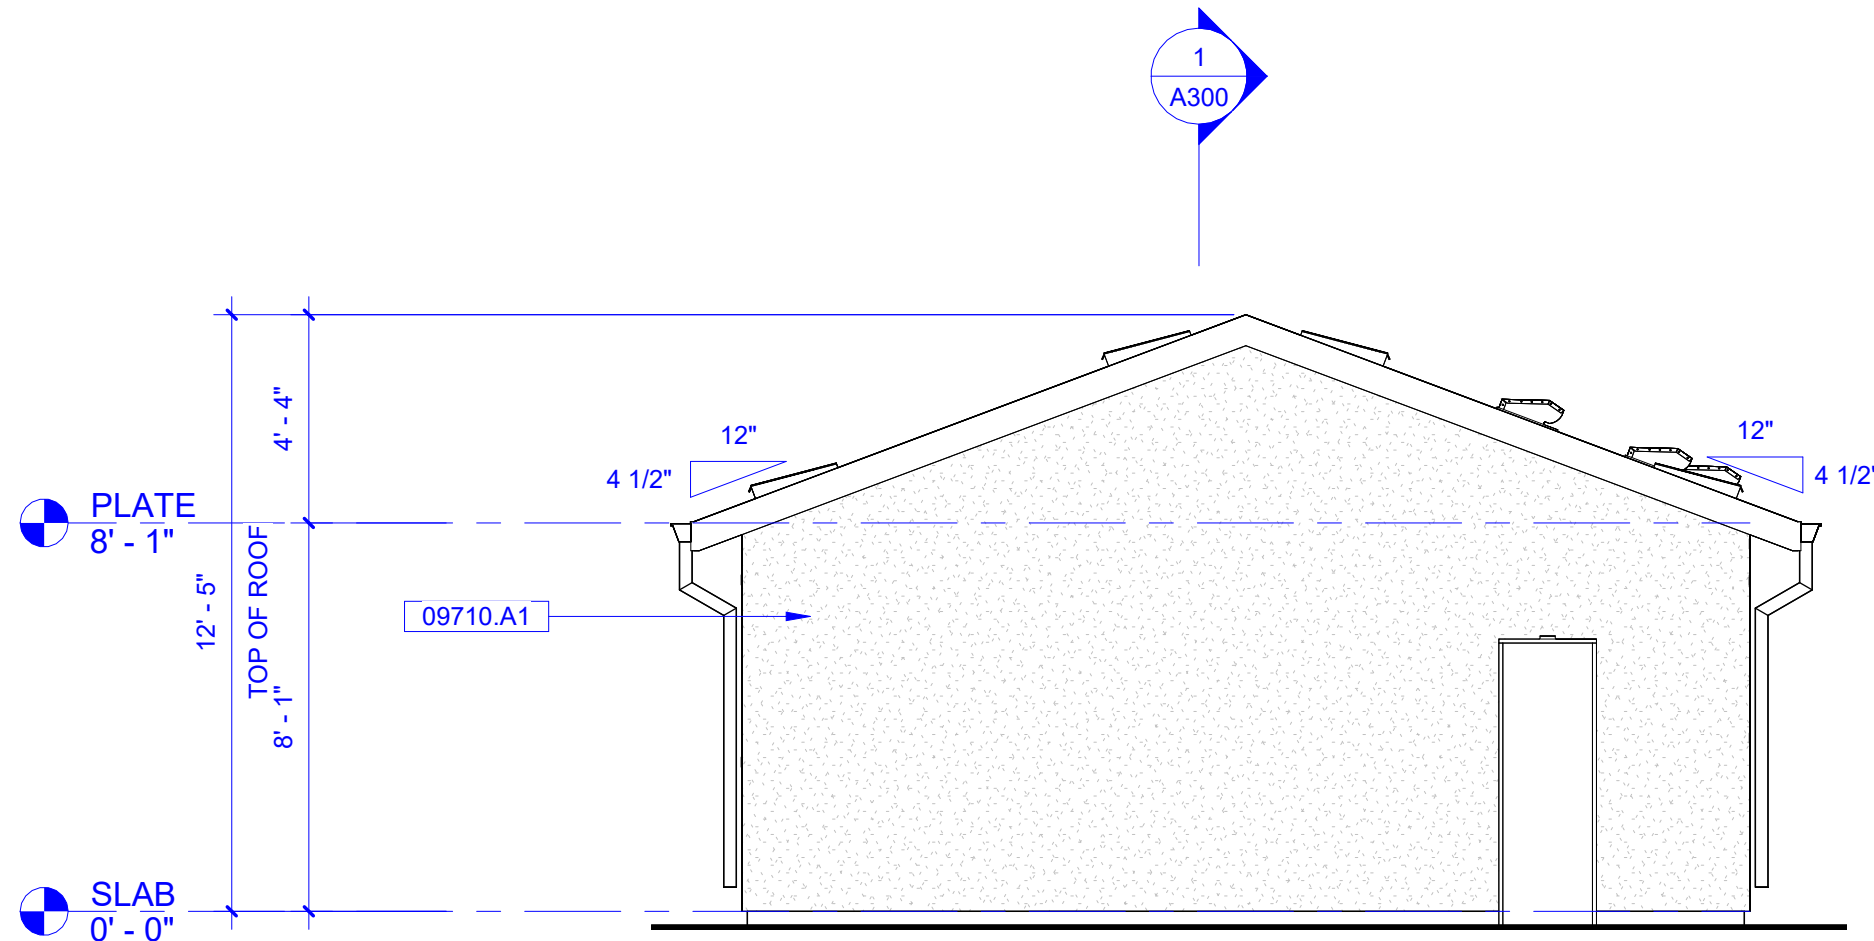


1 NORTH ELEVATION - STUCCO
SCALE: 1/4" = 1'-0"

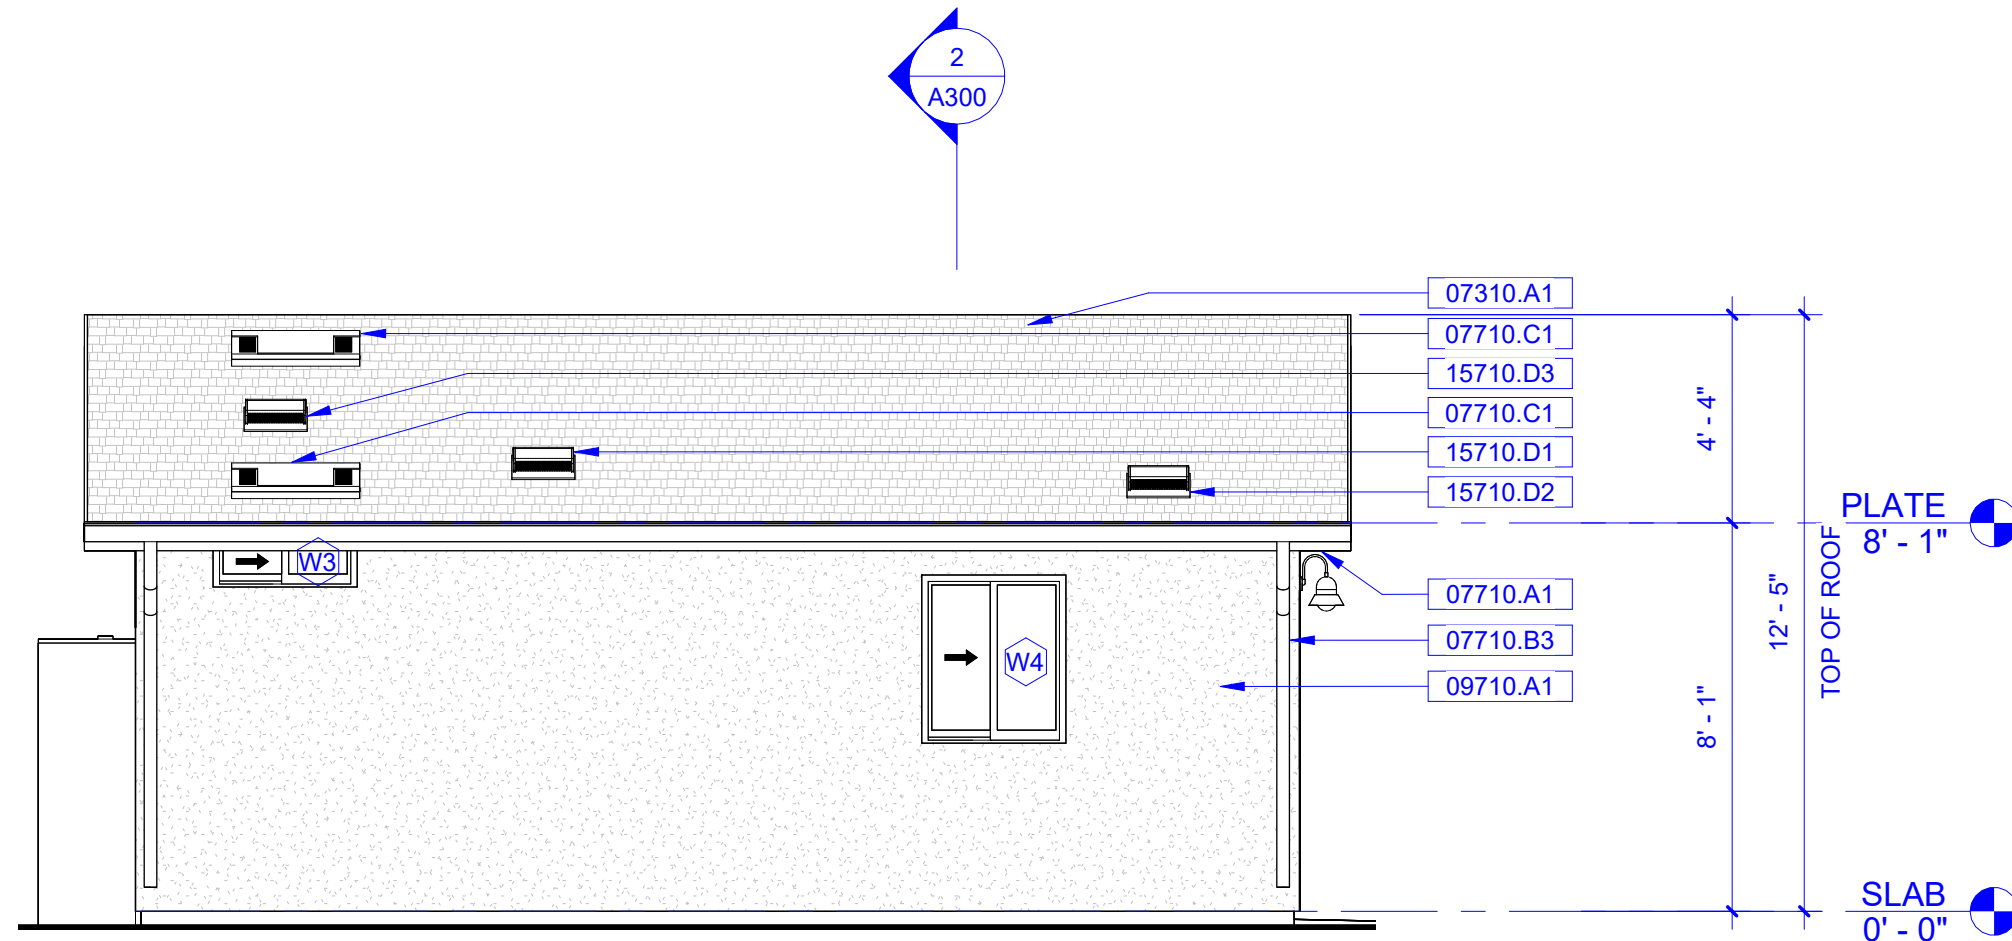

2 WEST ELEVATION - STUCCO
SCALE: 1/4" = 1'-0"

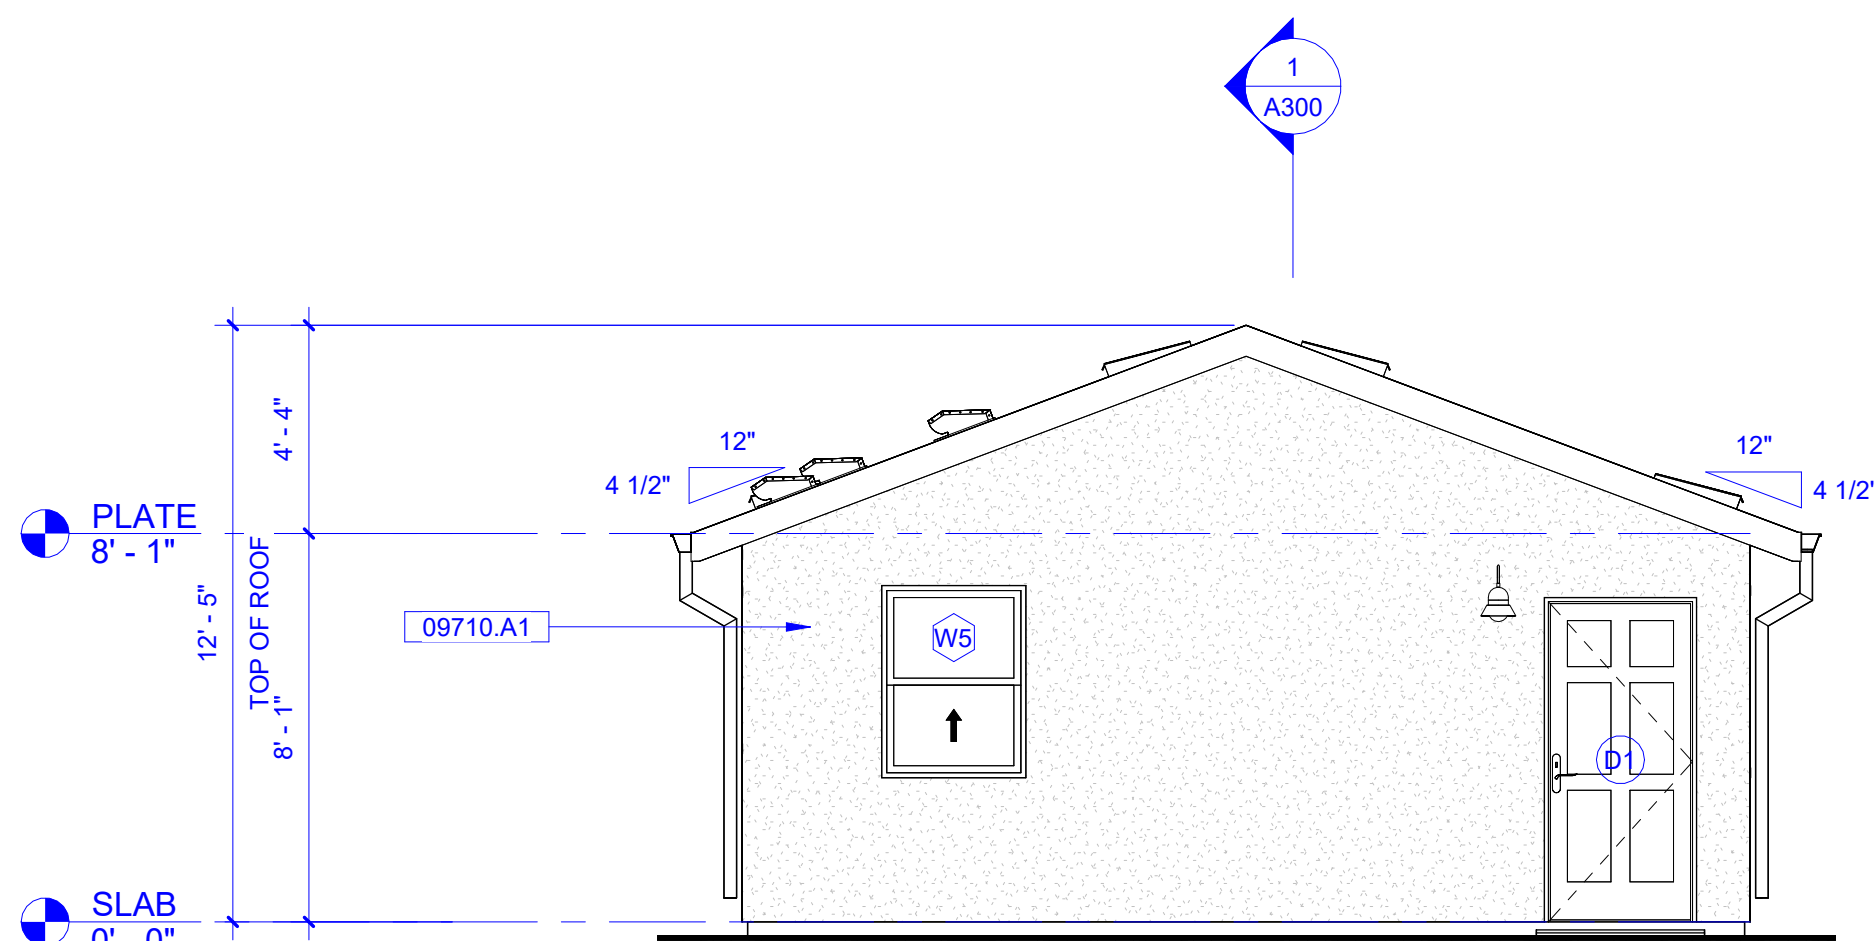

3 SOUTH ELEVATION - STUCCO
SCALE: 1/4" = 1'-0"

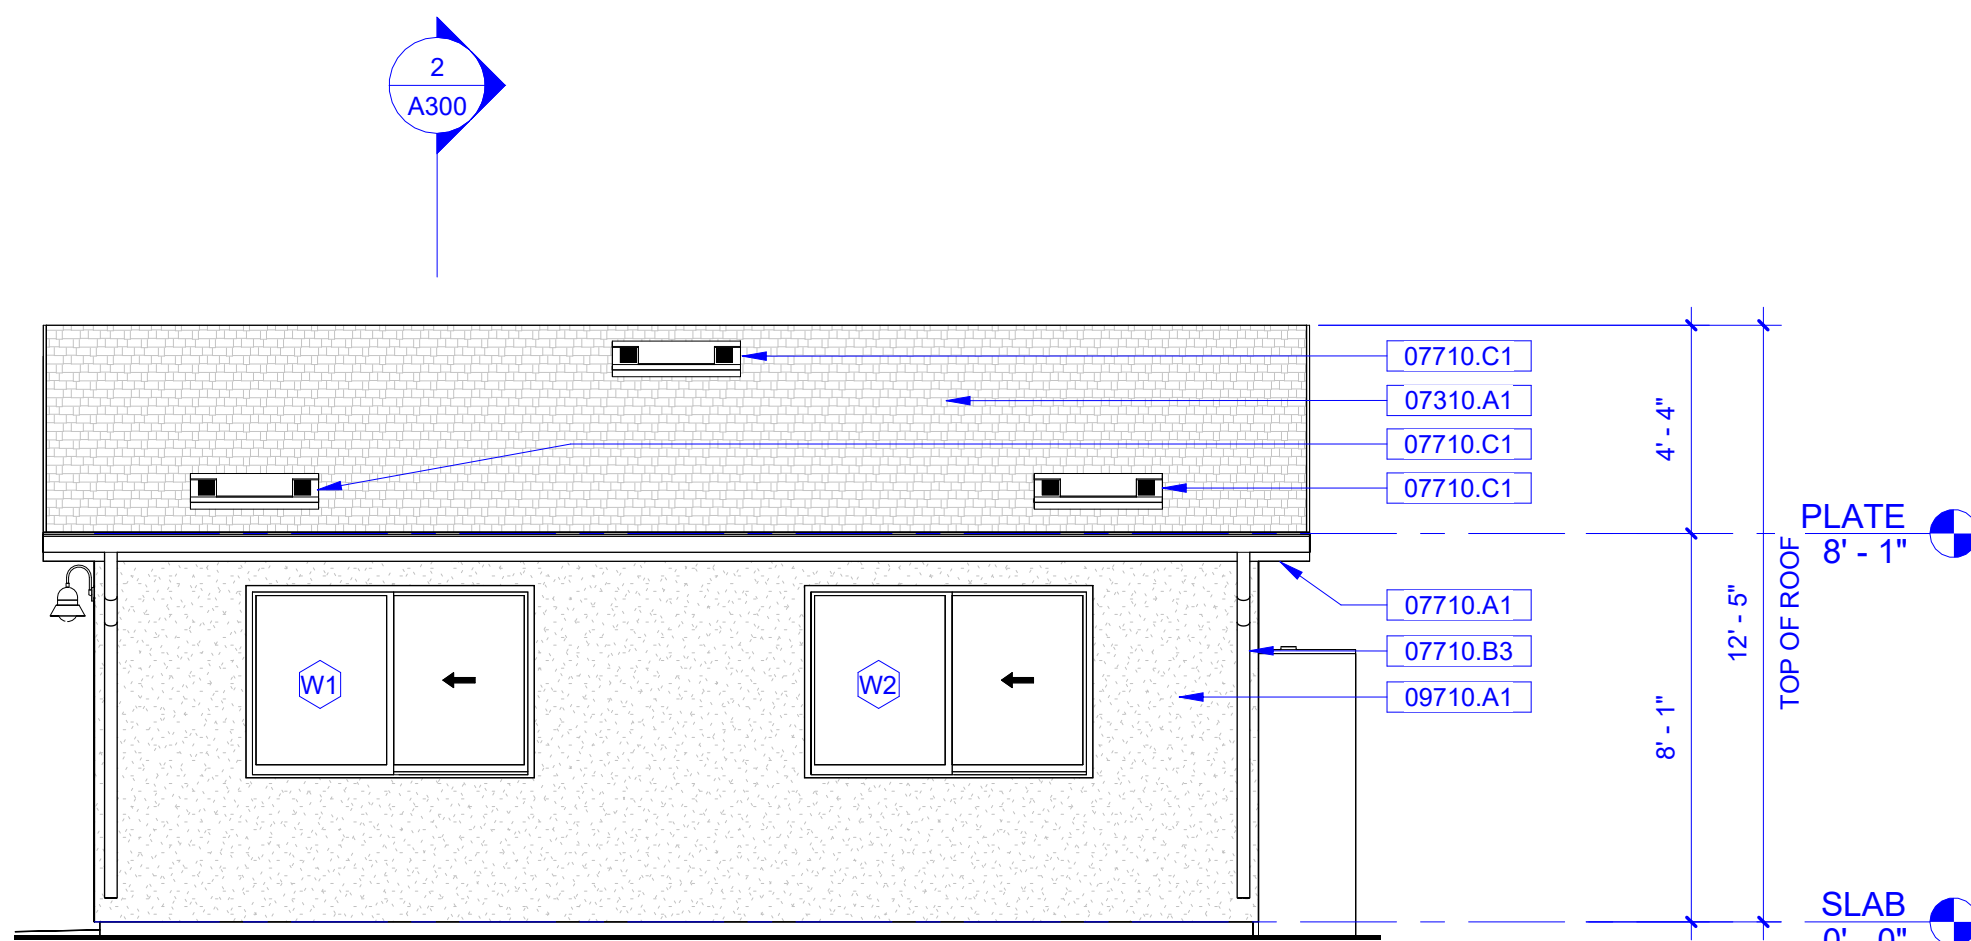

4 EAST ELEVATION - STUCCO
SCALE: 1/4" = 1'-0"

KEYNOTES:

KEYNOTE	DESCRIPTION
07310.A1	ROOFING MATERIAL PER CHECKLIST ON SHEET G102
07710.A1	GUTTER
07710.B3	DOWNSPOUT
07710.C1	O'HAGIN STANDARD LOW PROFILE ATTIC VENTS, 0.68 SF NFVA
09710.A1	STUCCO FINISH, COLOR TBD
15710.D1	DRYER EXHAUST ROOF EXHAUST VENT
15710.D2	RANGE HOOD ROOF EXHAUST VENT
15710.D3	BATH EXHAUST FAN ROOF VENT

GENERAL NOTES

- THE EXTERIOR ROOFING, TRIM, WALLS, WINDOWS, AND COLOR PALETTE OF THE ADU SHALL INCORPORATE THE SAME FEATURES AS THE MAIN DWELLING UNIT.
- THE TYPE, LOCATION, AND SIZE OF THE BUILDING ADDRESS IDENTIFICATION MUST BE CLEARLY VISIBLE AND LEGIBLE FROM THE ADJACENT PUBLIC WAY OR STREET. ADDRESS LETTERS/NUMBERS SHALL BE MINIMUM 4 INCHES HIGH, WITH A MINIMUM STROKE WIDTH OF 1/2 INCH, AND SHALL CONTRAST WITH THEIR BACKGROUND. CRC R319.1.



SNAPADU
DESIGN HOUSE

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 498 SQUARE
CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:

LUIS CALDERON
SnapADU


Luis Calderon
SIGNATURE

RELEASE DATE BY APP. RELEASED FOR...


ELEVATIONS A -
STUCCO

A201


22040

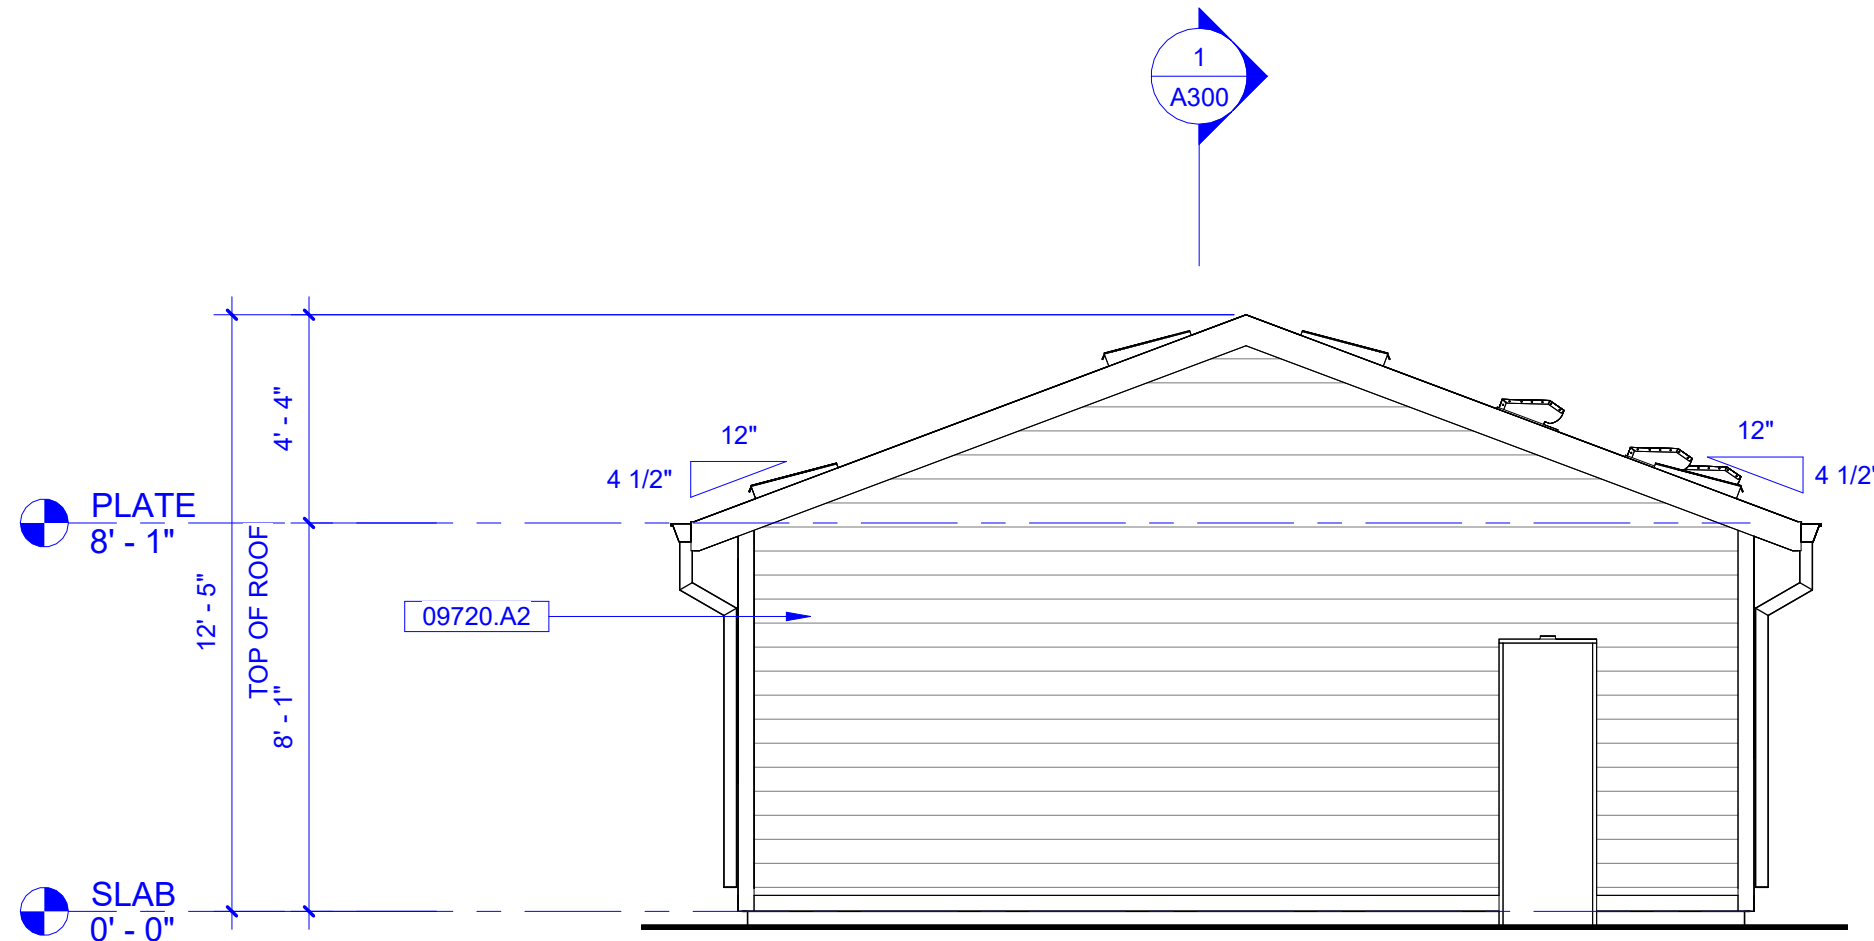


1 NORTH ELEVATION - LAP SIDING
SCALE: 1/4" = 1'-0"

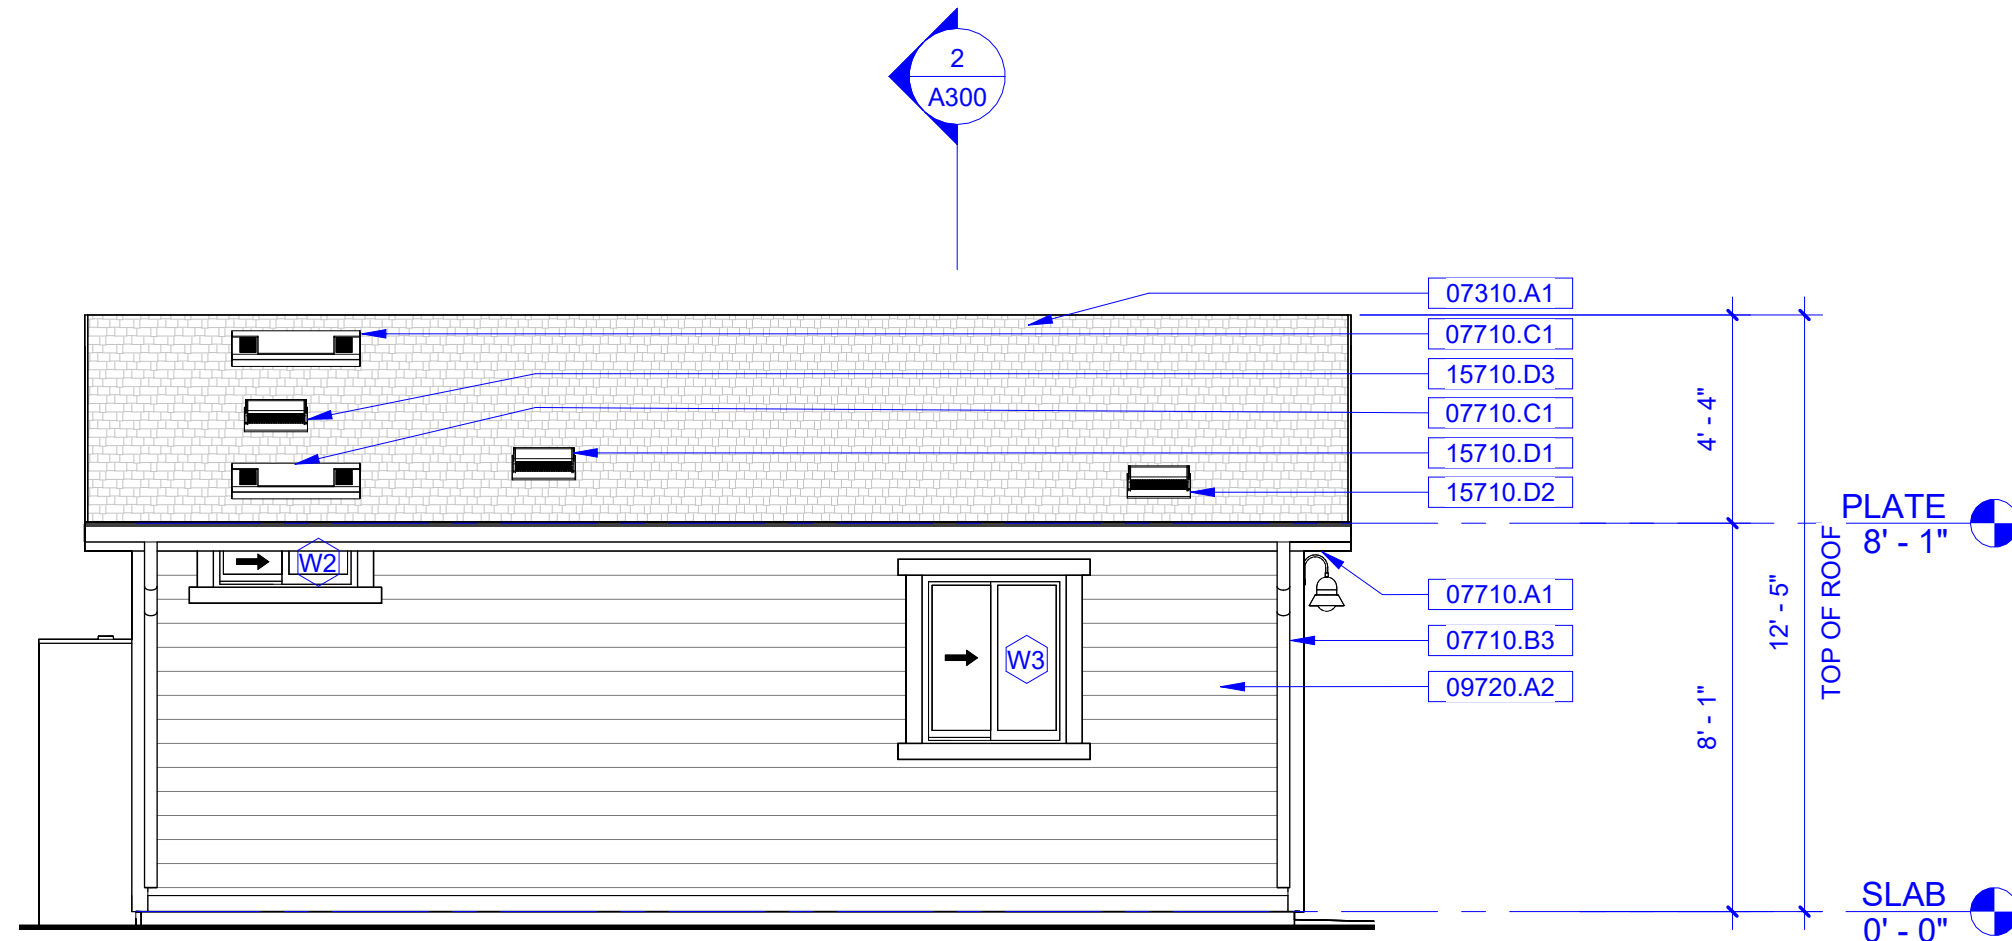

2 WEST ELEVATION - LAP SIDING
SCALE: 1/4" = 1'-0"

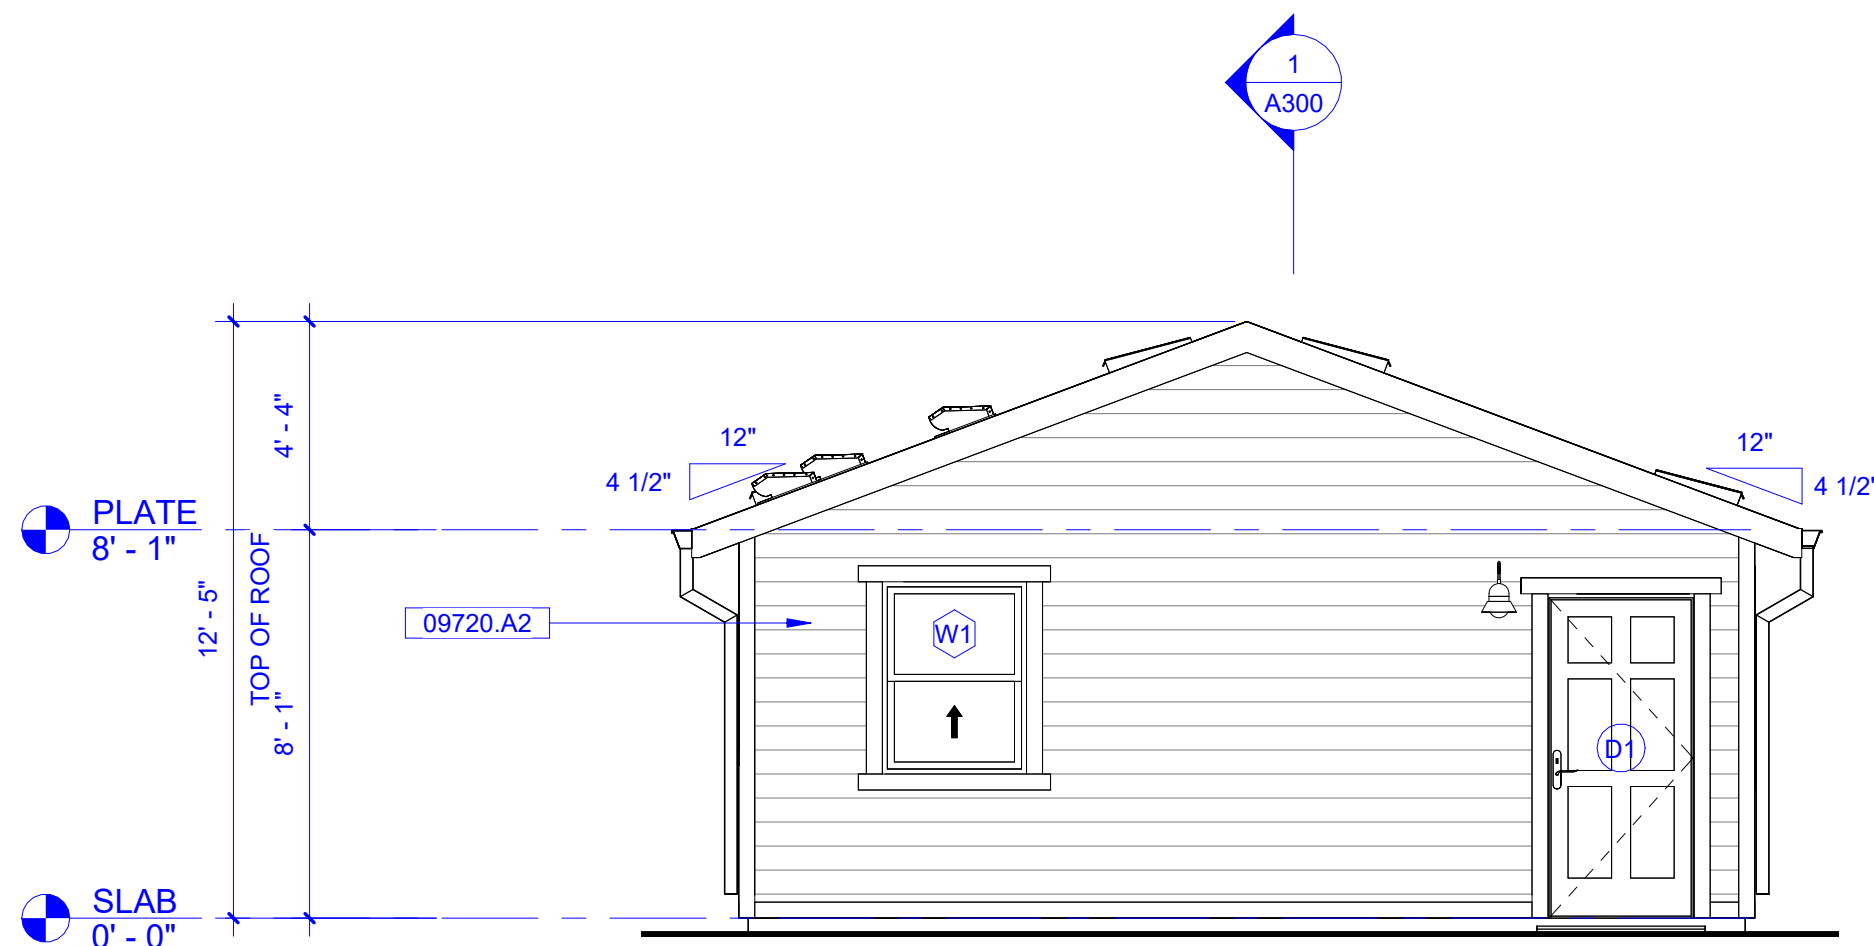

3 SOUTH ELEVATION - LAP SIDING
SCALE: 1/4" = 1'-0"

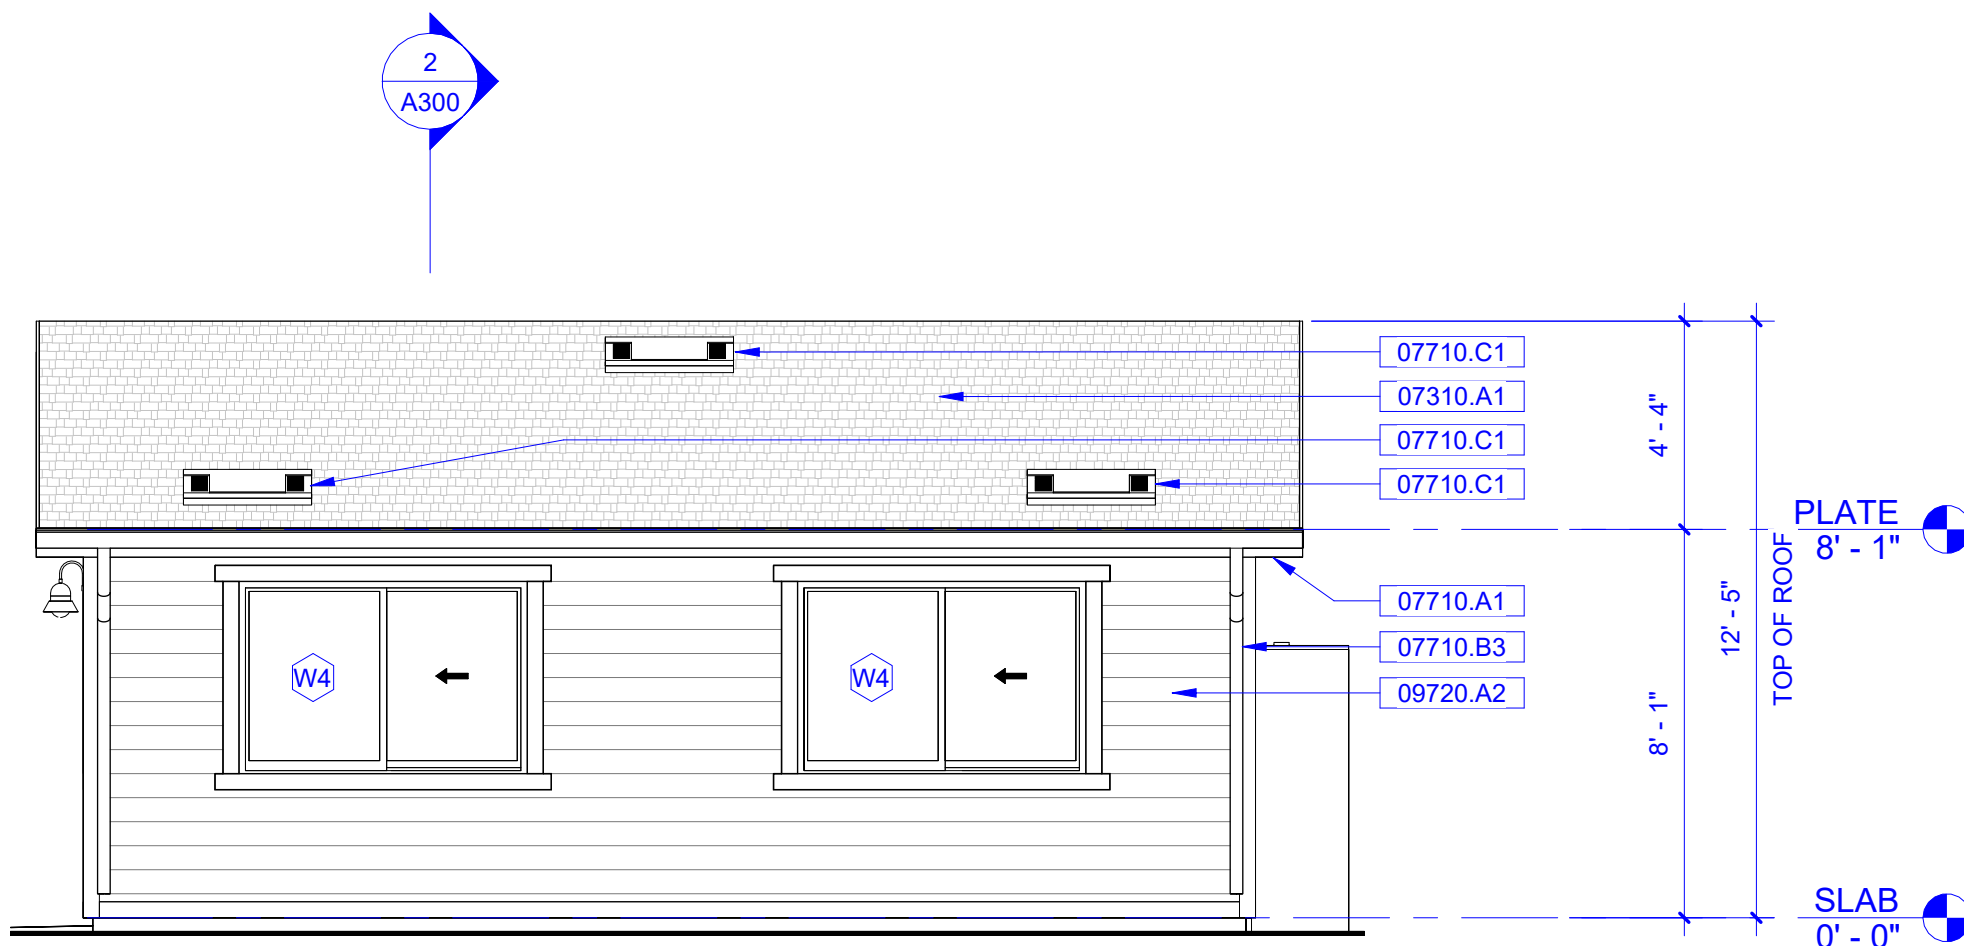

4 EAST ELEVATION - LAP SIDING
SCALE: 1/4" = 1'-0"

KEYNOTES:

KEYNOTE	DESCRIPTION
07310.A1	ROOFING MATERIAL PER CHECKLIST ON SHEET G102
07710.A1	GUTTER
07710.B3	DOWNSPOUT
07710.C1	O'HAGIN STANDARD LOW PROFILE ATTIC VENTS, 0.68 SF NFVA
09720.A2	FIBER CEMENT WALL LAP SIDING 'HARDIEPLANK' ESR-2290 OR SIMILAR, COLOR TBD TO MATCH MAIN RESIDENCE
15710.D1	DRYER EXHAUST ROOF EXHAUST VENT
15710.D2	RANGE HOOD ROOF EXHAUST VENT
15710.D3	BATH EXHAUST FAN ROOF VENT



SNAPADU
DESIGN HOUSE

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 498 SQUARE
CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:

LUIS CALDERON
SnapADU

Luis Calderon
SIGNATURE

RELEASE DATE BY APP. RELEASED FOR...

GENERAL NOTES


- THE EXTERIOR ROOFING, TRIM, WALLS, WINDOWS, AND COLOR PALETTE OF THE ADU SHALL INCORPORATE THE SAME FEATURES AS THE MAIN DWELLING UNIT.
- THE TYPE, LOCATION, AND SIZE OF THE BUILDING ADDRESS IDENTIFICATION MUST BE CLEARLY VISIBLE AND LEGIBLE FROM THE ADJACENT PUBLIC WAY OR STREET. ADDRESS LETTERS/NUMBERS SHALL BE MINIMUM 4 INCHES HIGH, WITH A MINIMUM STROKE WIDTH OF 1/2 INCH, AND SHALL CONTRAST WITH THEIR BACKGROUND. CRC R319.1.

ELEVATIONS B -
LAP SIDING


A211

22040


Autodesk Docs://22040_City of Chula Vista/22040_City of Chula Vista_498
Square_V2_CD_RVT22.rvt
3/24/2024 7:23:42 AM

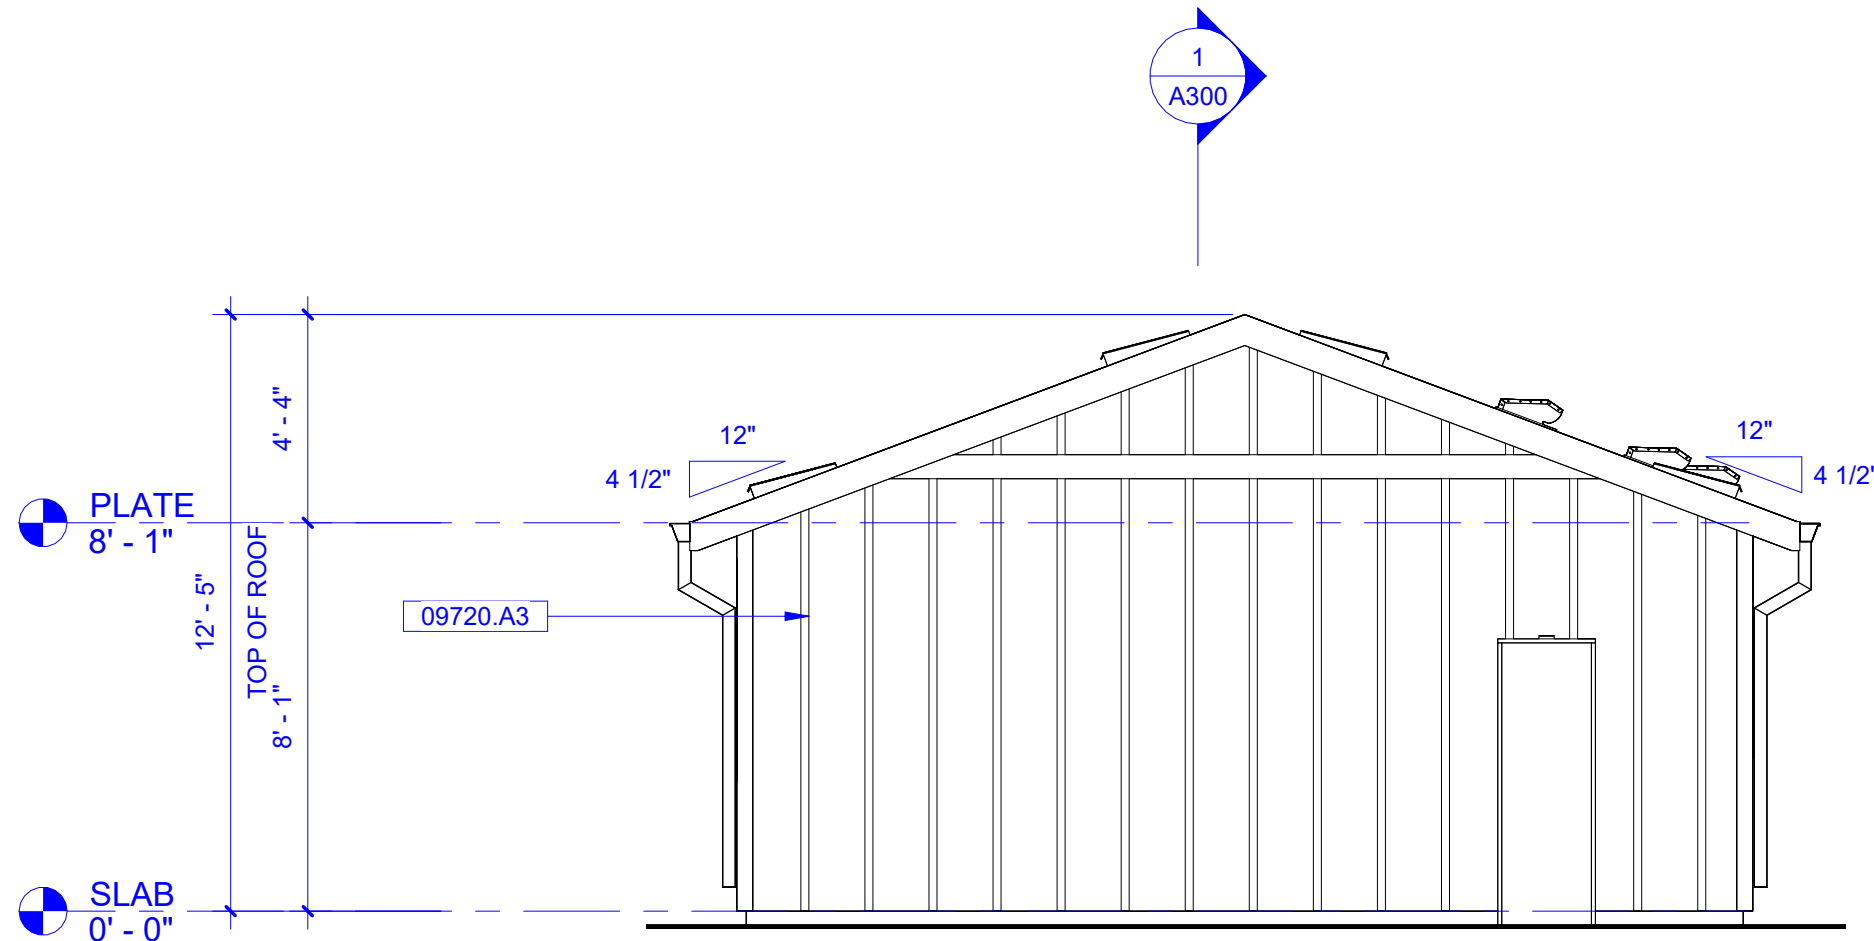


1 NORTH ELEVATION - B&B SIDING
SCALE: 1/4" = 1'-0"

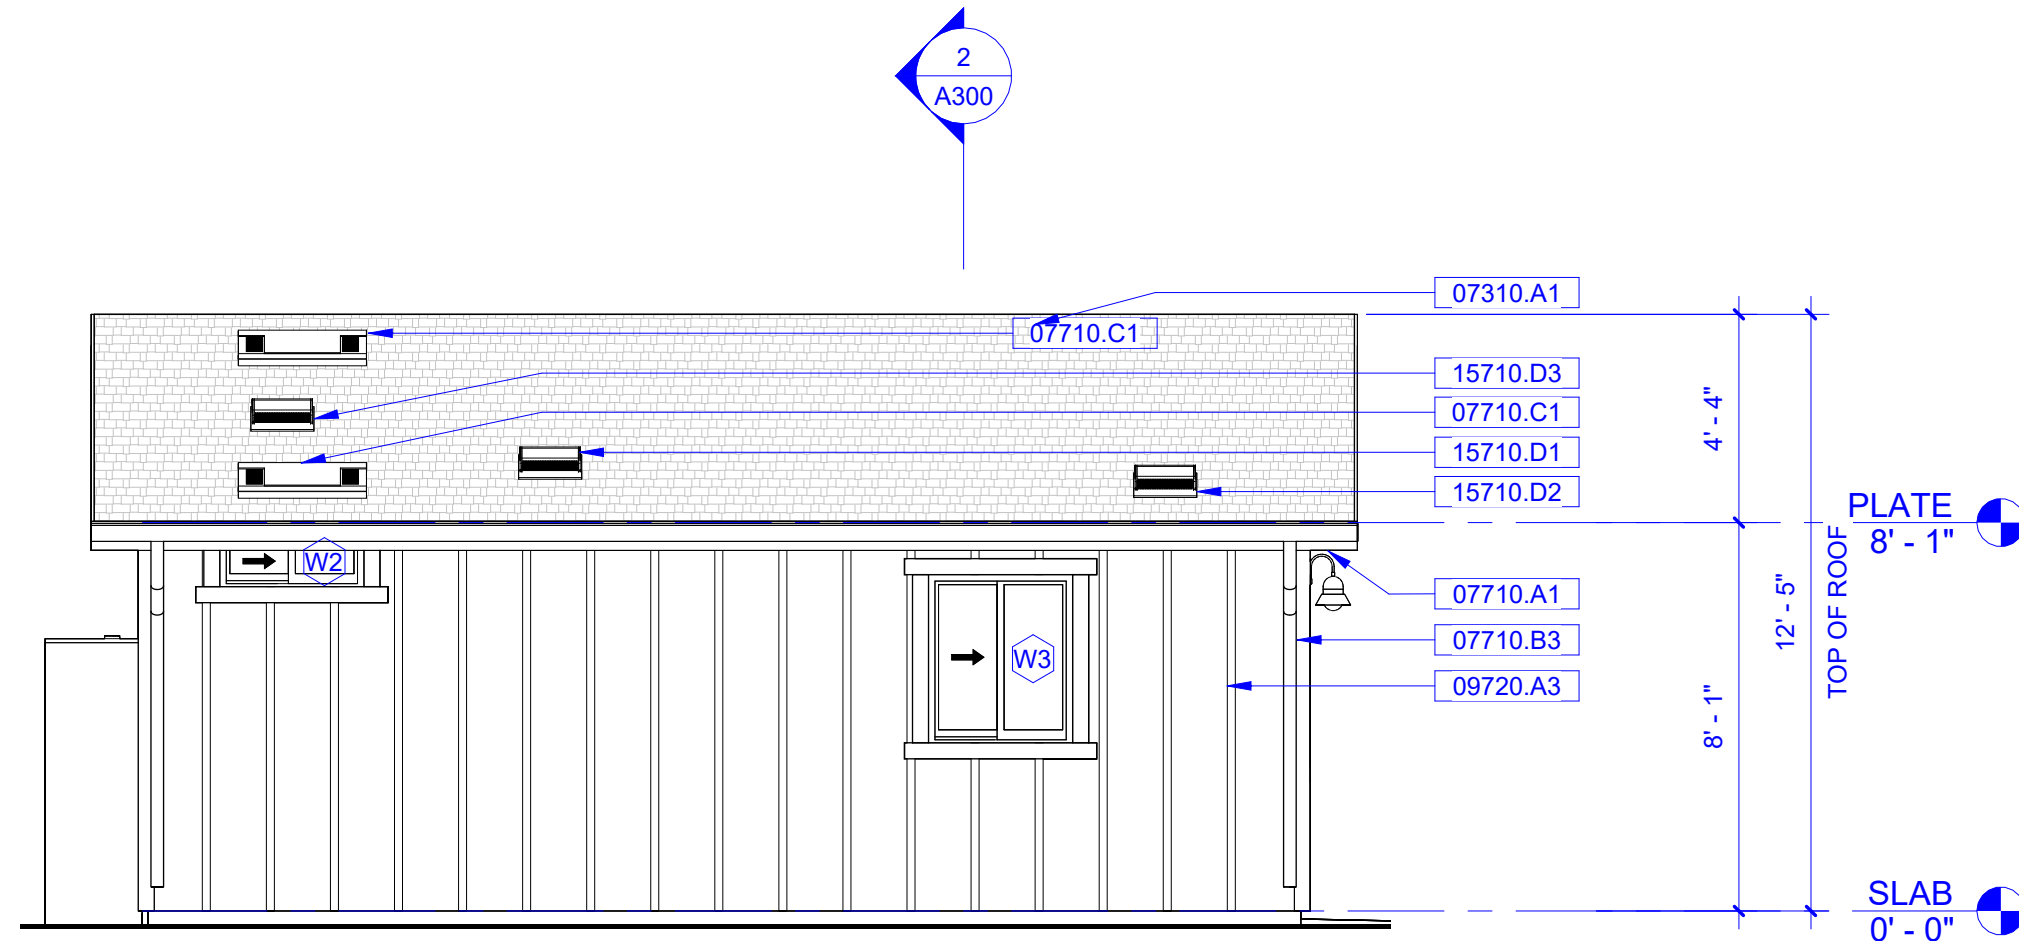

2 WEST ELEVATION - B&B SIDING
SCALE: 1/4" = 1'-0"

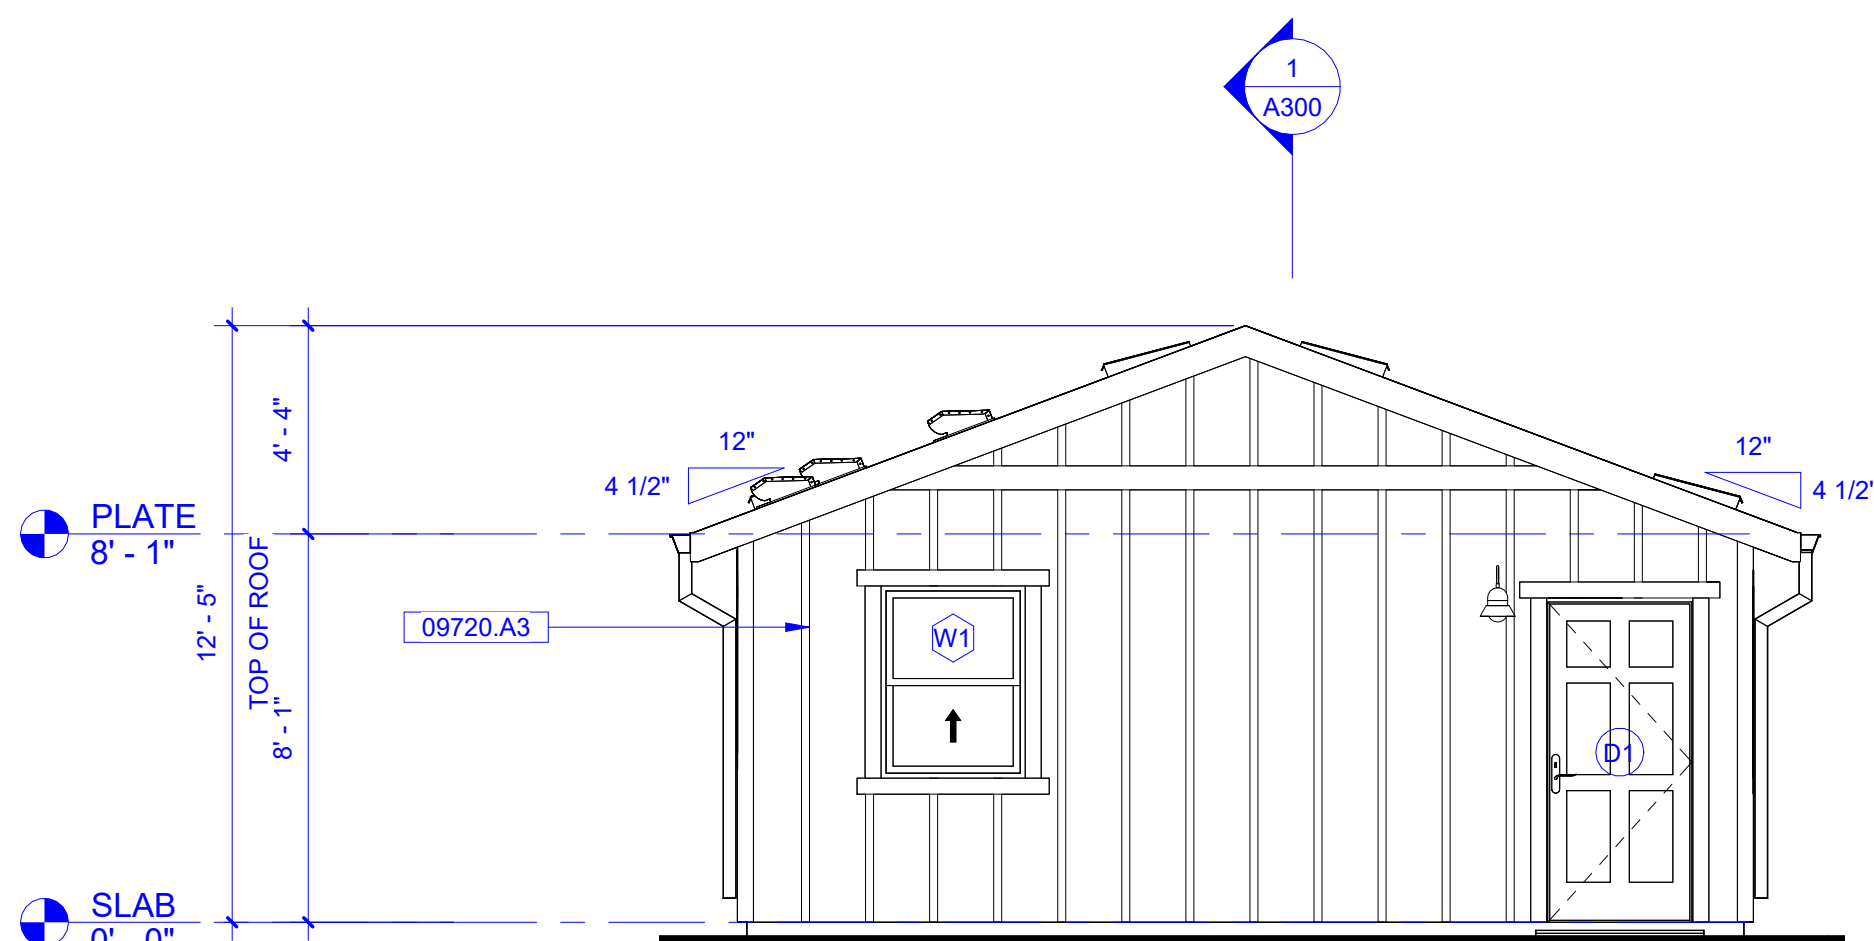

3 SOUTH ELEVATION - B&B SIDING
SCALE: 1/4" = 1'-0"

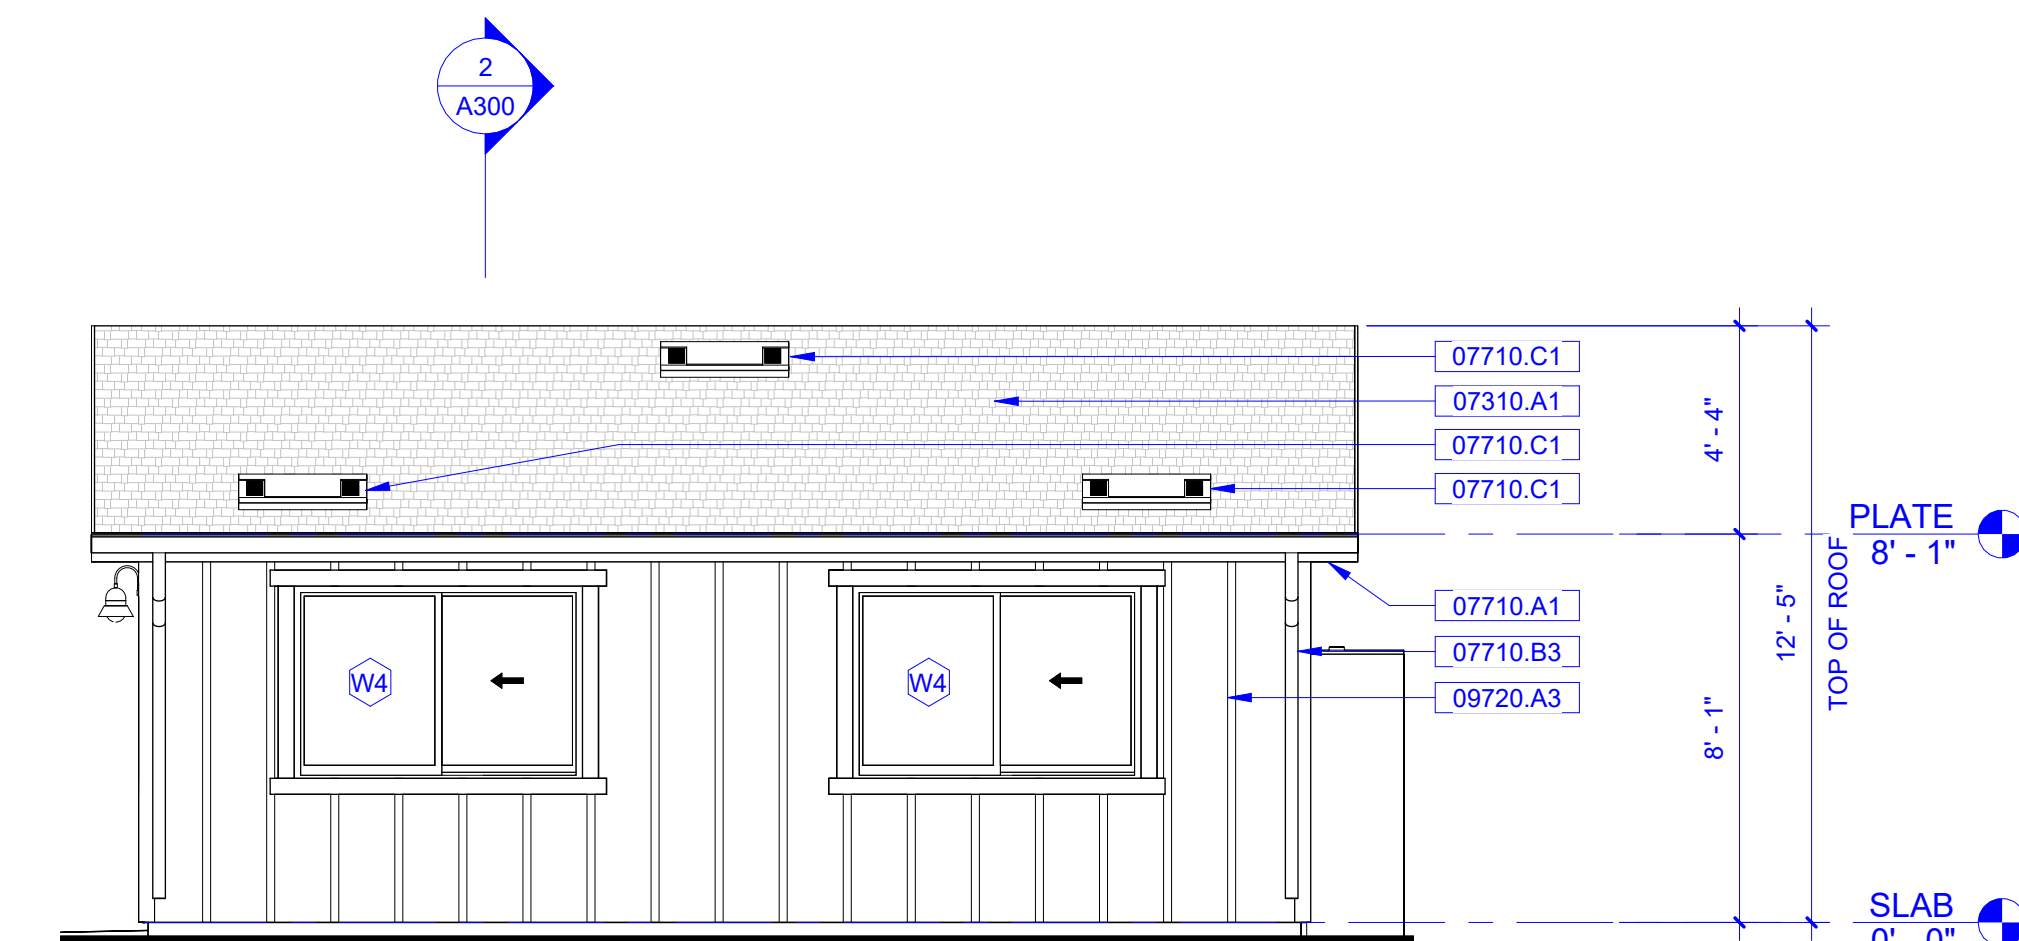

4 EAST ELEVATION - B&B SIDING
SCALE: 1/4" = 1'-0"

KEYNOTES:

KEYNOTE	DESCRIPTION
07310.A1	ROOFING MATERIAL PER CHECKLIST ON SHEET G102
07710.A1	GUTTER
07710.B3	DOWNSPOUT
07710.C1	O'HAGIN STANDARD LOW PROFILE ATTIC VENTS, 0.68 SF NFVA
09720.A3	FIBER CEMENT WALL VERTICAL B&B SIDING 'HARDIEPANEL' ESR-1844 OR SIMILAR, COLOR TBD TO MATCH MAIN RESIDENCE
15710.D1	DRYER EXHAUST ROOF EXHAUST VENT
15710.D2	RANGE HOOD ROOF EXHAUST VENT
15710.D3	BATH EXHAUST FAN ROOF VENT

GENERAL NOTES

- THE EXTERIOR ROOFING, TRIM, WALLS, WINDOWS, AND COLOR PALETTE OF THE ADU SHALL INCORPORATE THE SAME FEATURES AS THE MAIN DWELLING UNIT.
- THE TYPE, LOCATION, AND SIZE OF THE BUILDING ADDRESS IDENTIFICATION MUST BE CLEARLY VISIBLE AND LEGIBLE FROM THE ADJACENT PUBLIC WAY OR STREET. ADDRESS LETTERS/NUMBERS SHALL BE MINIMUM 4 INCHES HIGH, WITH A MINIMUM STROKE WIDTH OF 1/2 INCH, AND SHALL CONTRAST WITH THEIR BACKGROUND. CRC R319.1.



SNAPADU
DESIGN HOUSE

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 498 SQUARE
CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:
LUIS CALDERON
SnapADU


Luis Calderon
SIGNATURE

RELEASE DATE BY APP. RELEASED FOR...


ELEVATIONS C -
BOARD & BATTEN

A221


22040

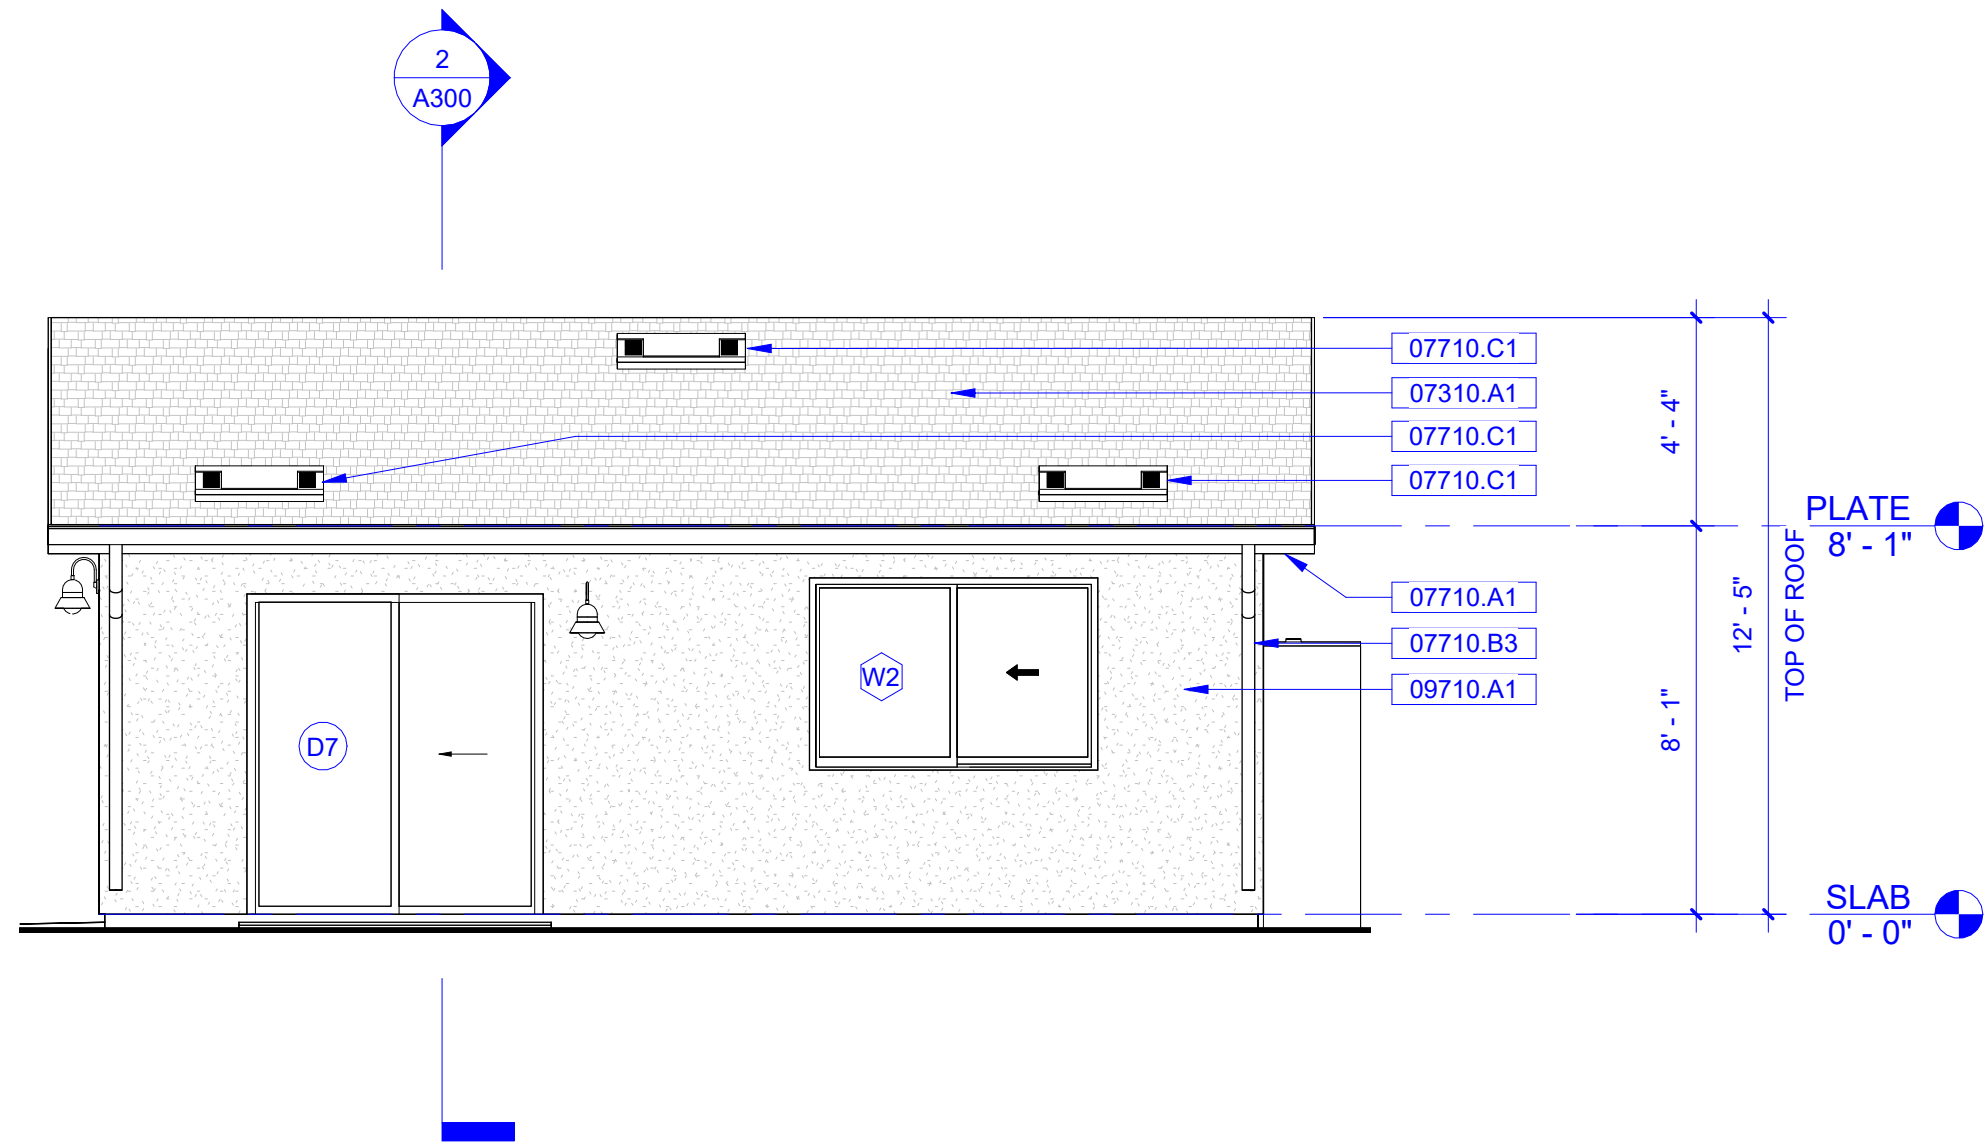

1 EAST ELEVATION - STUCCO - 6068 SGD
SCALE: 1/4" = 1'-0"

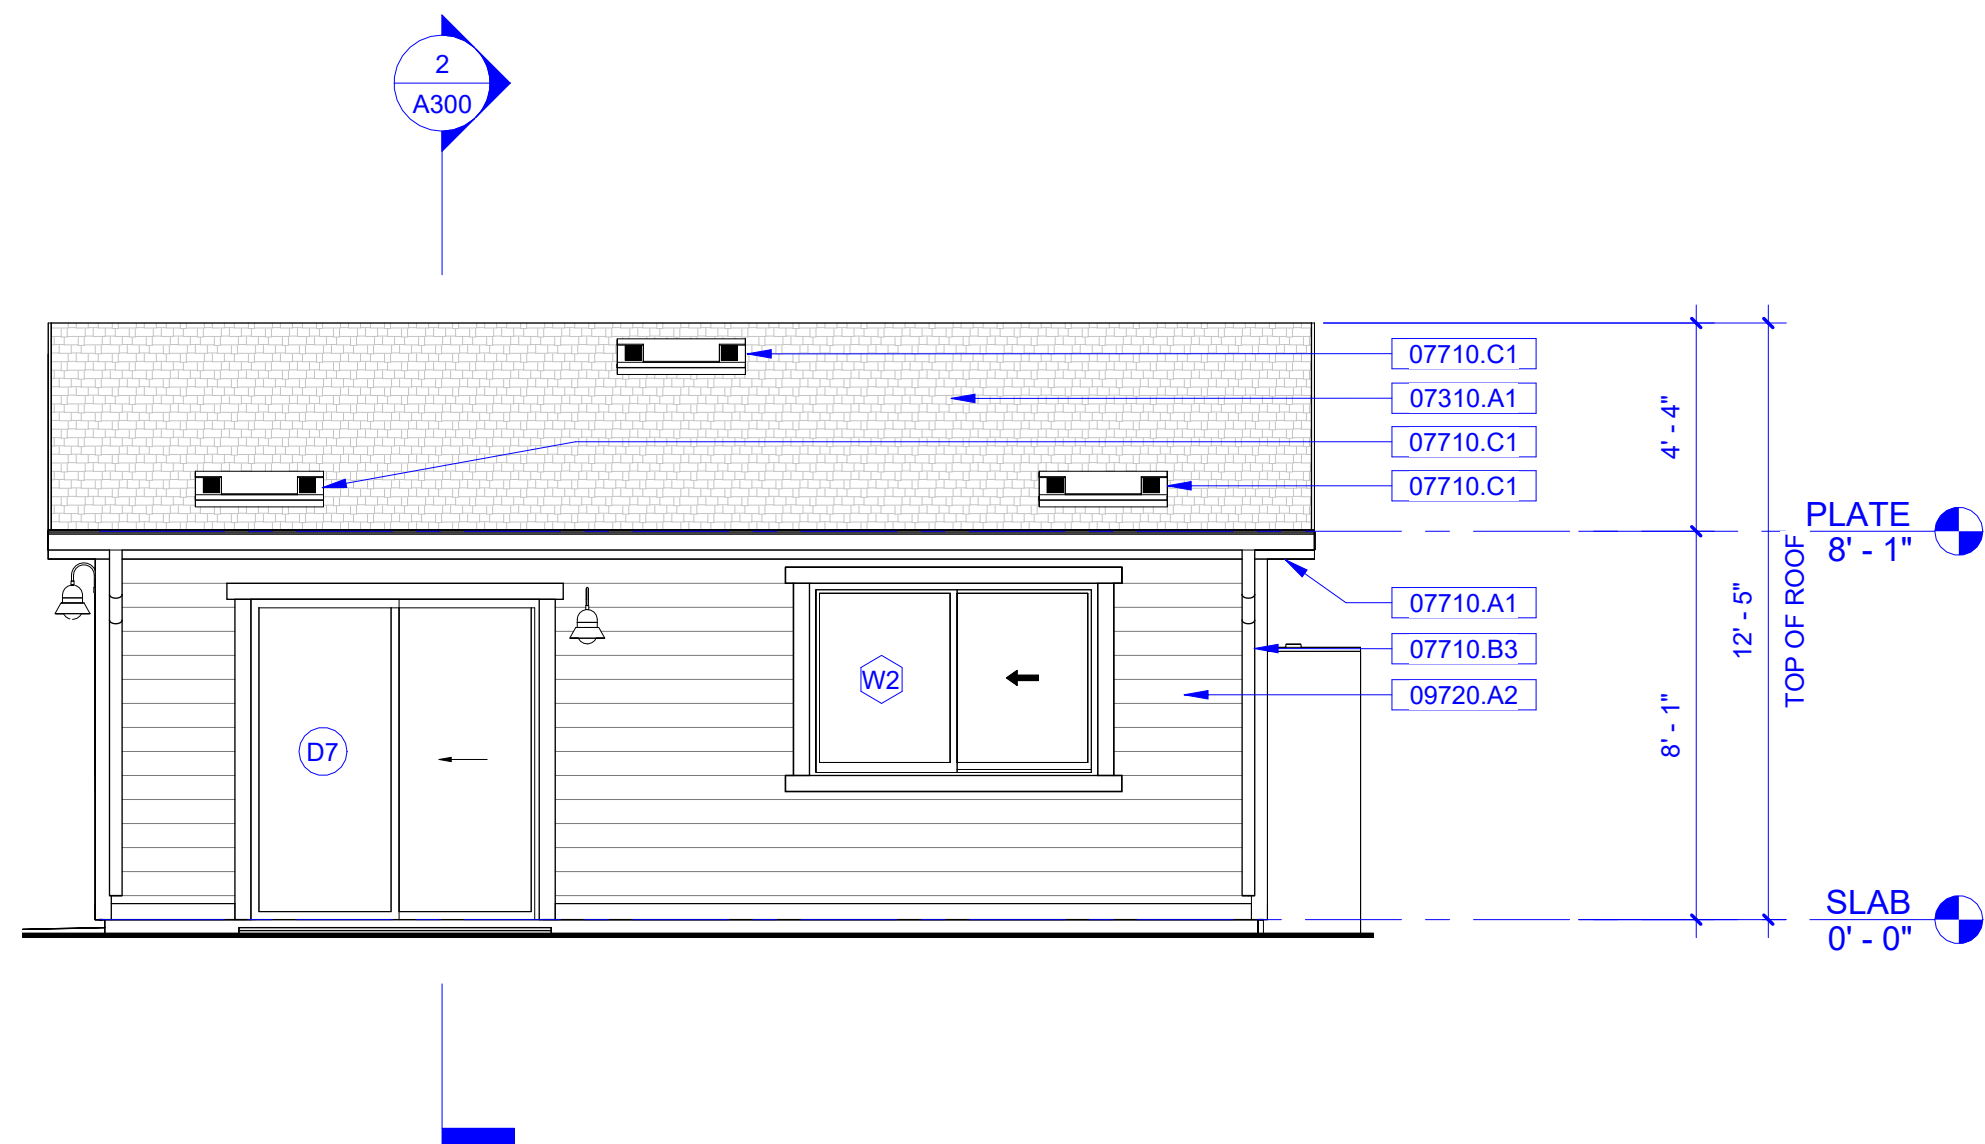

2 EAST ELEVATION - LAP SIDING - 6068 SGD
SCALE: 1/4" = 1'-0"

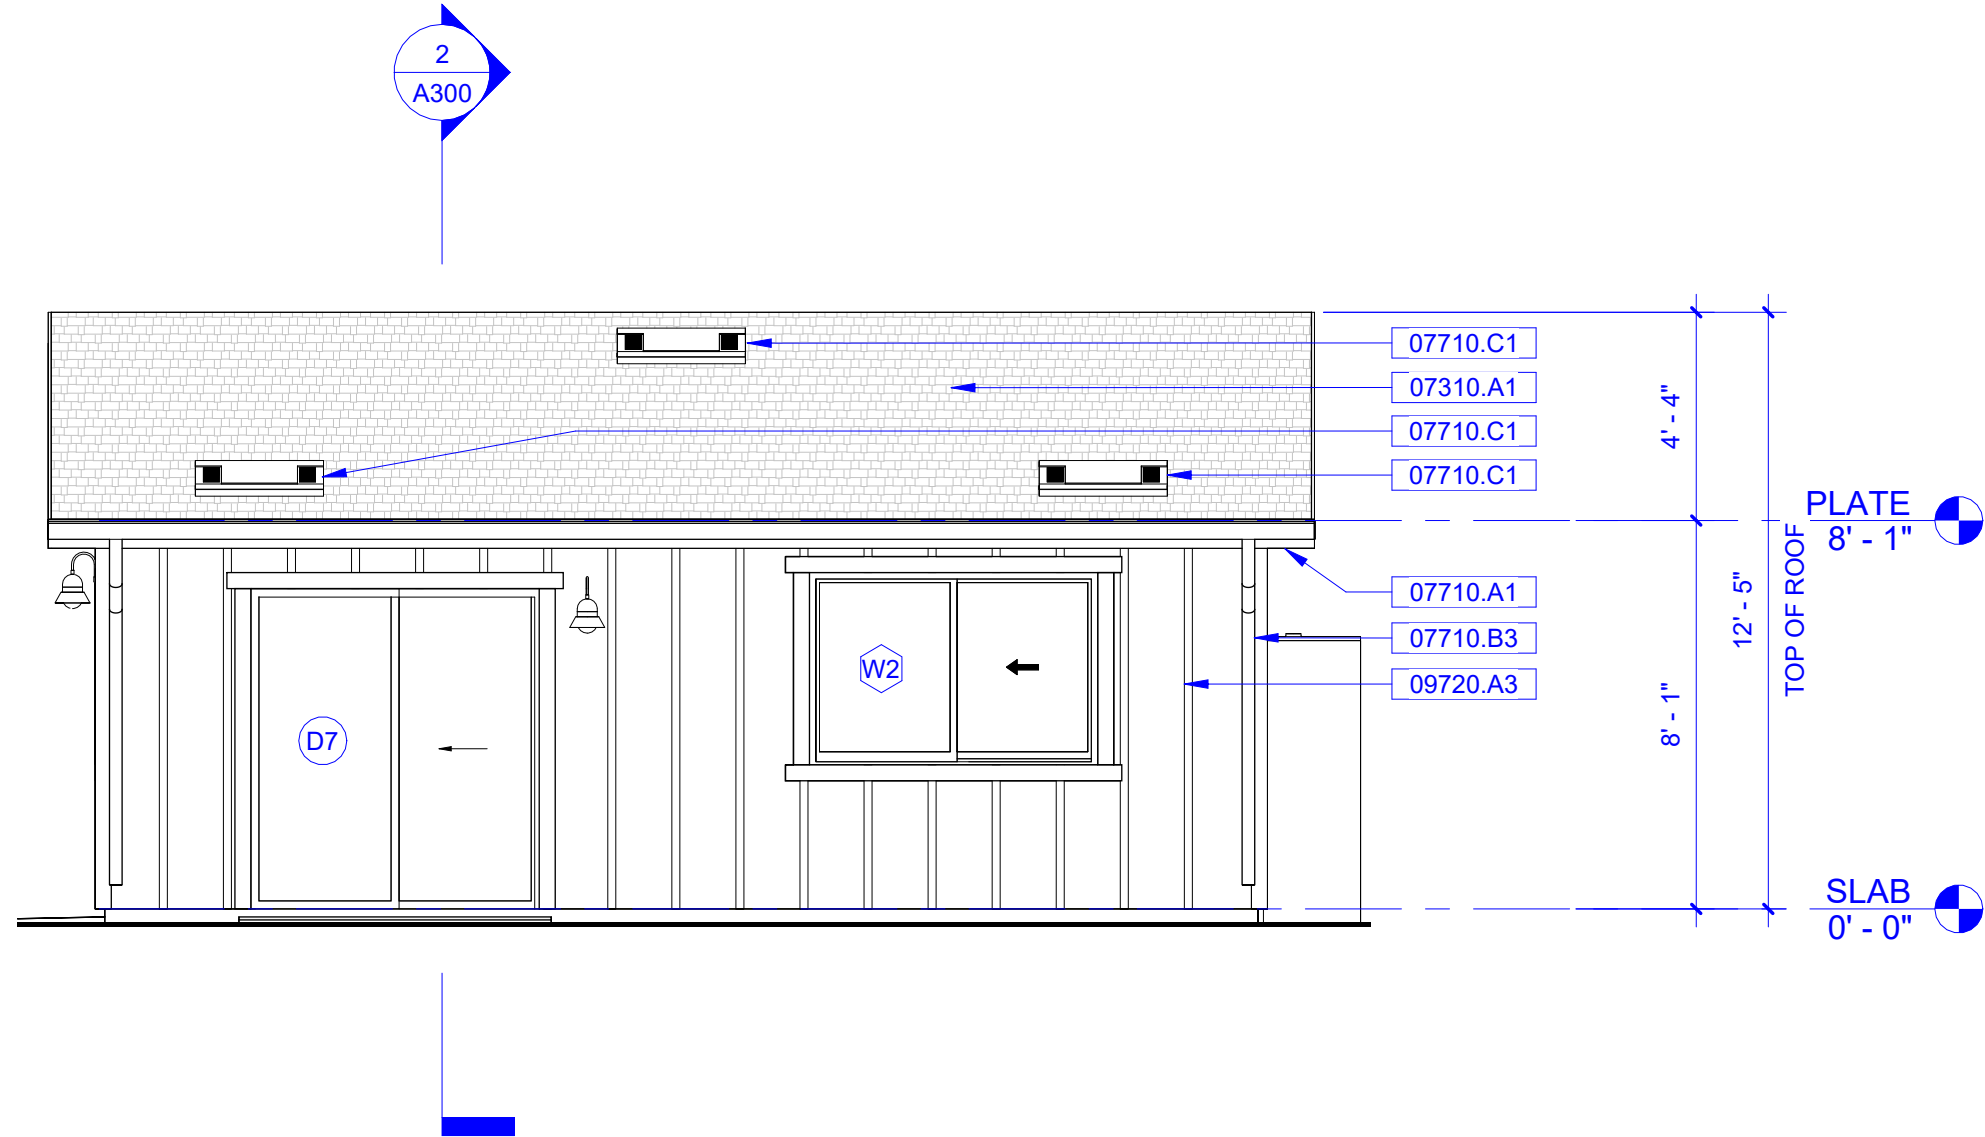

3 EAST ELEVATION - B&B SIDING - 6068 SGD
SCALE: 1/4" = 1'-0"

KEYNOTES:

KEYNOTE	DESCRIPTION
07310.A1	ROOFING MATERIAL PER CHECKLIST ON SHEET G102
07710.A1	GUTTER
07710.B3	DOWNSPOUT
07710.C1	O'HAGIN STANDARD LOW PROFILE ATTIC VENTS, 0.68 SF NFVA
09720.A3	FIBER CEMENT WALL VERTICAL B&B SIDING 'HARDIEPANEL' ESR-1844 OR SIMILAR, COLOR TBD TO MATCH MAIN RESIDENCE



SNAPADU
DESIGN HOUSE
YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 498 SQUARE
CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:
LUIS CALDERON
SnapADU

Luis Calderon
SIGNATURE

RELEASE	DATE	BY	APP.	RELEASED FOR...
A	03/22/2024		LAG	



GENERAL NOTES

- THE EXTERIOR ROOFING, TRIM, WALLS, WINDOWS, AND COLOR PALETTE OF THE ADU SHALL INCORPORATE THE SAME FEATURES AS THE MAIN DWELLING UNIT.
- THE TYPE, LOCATION, AND SIZE OF THE BUILDING ADDRESS IDENTIFICATION MUST BE CLEARLY VISIBLE AND LEGIBLE FROM THE ADJACENT PUBLIC WAY OR STREET. ADDRESS LETTERS/NUMBERS SHALL BE MINIMUM 4 INCHES HIGH, WITH A MINIMUM STROKE WIDTH OF 1/2 INCH, AND SHALL CONTRAST WITH THEIR BACKGROUND. CRC R319.1.

ELEVATION -
OPTIONS

A230

22040

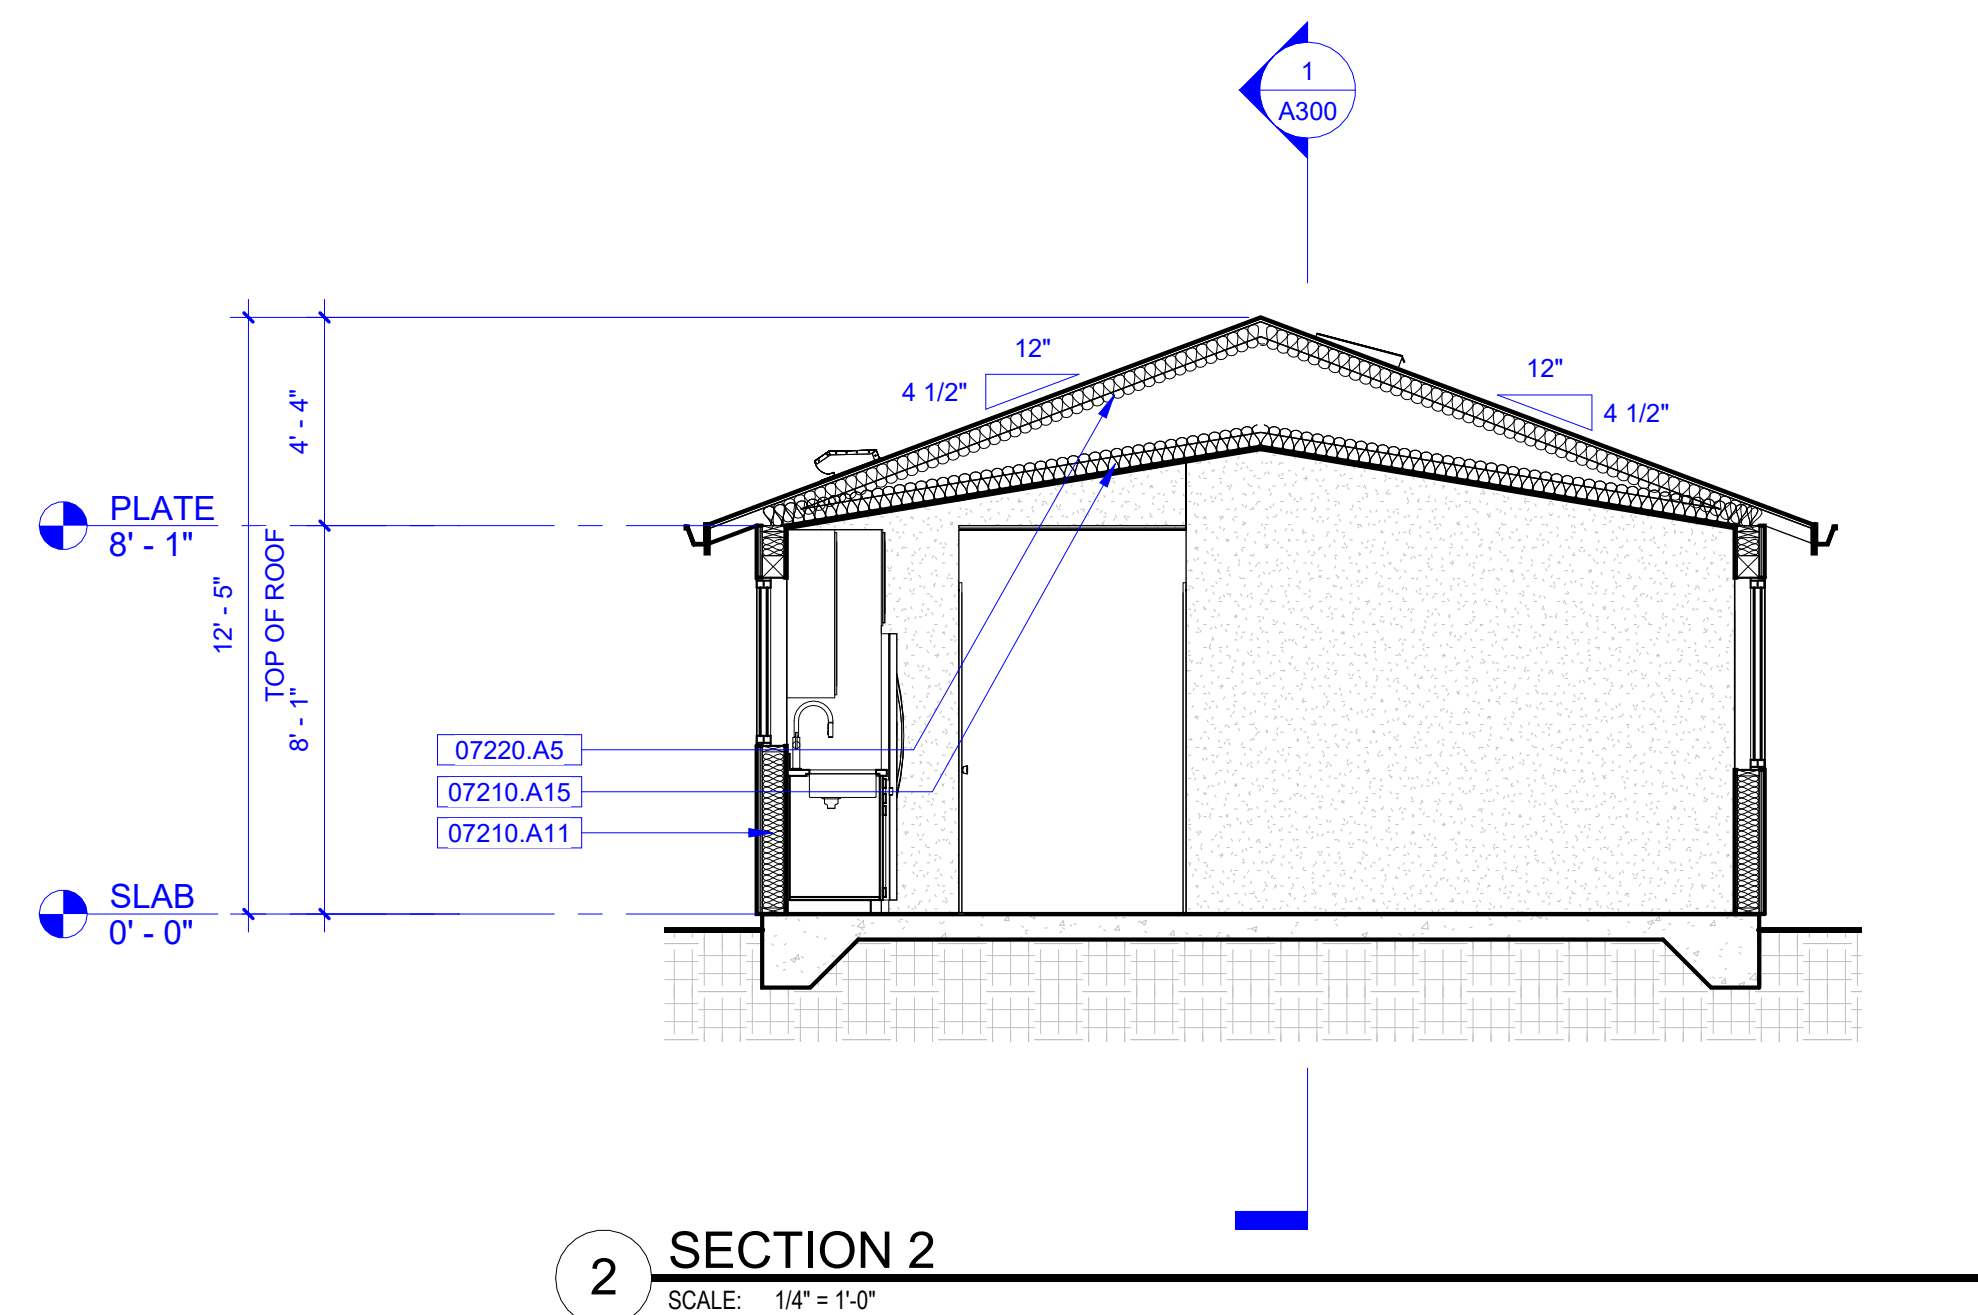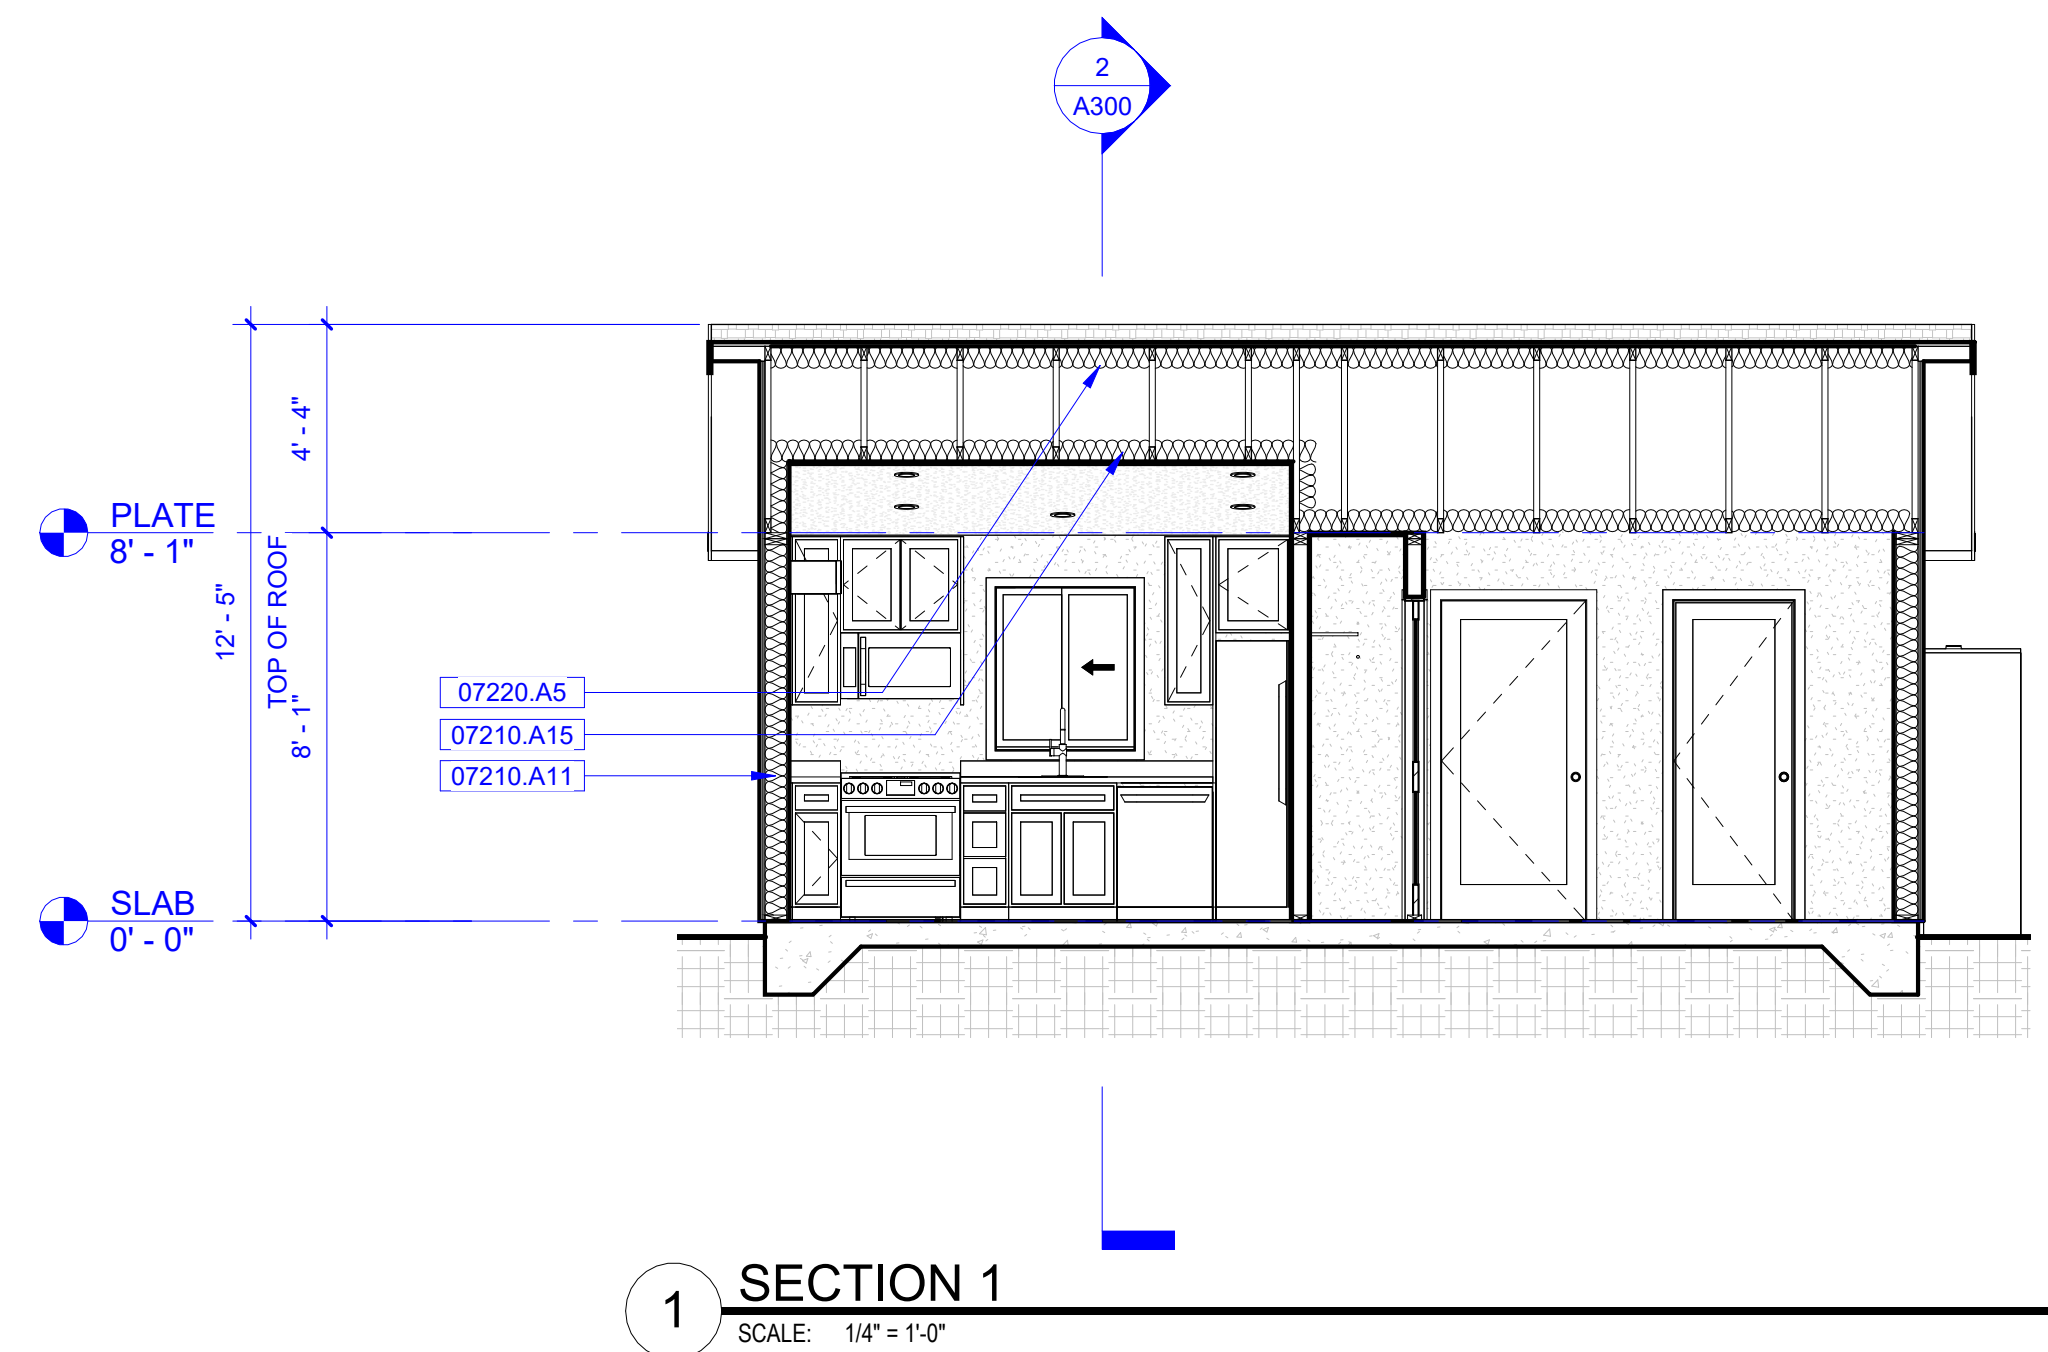

KEYNOTES:

KEYNOTE	DESCRIPTION
07210.A11	WALL BATT INSULATION PER TITLE 24 CALCULATIONS
07210.A15	CEILING BATT INSULATION PER TITLE 24 CALCULATIONS
07220.A5	BATT INSULATION BELOW ROOF DECK PER TITLE 24 CALCULATIONS



YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 498 SQUARE
CITY OF CHULA VISTA

CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:
LUIS CALDERON
SnapADU

LUIS CALDERON
SnapADU

SIGNATURE

SIGNATURE

A	03/22/2024	LAC
RELEASE	DATE	BY APP. RELEASED FOR...

LAC
APP.

BY

--	--

TE

5	□
	三

LEA


BUILDING SECTIONS

A300

22040



8 FOUNDATION VENT CALCULATIONS



(A) GRAB BAR REINFORCEMENT FOR ADAPTABLE WATER CLOSETS

(B) GRAB BAR REINFORCEMENT FOR ADAPTABLE BATHTUBS

(C) GRAB BAR REINFORCEMENT FOR ADAPTABLE SHOWERS

NOTE:
AREAS OUTLINED IN DASHED LINES REPRESENT LOCATION FOR FUTURE INSTALLATION OF GRAB BARS.

6 GRAB BAR REINFORCEMENT FOR AGING-IN-PLACE REQUIREMENTS

STEP 1

ATTACH SILL STRIP WITH TOP EDGE LEVEL WITH ROUGH SILL. EXTEND BEYOND EDGE OF ROUGH OPENING AT LEAST 8". SECURE FLASHING MATERIAL WITH GALVANIZED NAILS OR POWER-DRIVEN STAPLES.

STEP 2

ATTACH JAMB STRIPS WITH SIDE EDGE EVEN WITH ROUGH-JAMB FRAMING. START STRIP 1" BELOW LOWER EDGE OF SILL STRIP AND EXTEND 4" ABOVE LOWER EDGE OF LINTEL.

STEP 3

INSTALL WINDOW INTO ROUGH OPENING WITH SILL AND JAMB FLANGES OVER PREVIOUSLY INSTALLED FLASHING. ATTACH HEAD FLASHING OVER THE WINDOW FLANGE.

STEP 4

COMMENCING AT THE BOTTOM (SILL PLATE) OF THE WALL LAY BUILDING PAPER UNDER SILL STRIP. (A)

NOTE: CUT ANY EXCESS BUILDING PAPER THAT MAY EXTEND ABOVE THE SILL FLANGE LINE ON EACH SIDE OF THE OPENING (SHOWN AS SHORT DASHED LINES).

DO NOT SPLICE BUILDING PAPER HORIZONTALLY SO THAT THE PAPER WILL LAP OVER THE JAMB STRIPS. INSTALL SUCCESSIVE LINES OF BUILDING PAPER (B,C,D, ETC.) OVER JAMB AND HEAD FLANGES, LAPPING EACH COURSE.

- LINE-WIRE WHEN USED AS BACKING TO SUPPORT BUILDING PAPER BENEATH WIRE LATH (NETTING) FOR PORTLAND CEMENT (STUCCO), SHALL BE INSTALLED, AS FOLLOWS:
 - WIRE GAUGE, SPACING AND ATTACHMENT SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF SPECIFICATIONS.
 - PERIPHERAL FLASHING AT ALL EDGES OF WALL OPENINGS MUST COVER THE WIRE BACKING.
 - NO ATTACHMENT DEVICES NOR THE WIRE BACKING SHALL COVER OR PENETRATE THE FLASHING MATERIAL.
- WINDOW FLASHING SHALL BE 'MOISTOP' MINIMUM 12" WIDE (UNLESS OTHERWISE DETAILED).
- PROVIDE SEALANT AROUND WINDOW (VERIFY WITH WINDOW MANUFACTURER ANY CONFLICT TO BE CONFIRMED WITH ARCHITECT PRIOR TO INSTALLATION).
- AT WINDOW HEAD, JAMBS AND SILL, ALL FASTENERS ARE TO BE NAILED THROUGH THE WINDOW FIN NO CLOSER THAN 3 INCHES TO CORNERS, AND NO MORE THAN 10 INCHES FROM CORNERS, NAIL SHALL BE NO MORE THAN 16 INCHES ON CENTER.

4 WINDOW - TYPICAL FLASHING

1 DOOR - INTERIOR HEAD (JAMB SIM.)

2 DOOR - EXTERIOR DOOR THRESHOLD

5 SKYLIGHT SECTION

3 DOOR - SLIDING GLASS DOOR THRESHOLD

SNAPADU
DESIGN HOUSE

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 498 SQUARE

CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:
LUIS CALDERON
SnapADU

Luis Calderon
SIGNATURE


RELEASE	DATE	BY	APP.	RELEASED FOR...
A	03/22/2024	LAG		

GENERIC DOOR,
WINDOW & MISC.
DETAILS

A501


22040

Autodesk Docs //22040_City of Chula Vista//22040_City of Chula Vista_ 498
3/24/2024 7:23:48 AM
Square V2_CD_RV722.rvt

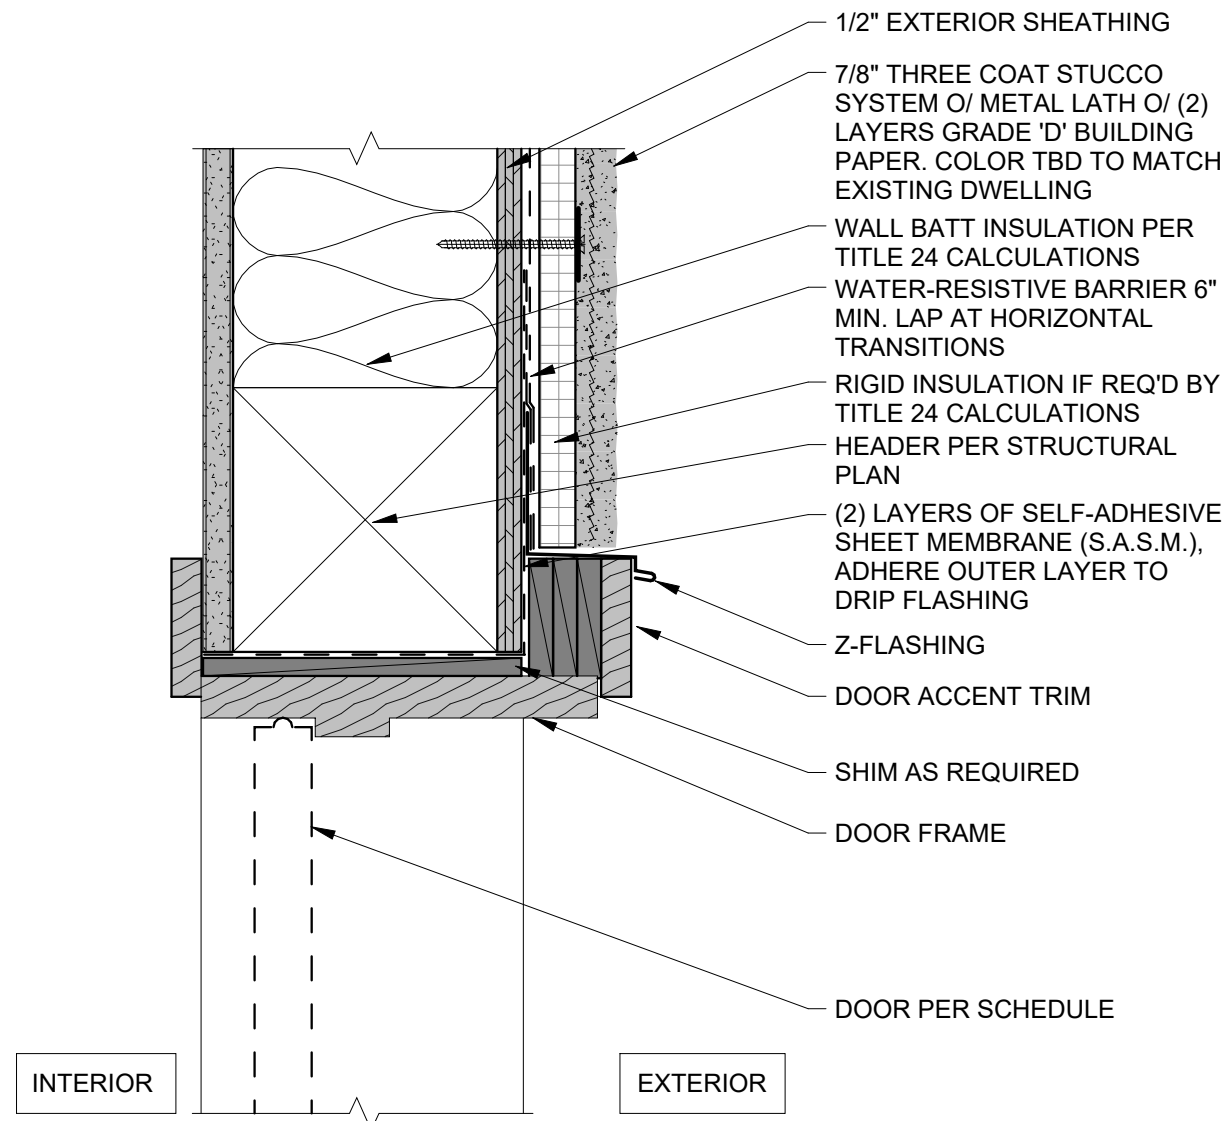


10 DOOR - EXTERIOR HEAD @ STUCCO
W/ CONT. INSULATION (JAMB SIM.)

SCALE: 3" = 1'-0"

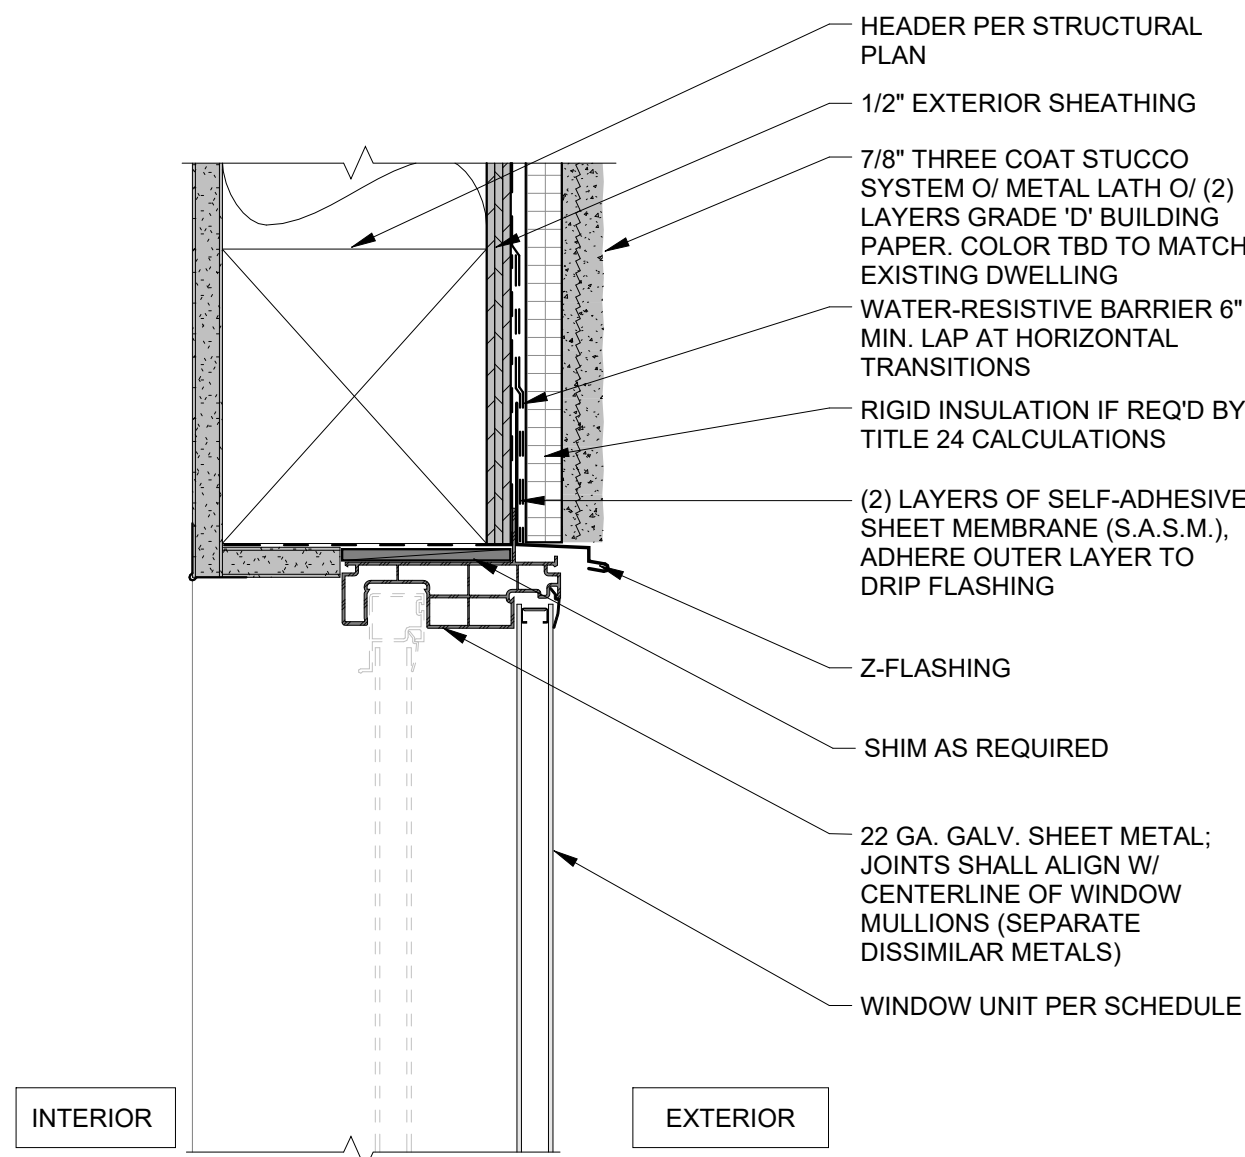


7 WINDOW - EXTERIOR HEAD @ STUCCO
W/ CONT. INSULATION (JAMB SIM.)

SCALE: 3" = 1'-0"

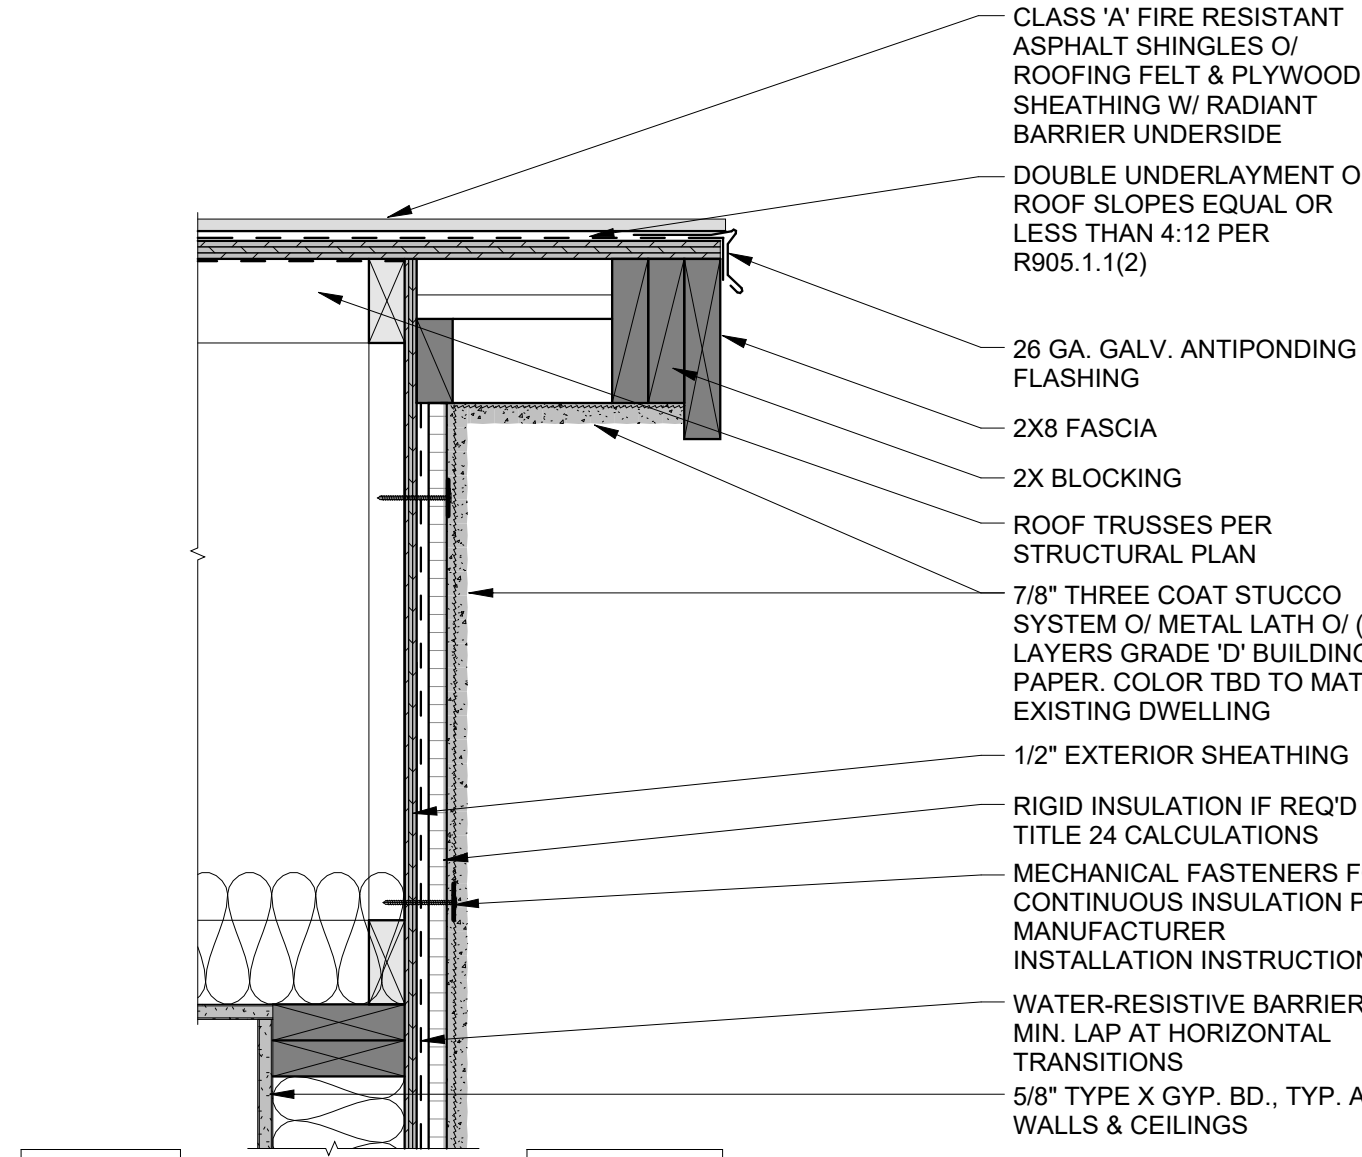


4 A1 - ROOF RAKE - SHINGLE PROTECTED
W/ CONT. INSULATION AND STUCCO

SCALE: 1 1/2" = 1'-0"

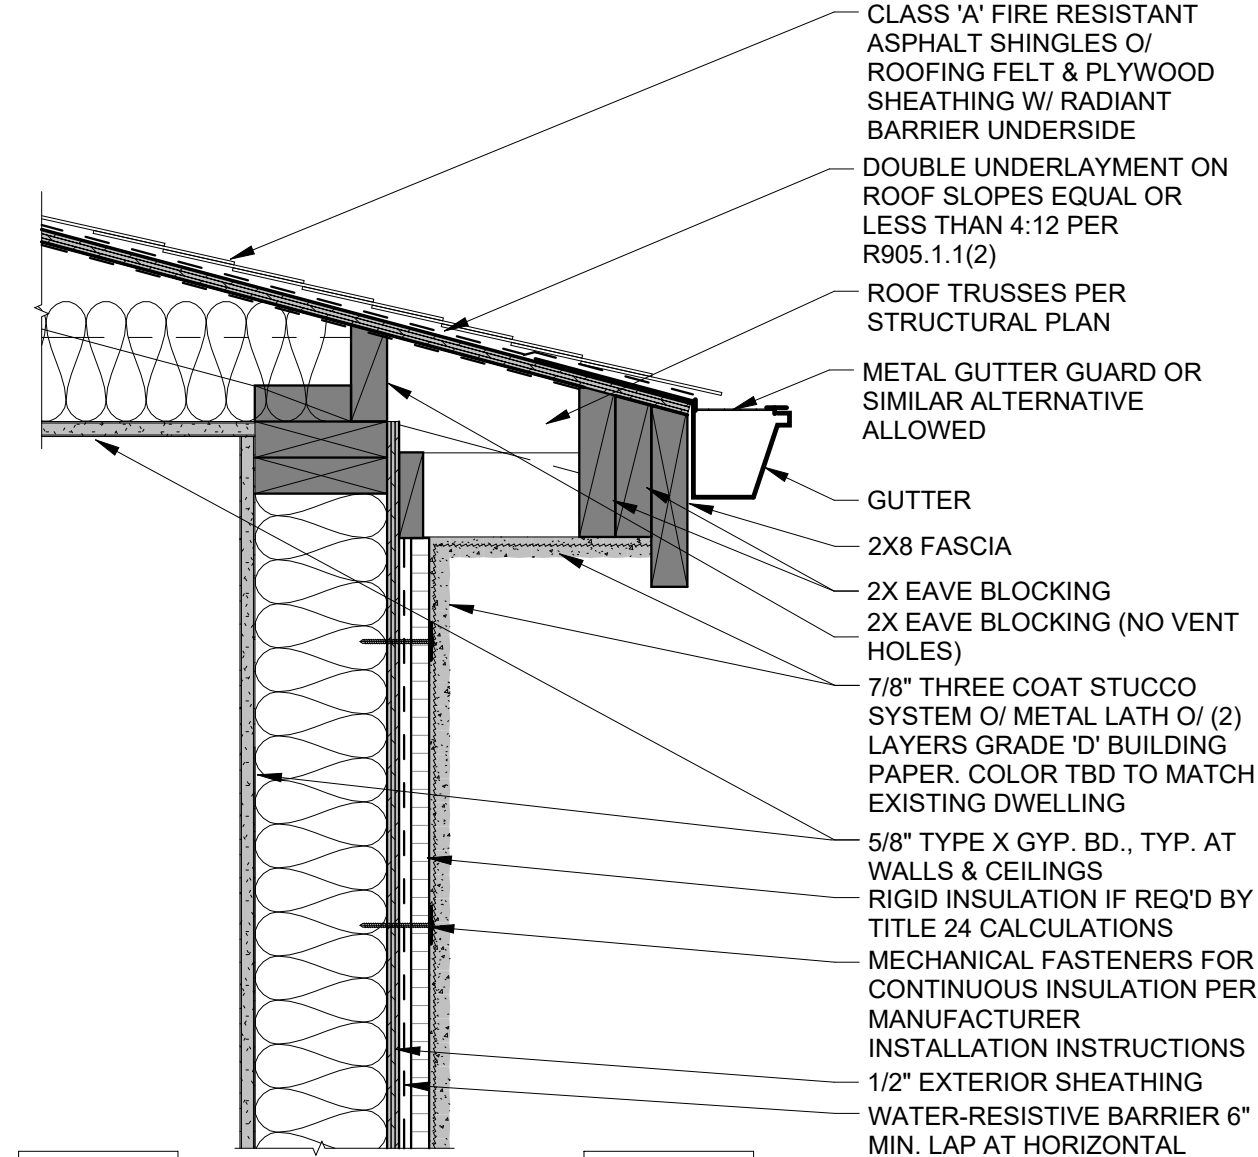


1 A1 - ROOF EAVE - SHINGLE PROTECTED
W/ CONT. INSULATION AND STUCCO

SCALE: 1 1/2" = 1'-0"

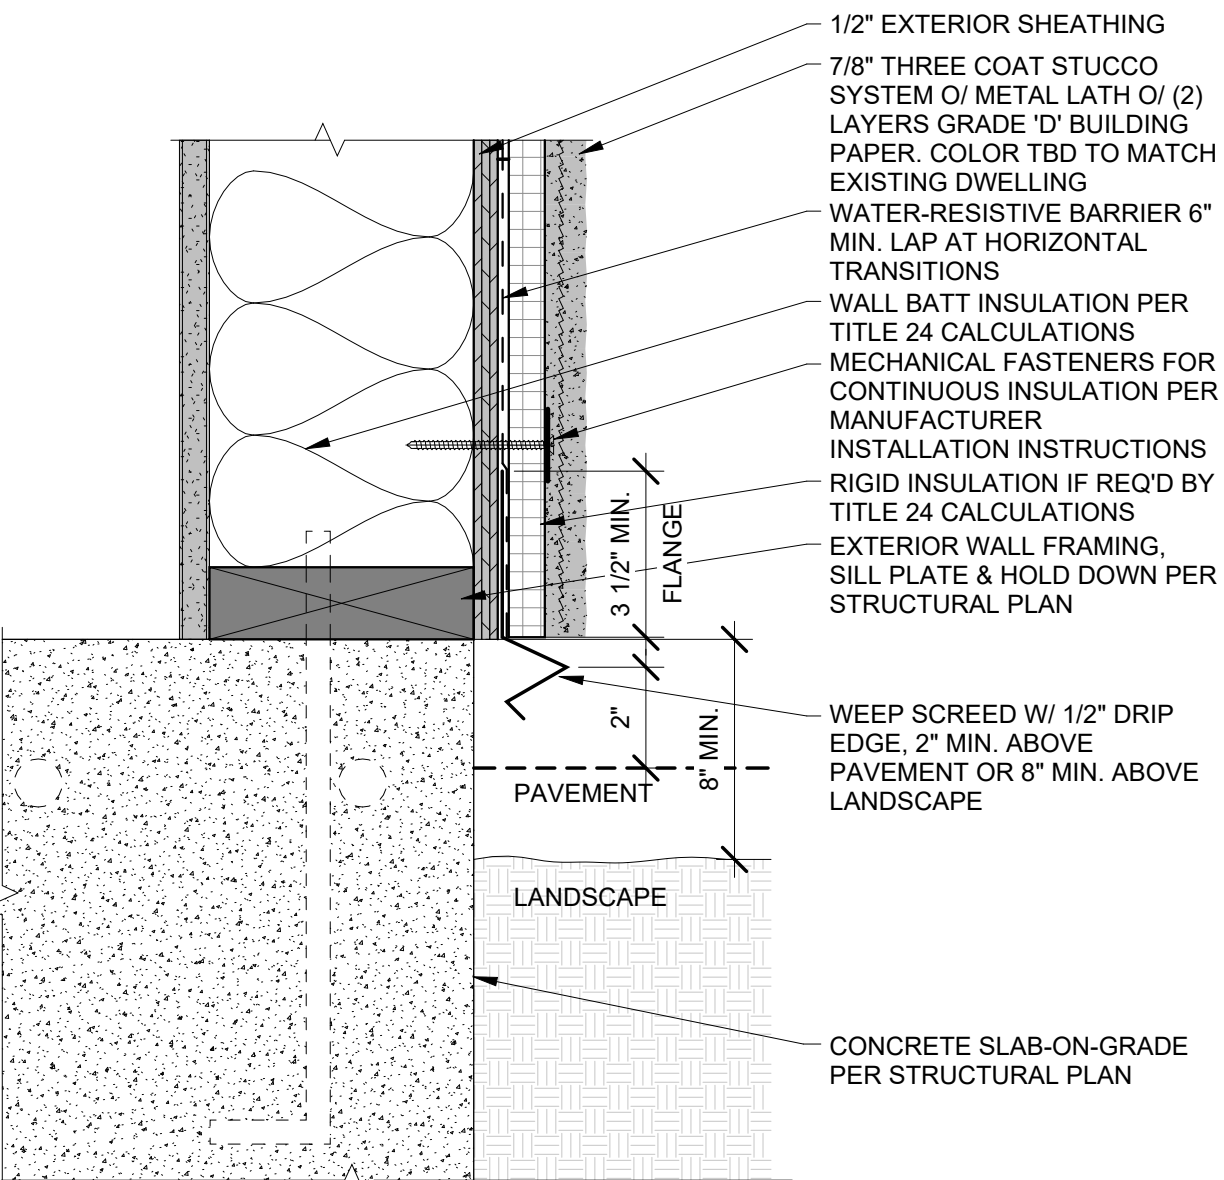


11 WALL - EXTERIOR STUCCO SCREED
W/ CONT. INSULATION

SCALE: 3" = 1'-0"

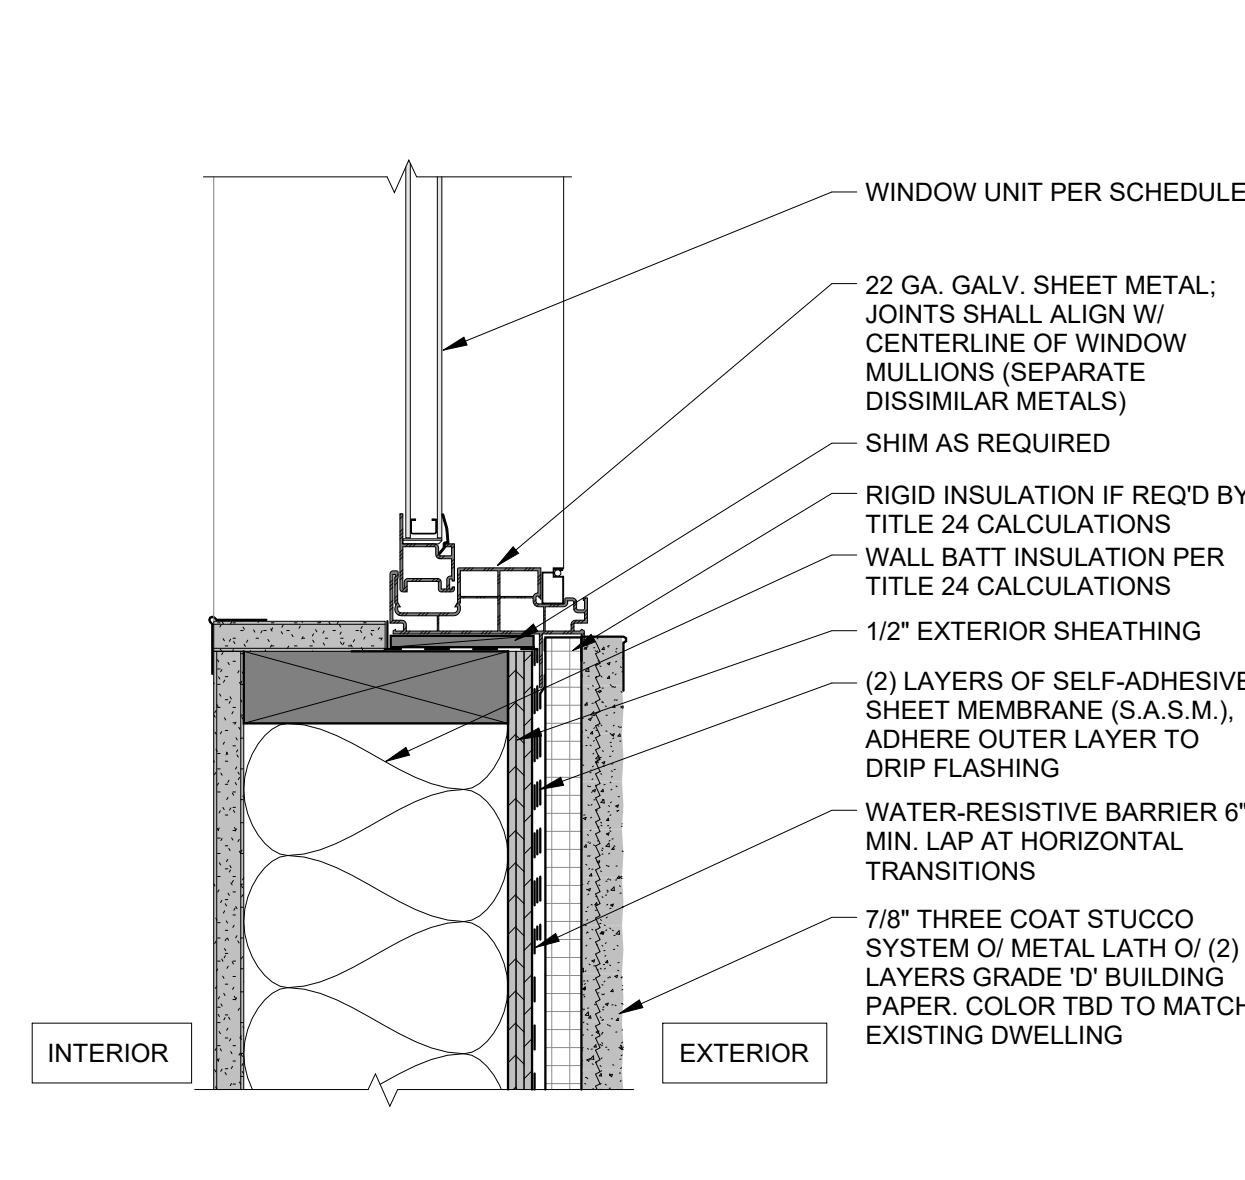


8 WINDOW - EXTERIOR SILL @ STUCCO
W/ CONT. INSULATION

SCALE: 3" = 1'-0"

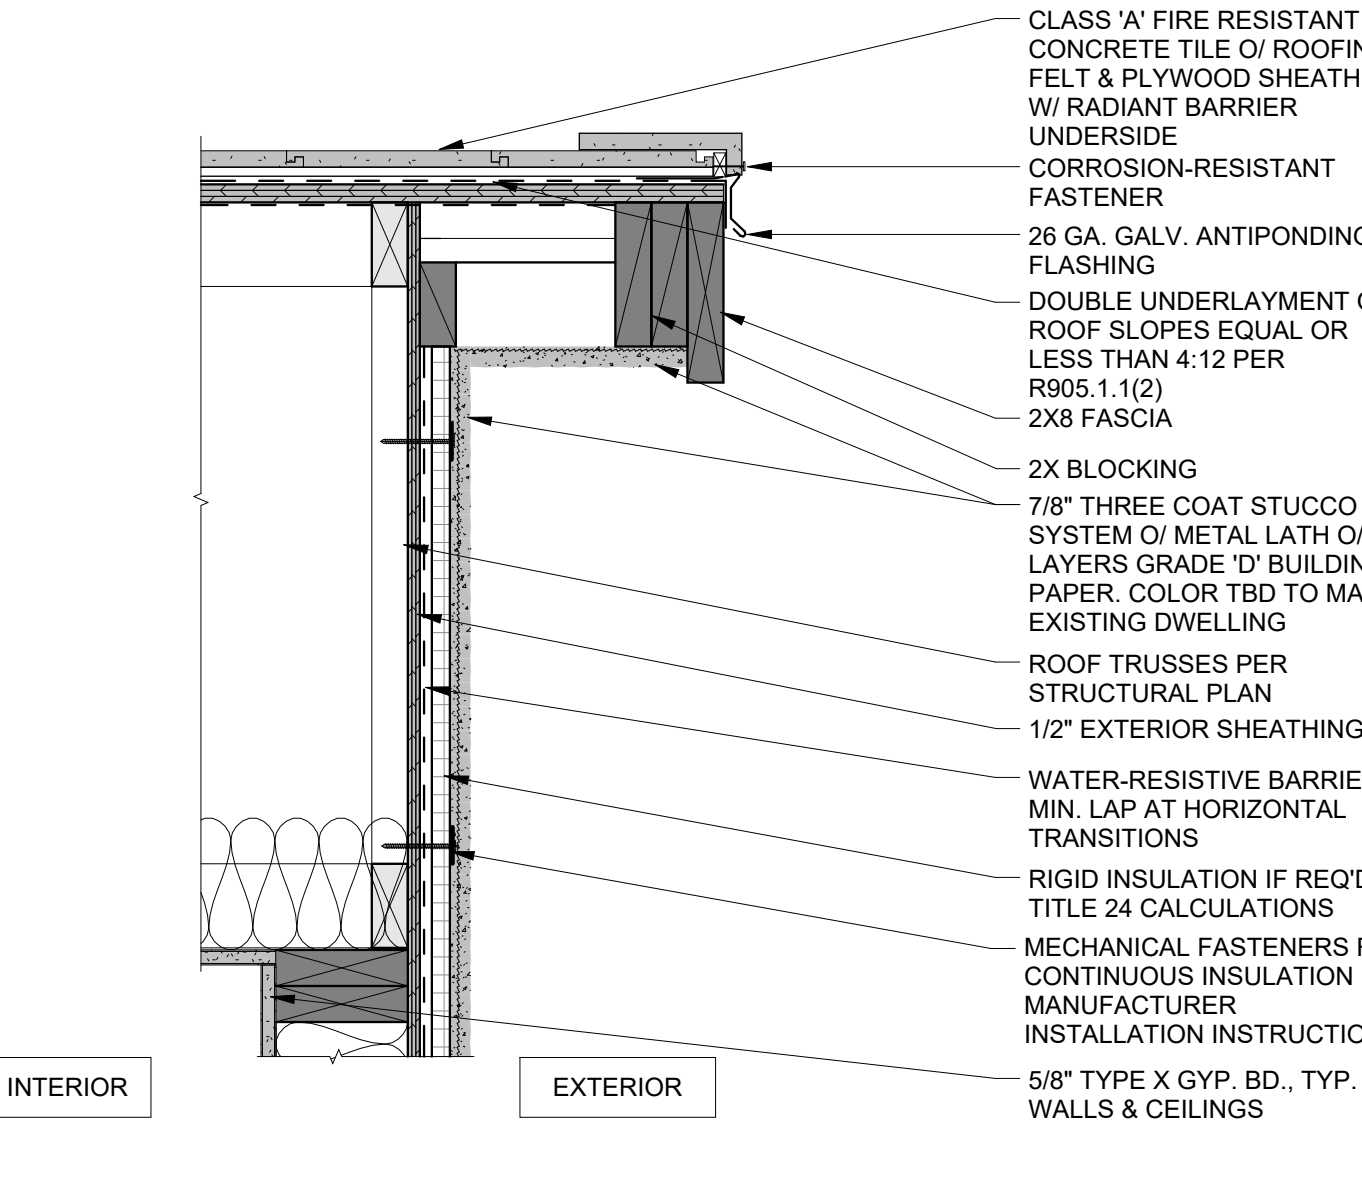


5 A2 - ROOF RAKE - CEMENT PROTECTED
W/ CONT. INSULATION AND STUCCO

SCALE: 1 1/2" = 1'-0"

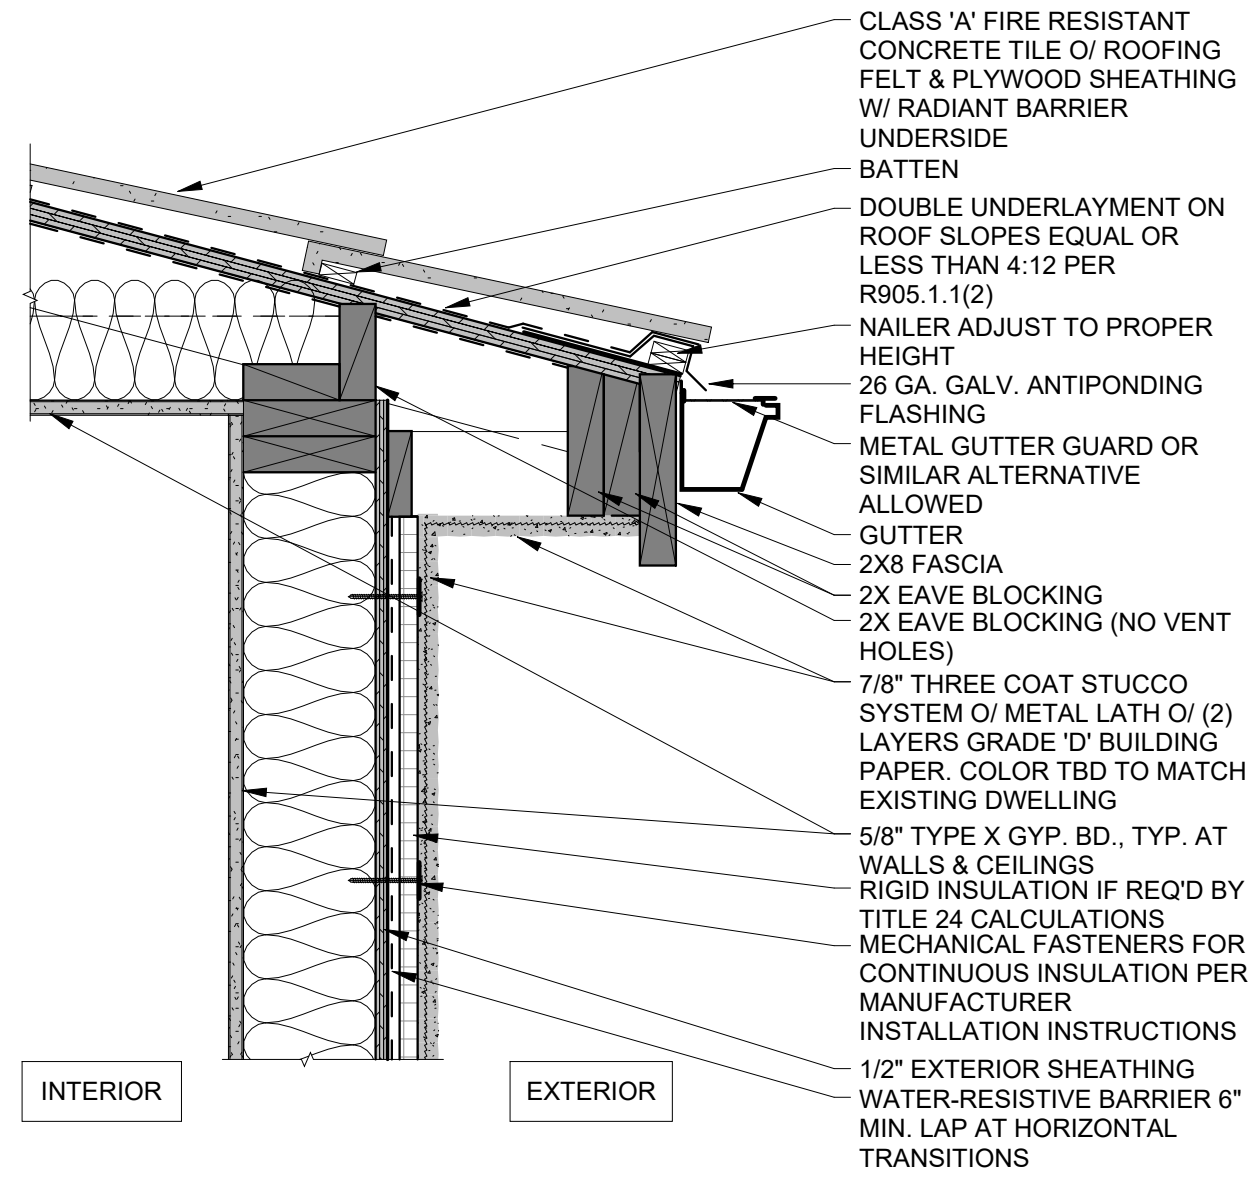


2 A2 - ROOF EAVE - CEMENT PROTECTED
W/ CONT. INSULATION AND STUCCO

SCALE: 1 1/2" = 1'-0"

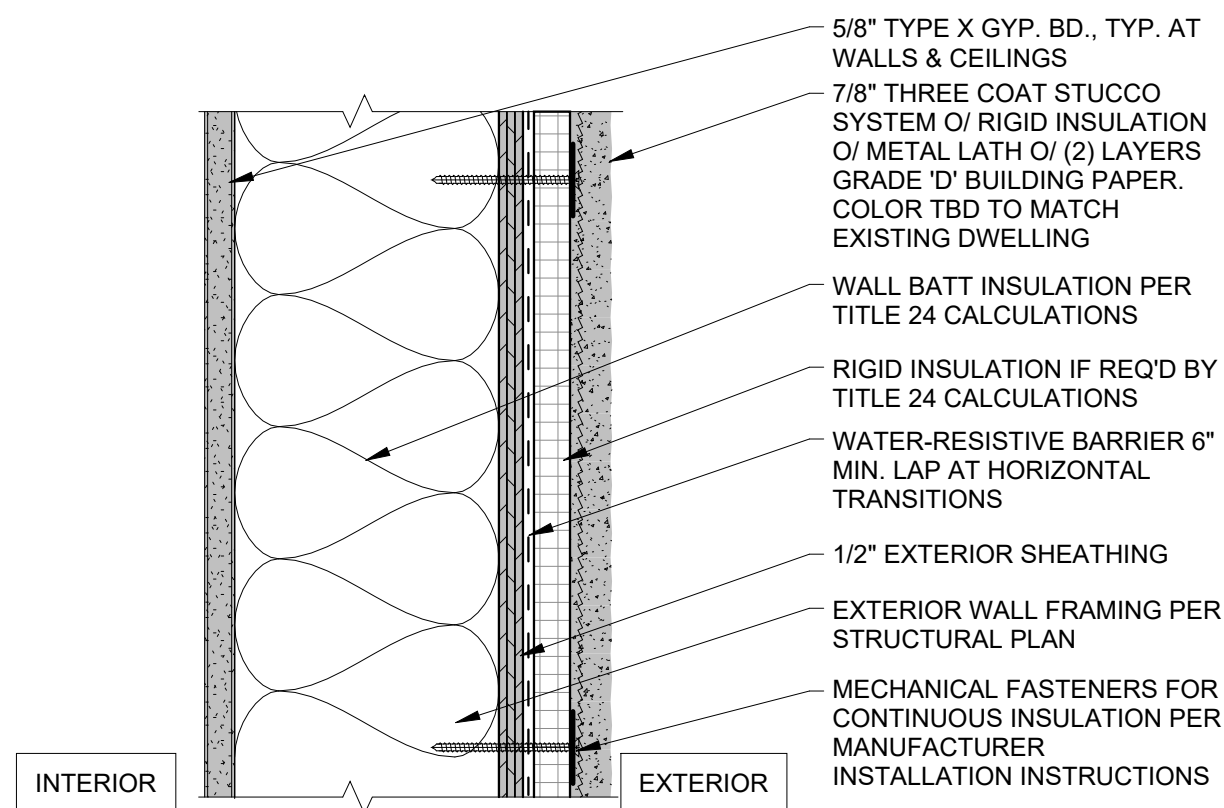


12 A - WALL - EXTERIOR 1-HOUR RATED - STUCCO
W/ CONT. INSULATION

SCALE: 3" = 1'-0"

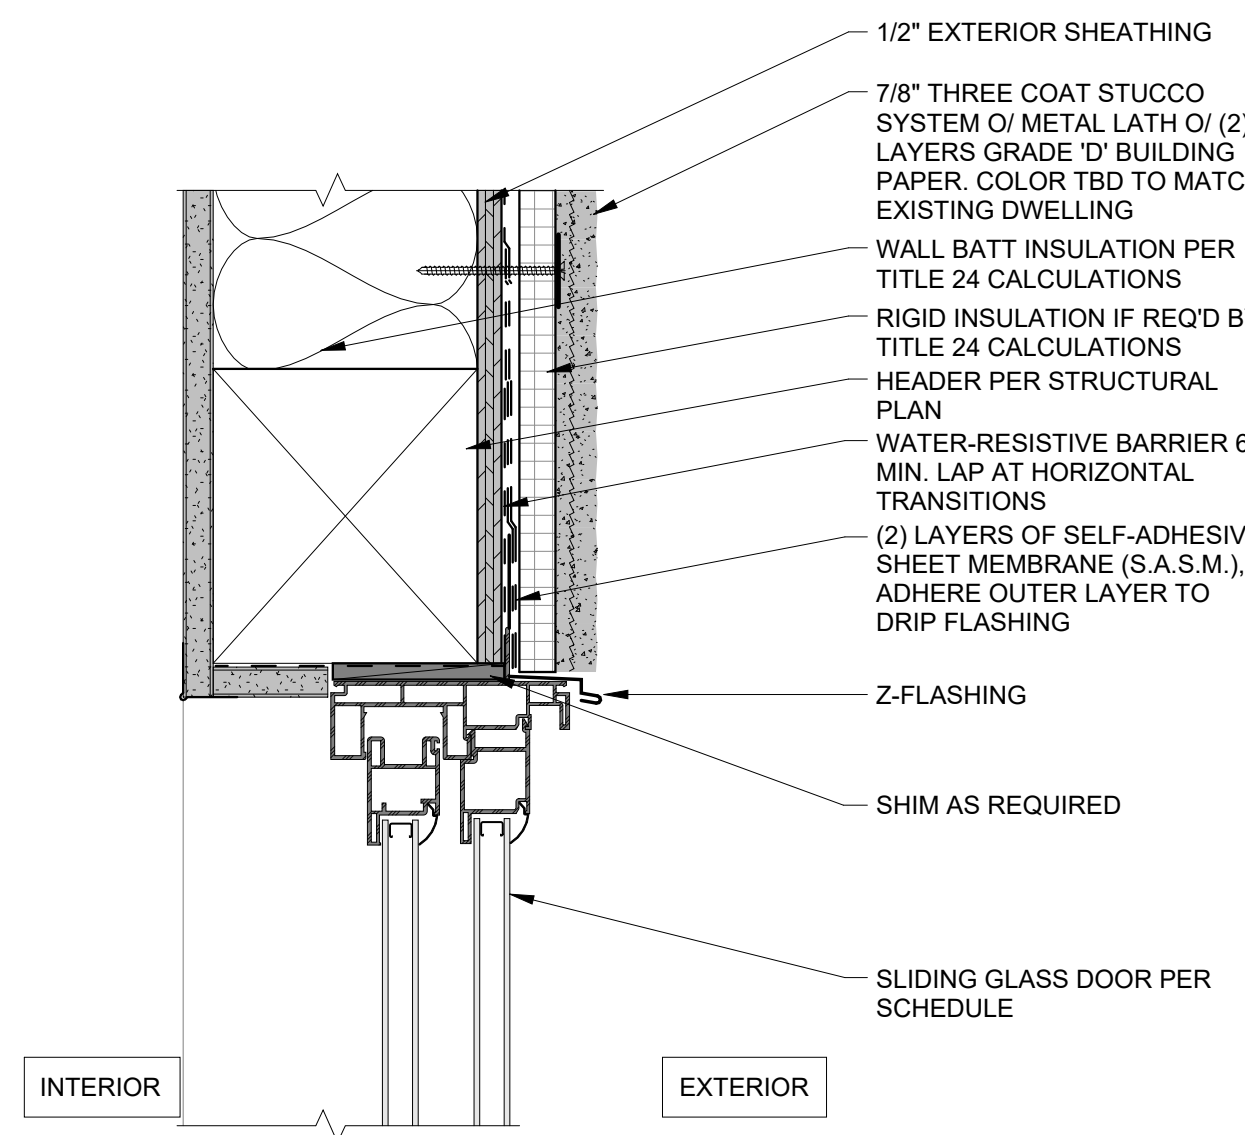


9 DOOR - SLIDING GLASS DOOR HEAD @ STUCCO
W/ CONT. INSULATION (JAMB SIM.)

SCALE: 3" = 1'-0"

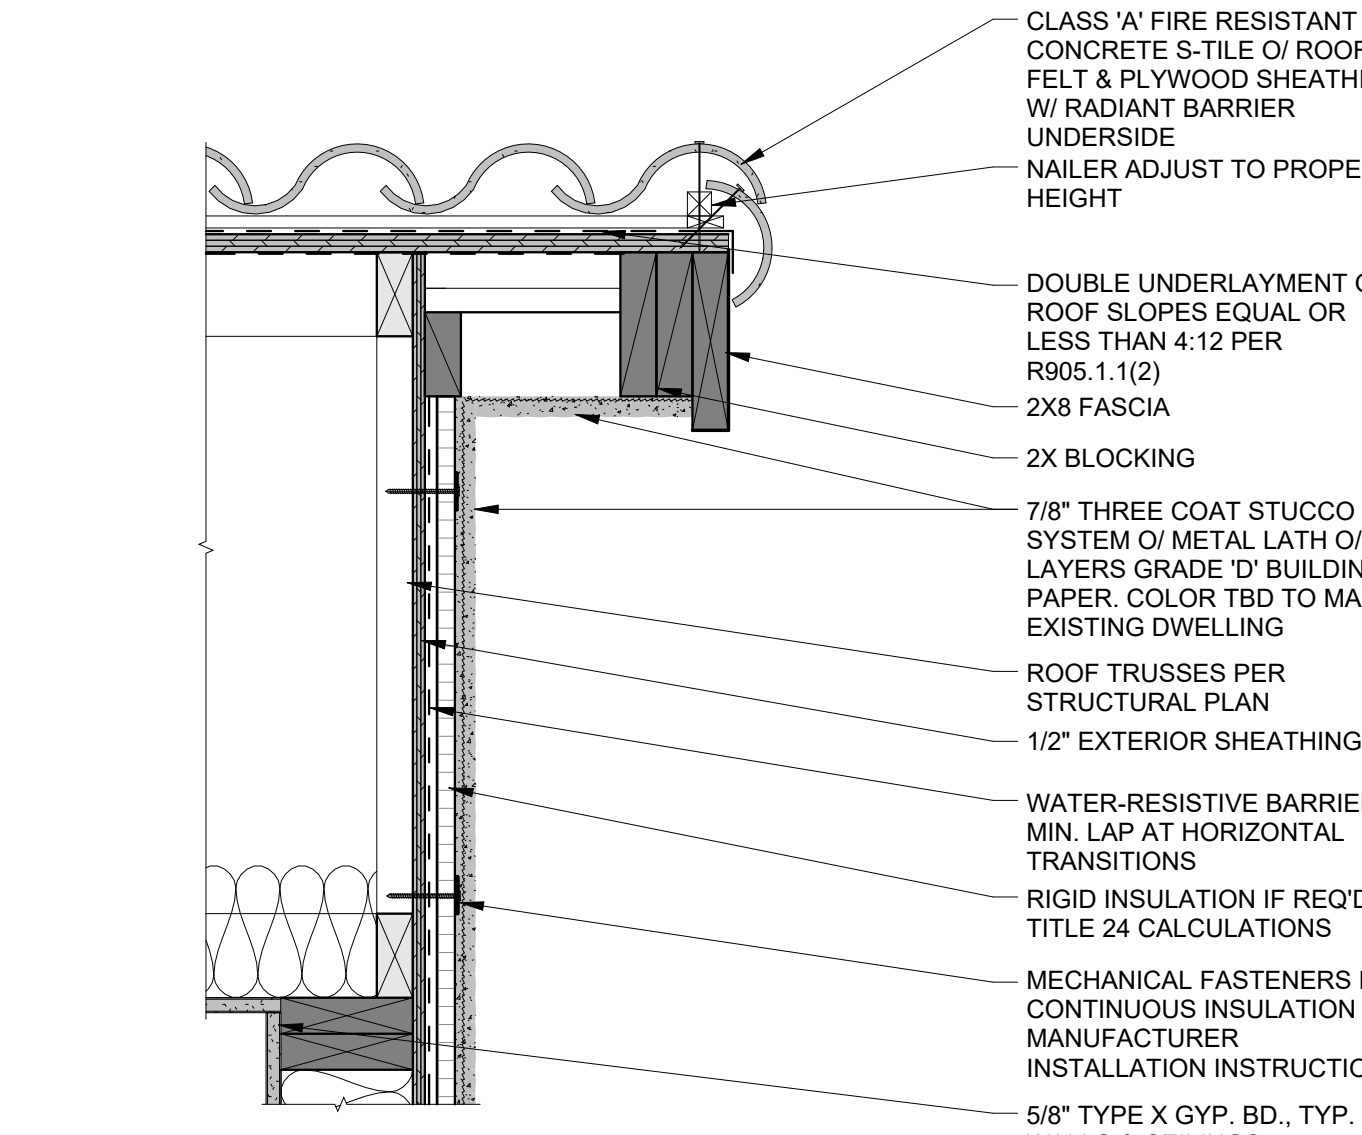

6 A3 - ROOF RAKE - S-TILE PROTECTED
W/ CONT. INSULATION AND STUCCO

SCALE: 1 1/2" = 1'-0"

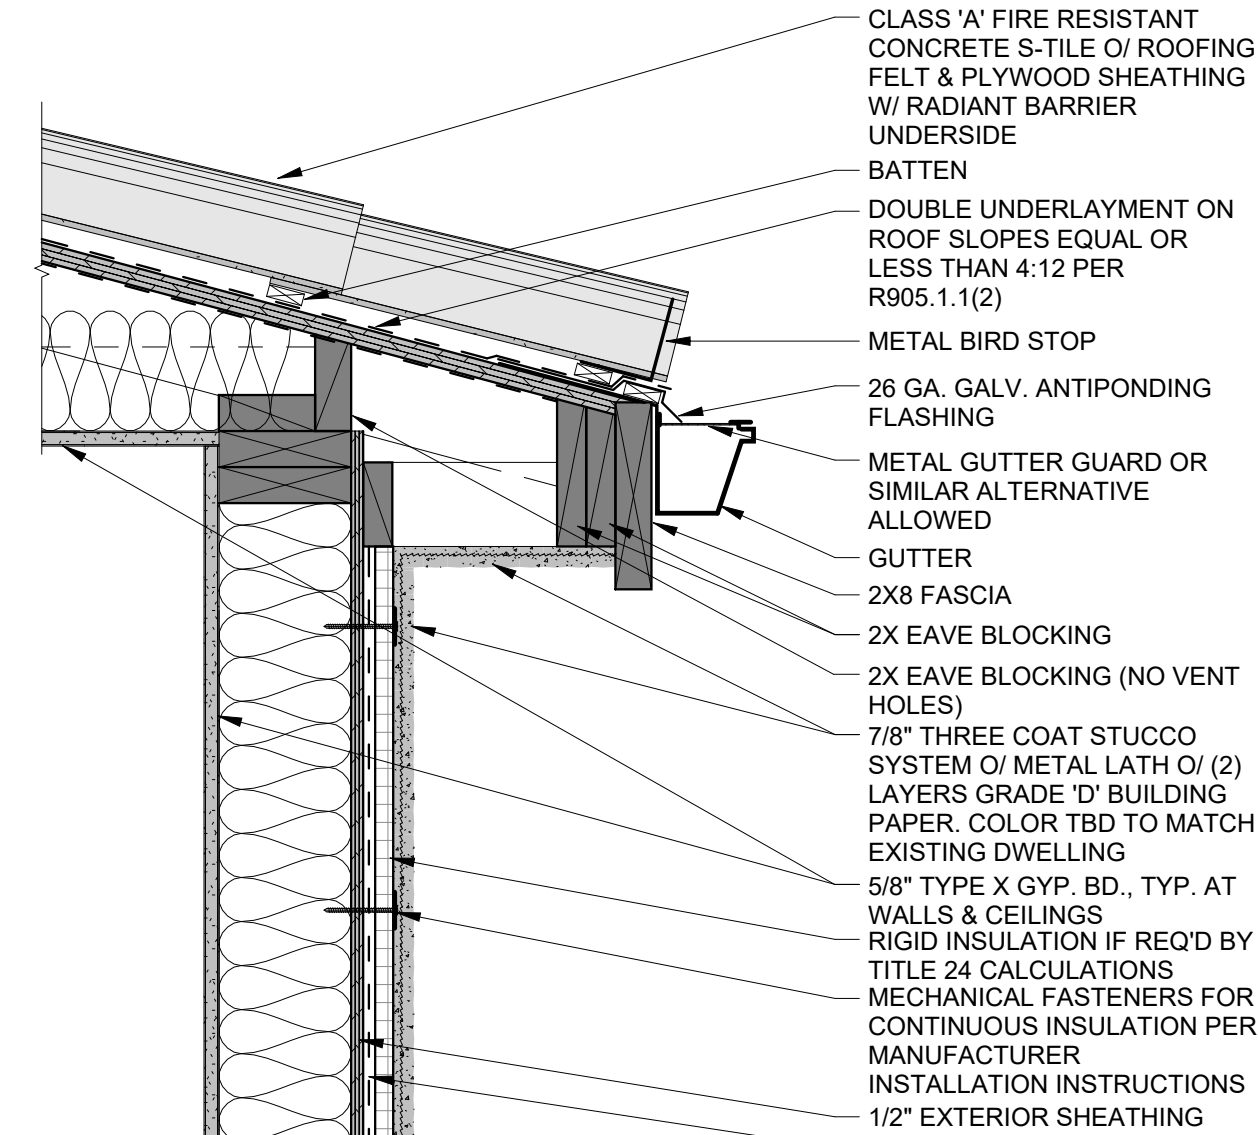

3 A3 - ROOF EAVE - S-TILE PROTECTED
W/ CONT. INSULATION AND STUCCO

SCALE: 1 1/2" = 1'-0"



SNAPADU
DESIGN HOUSE

YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 498 SQUARE

CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:

LUIS CALDERON
SnapADU

Luis Calderon
SIGNATURE













RELEASE	DATE	BY	APP.	RELEASED FOR...
	03/22/2024		LAC	

STUCCO DETAILS

A510

22040

Autodesk Docs://22040_City of Chula Vista/22040_City of Chula Vista_498
Square V2_CD_RV722.rvt
3/24/2024 7:23:49 AM

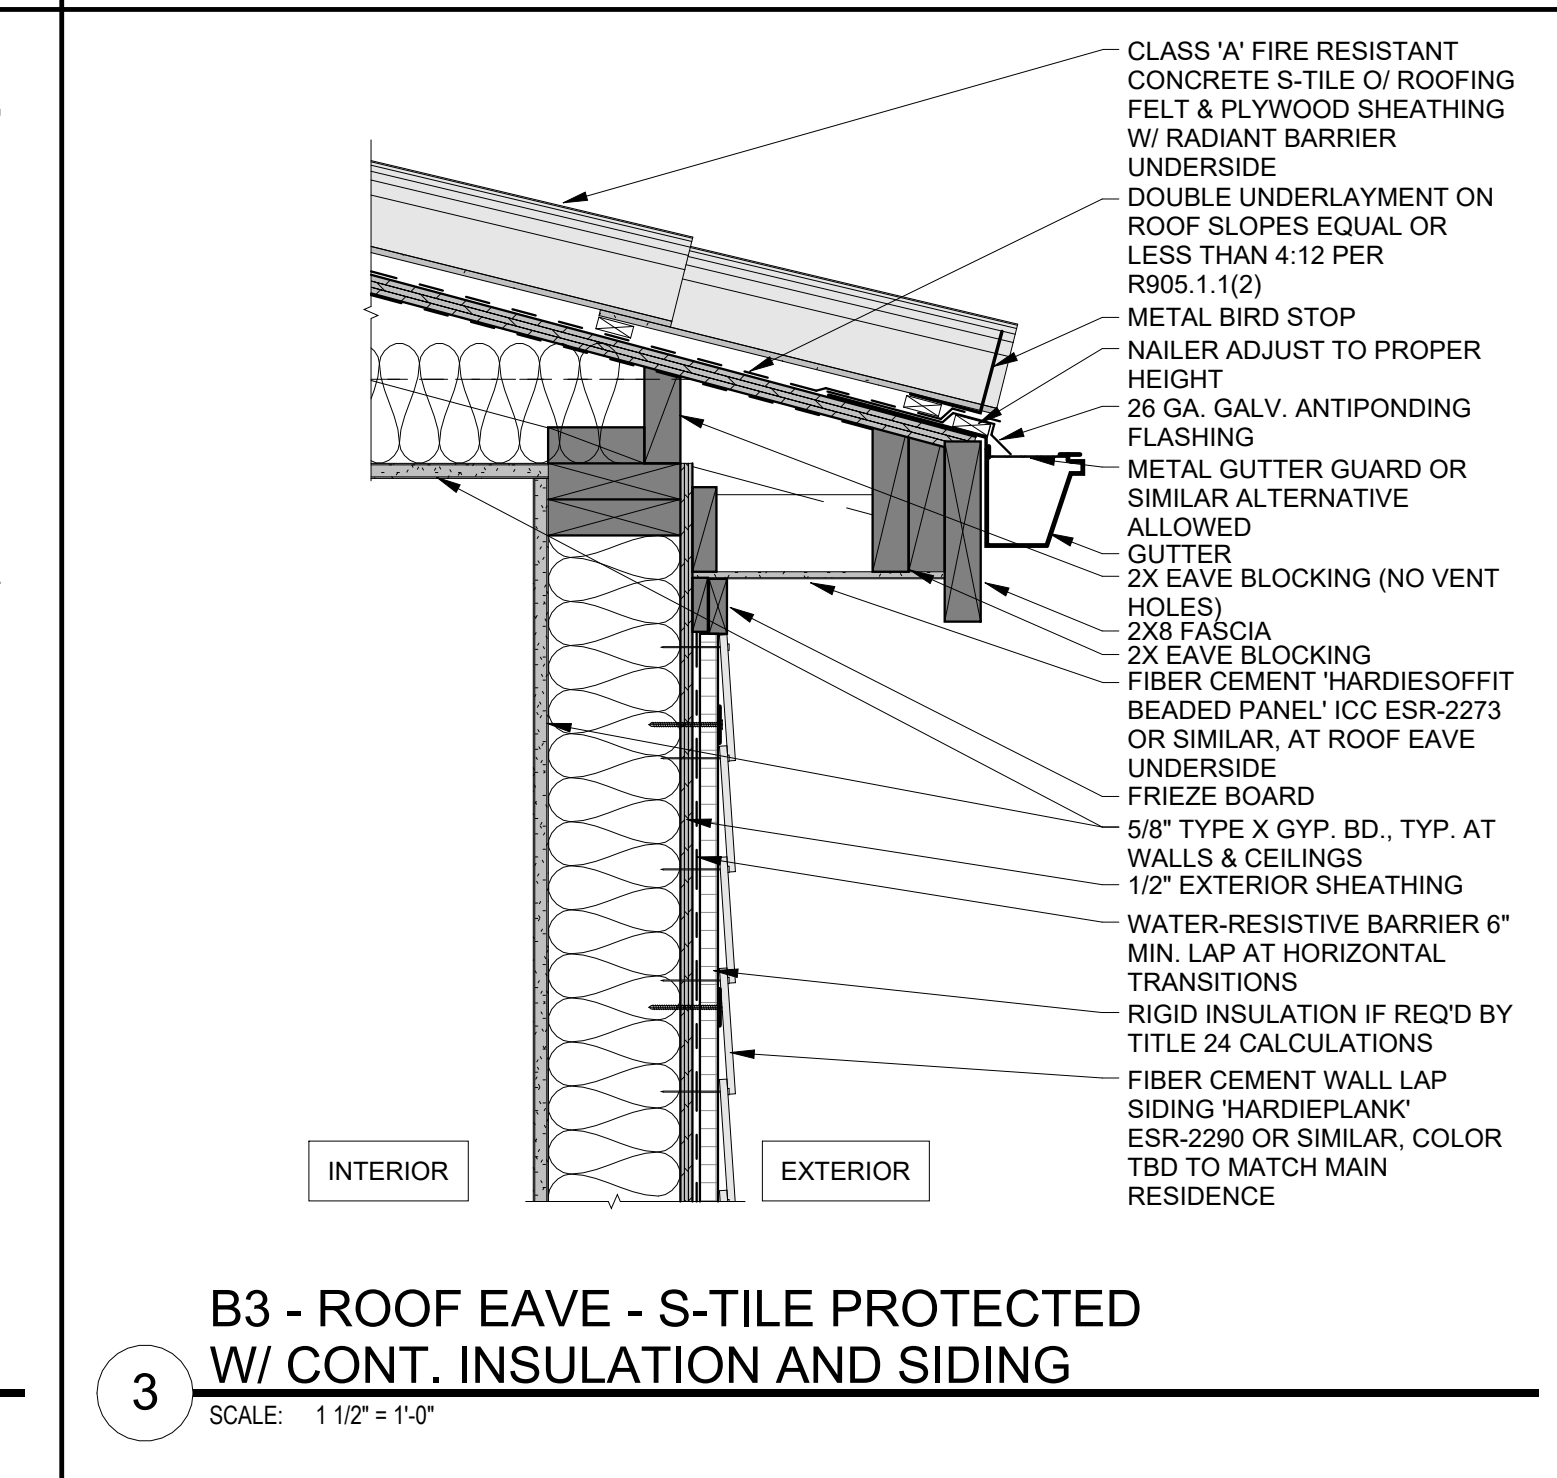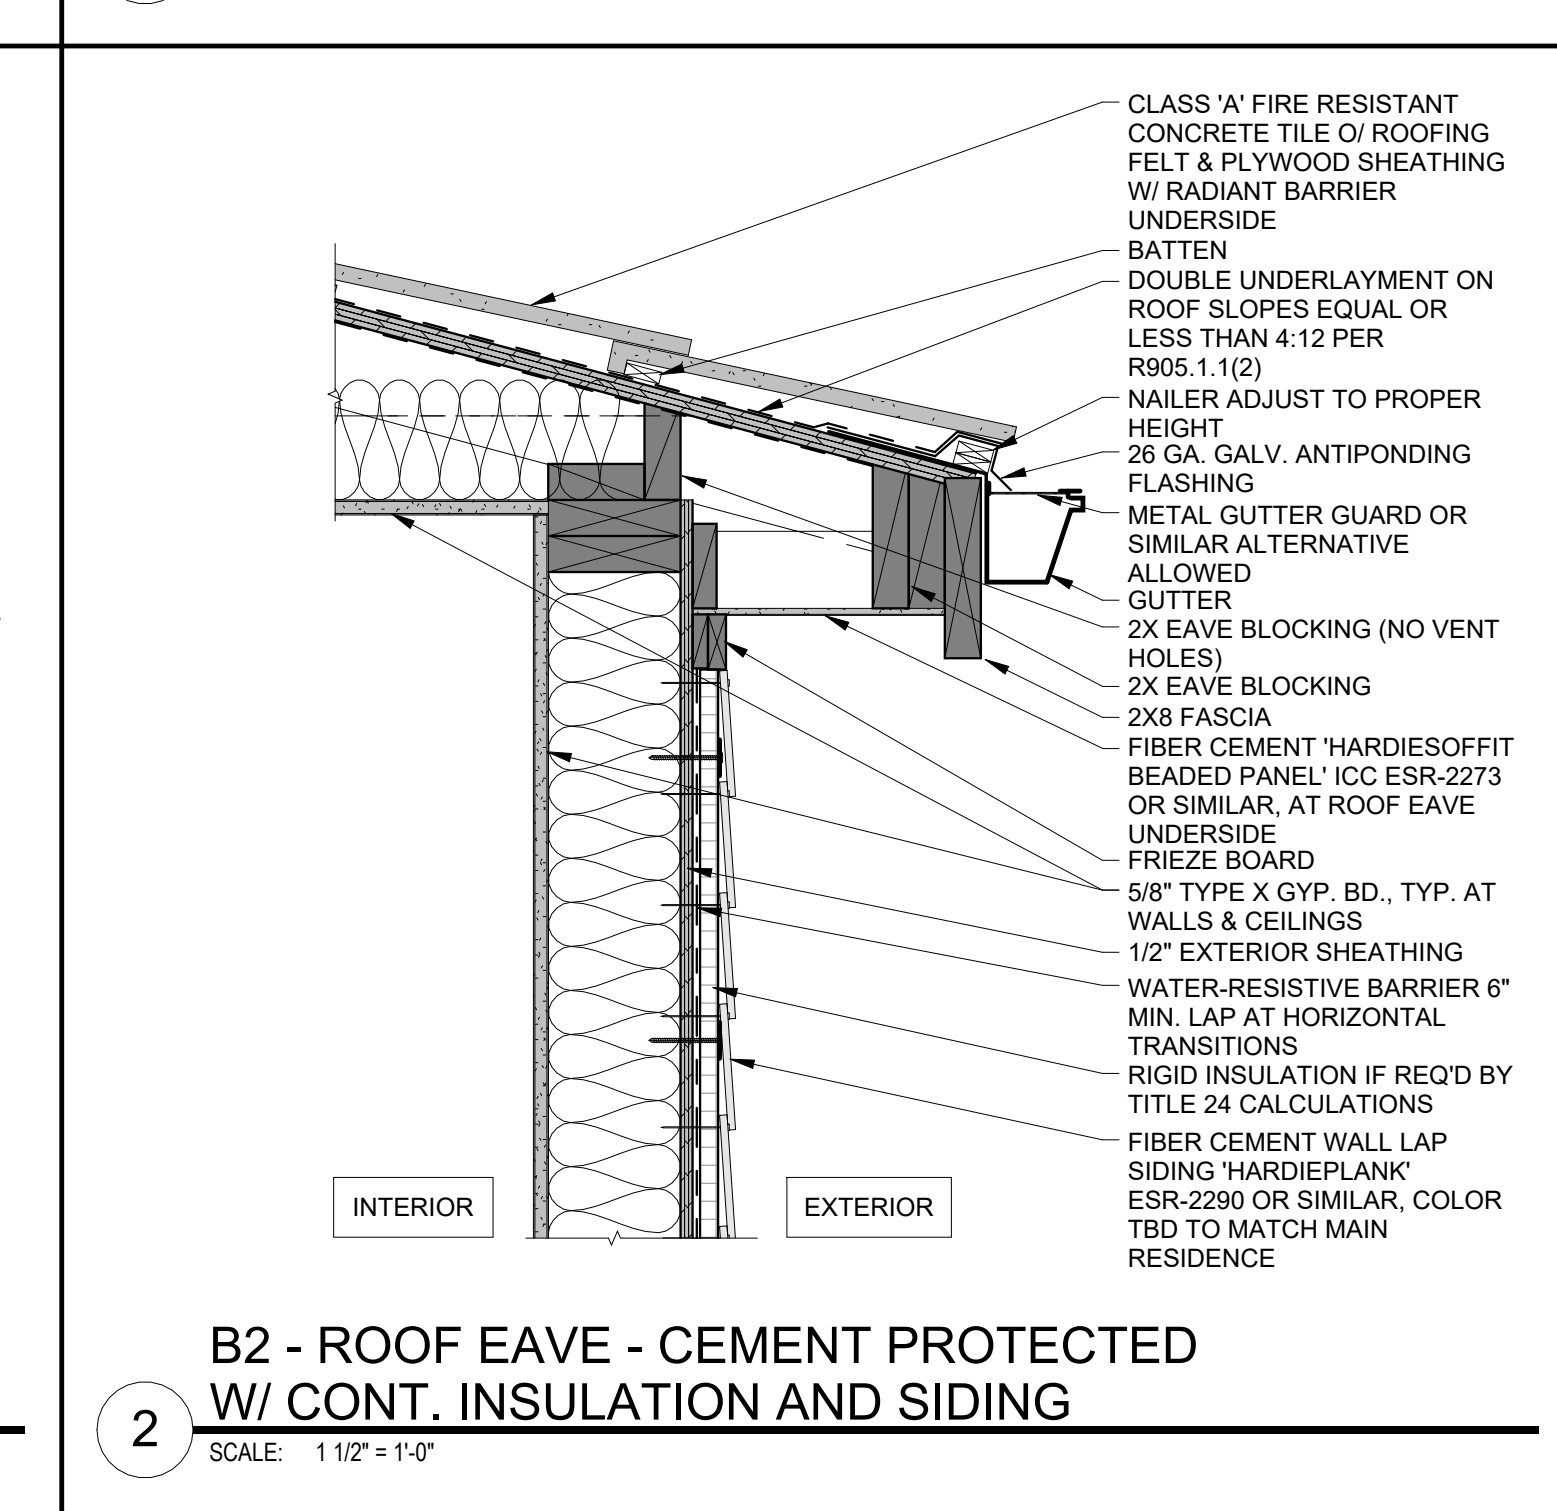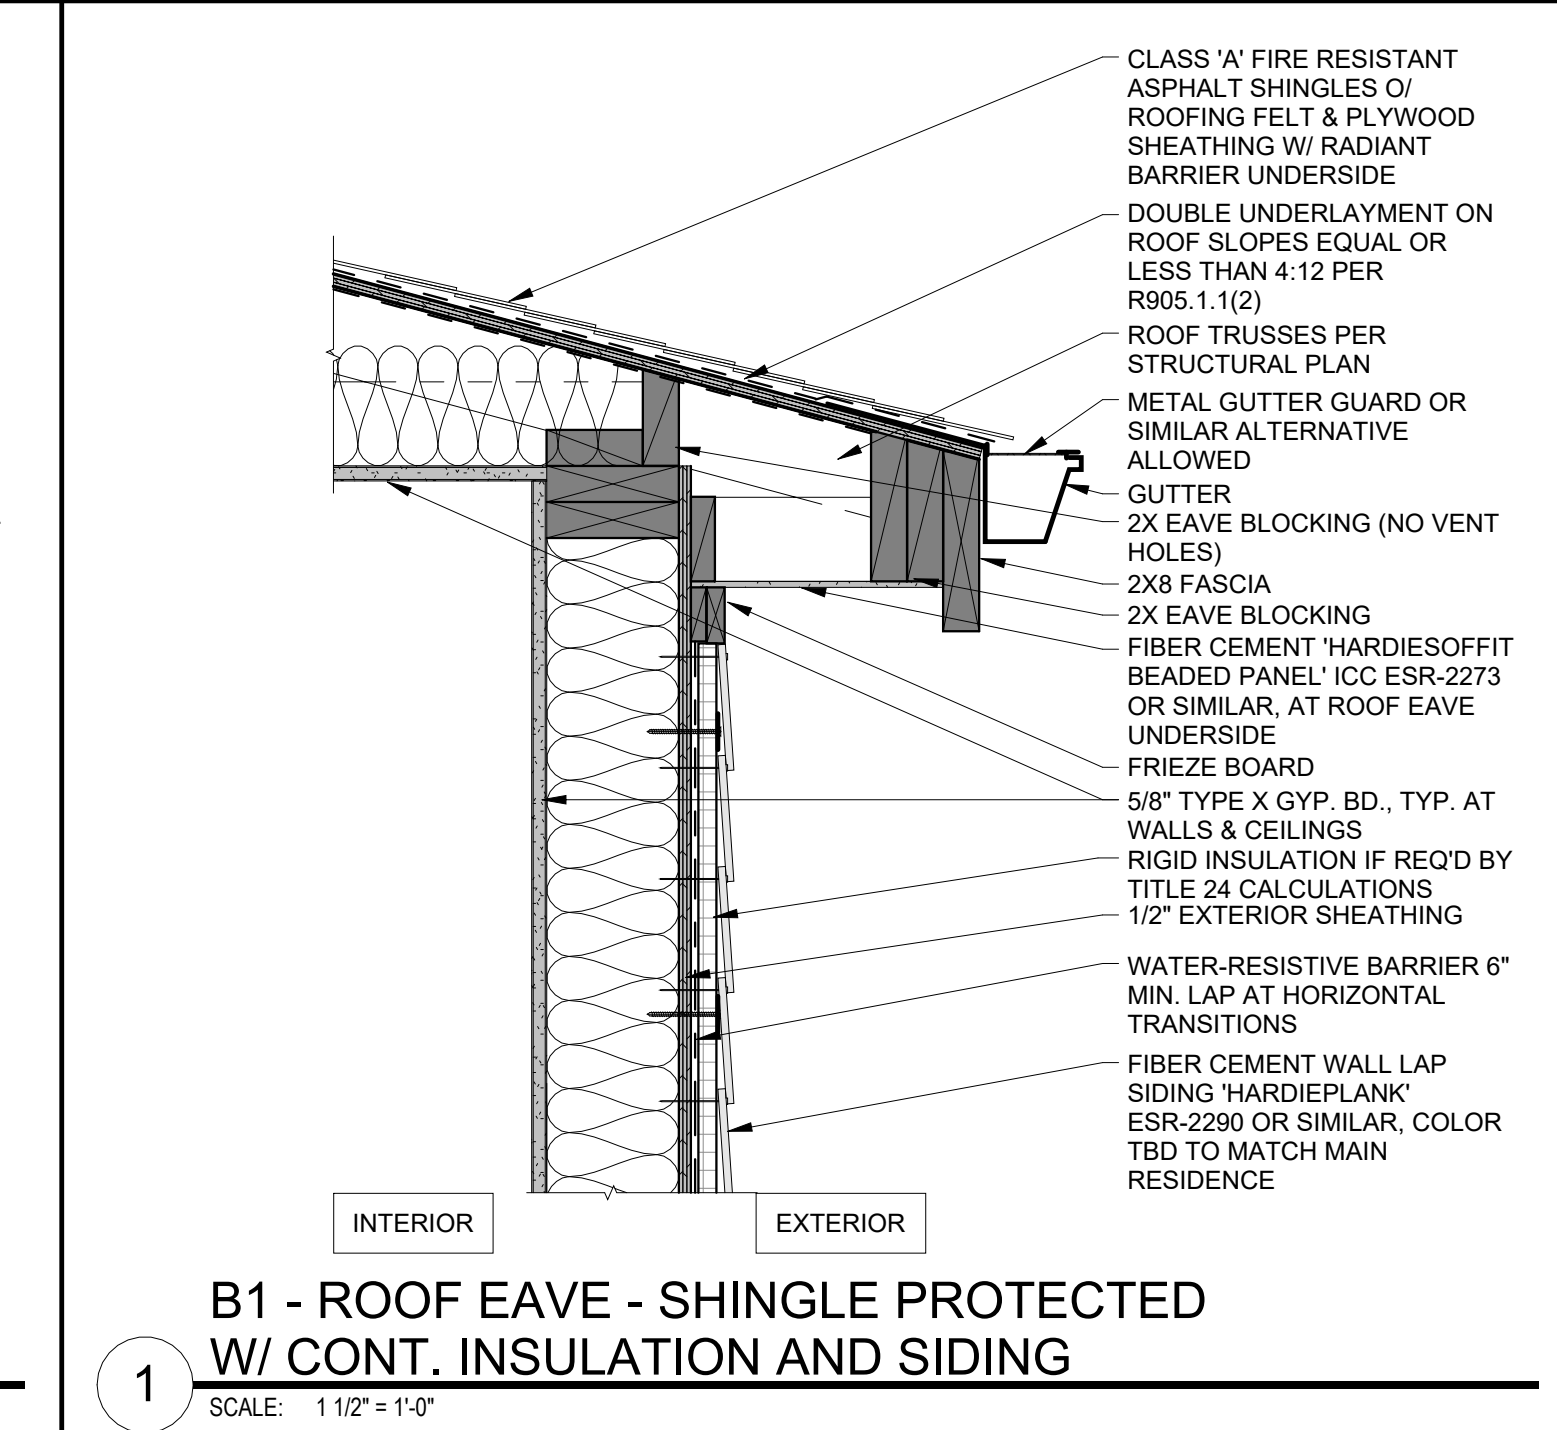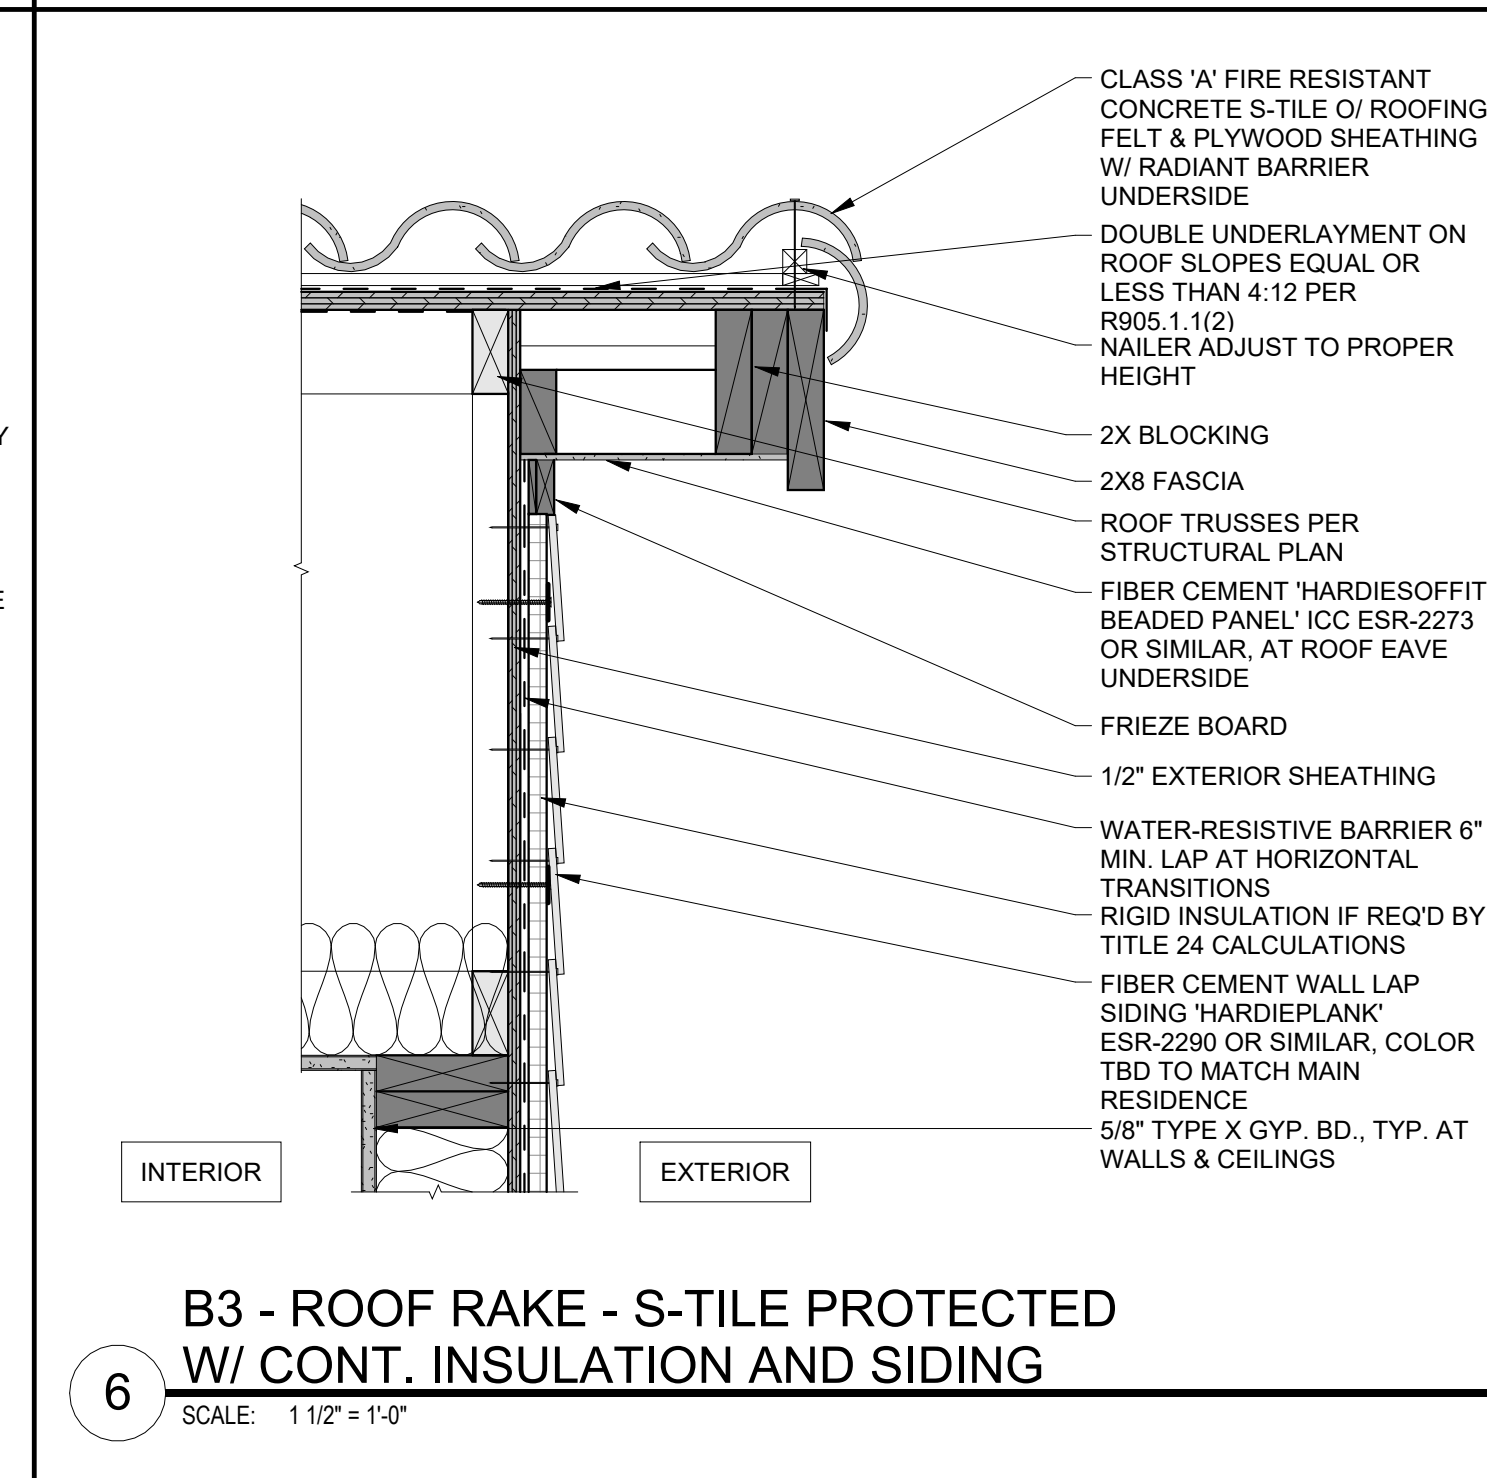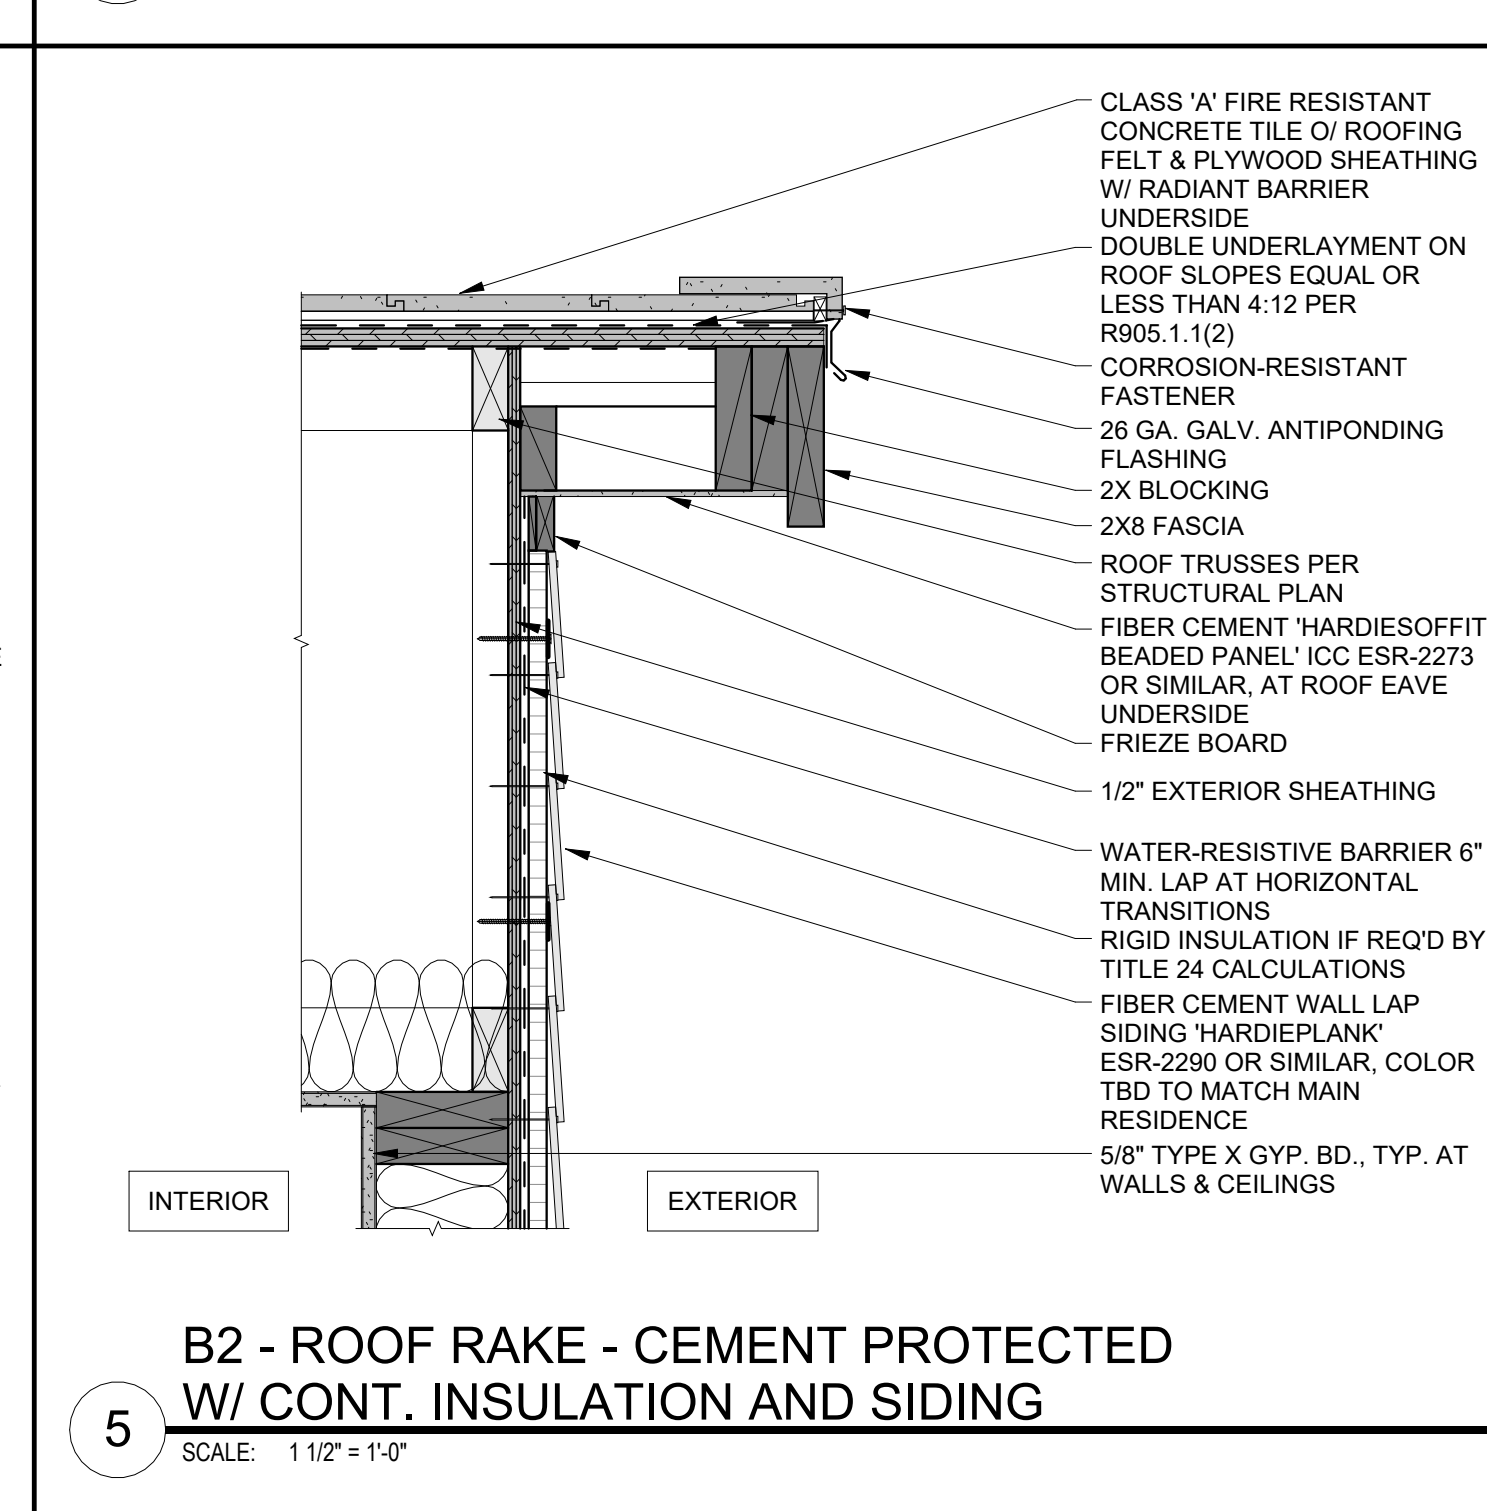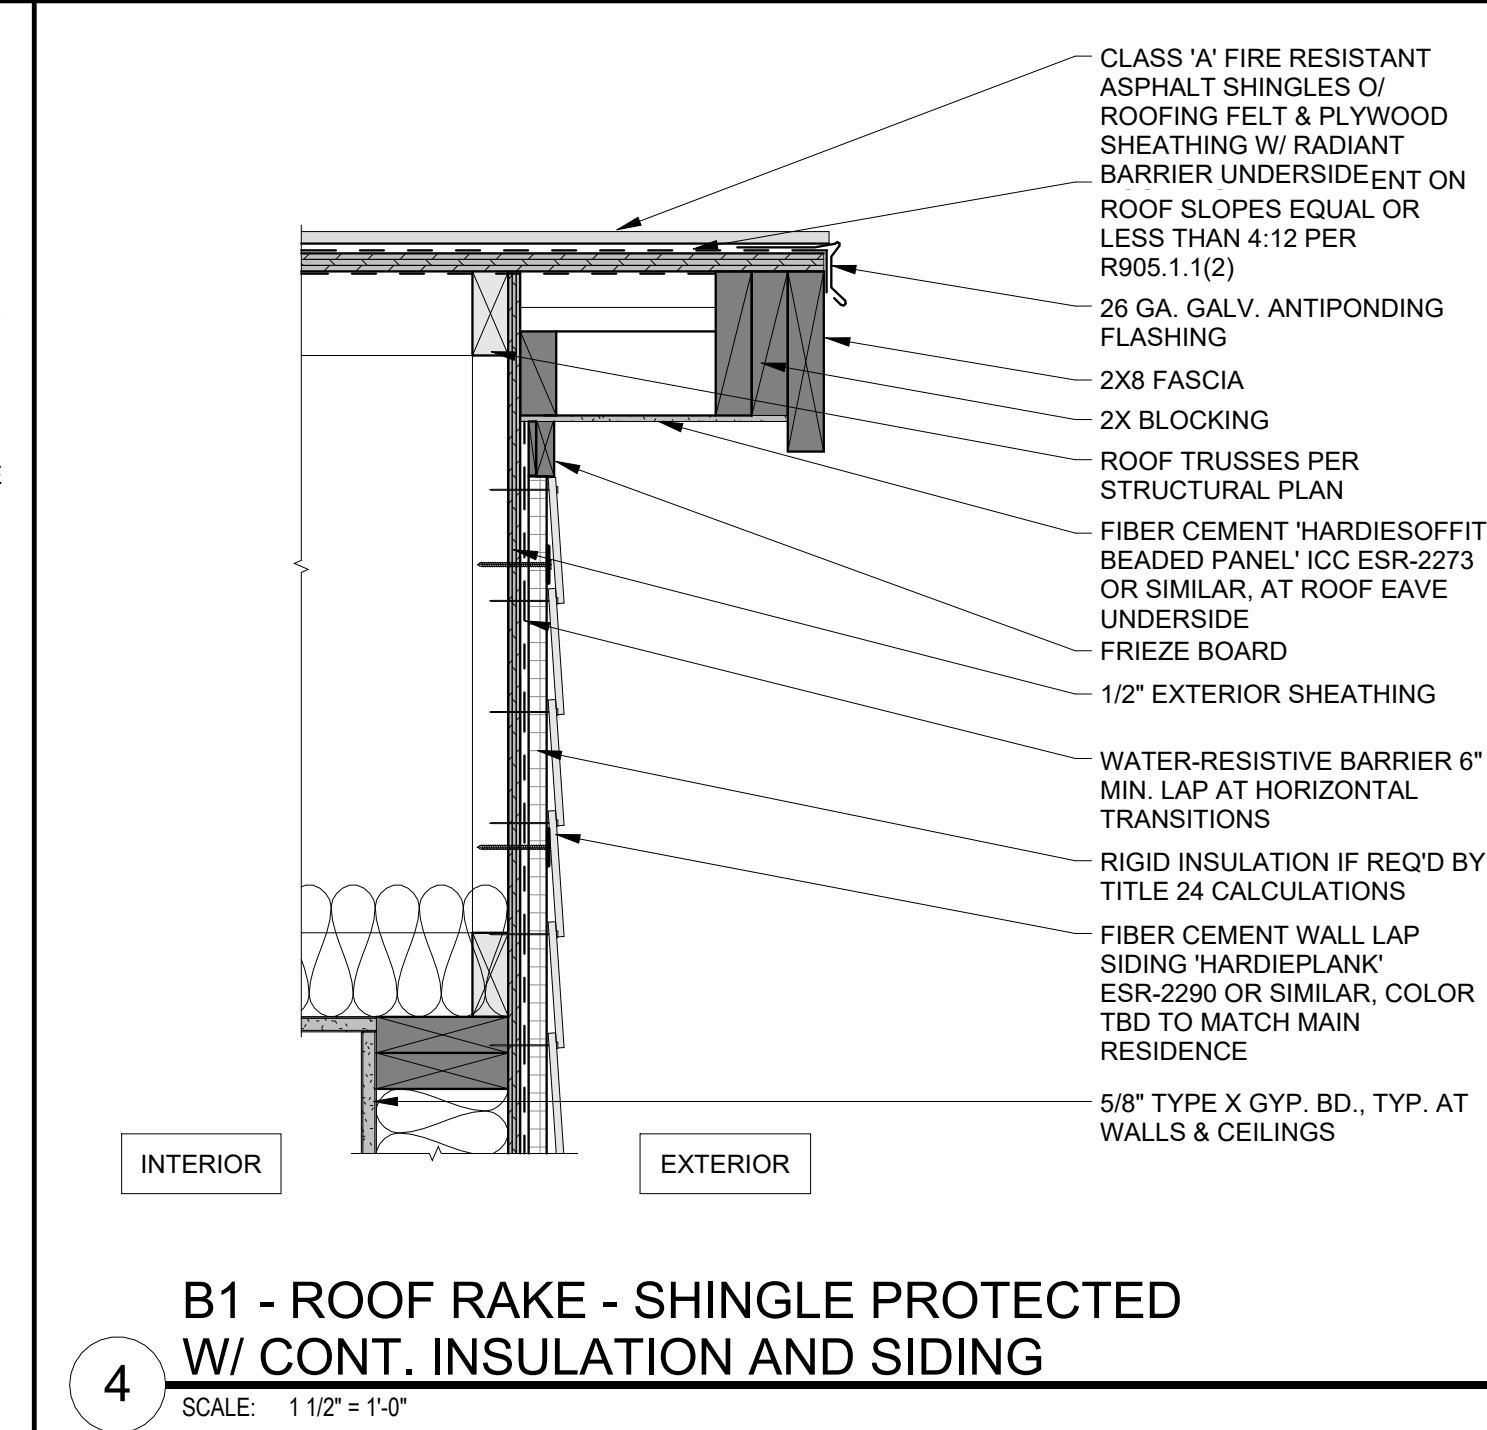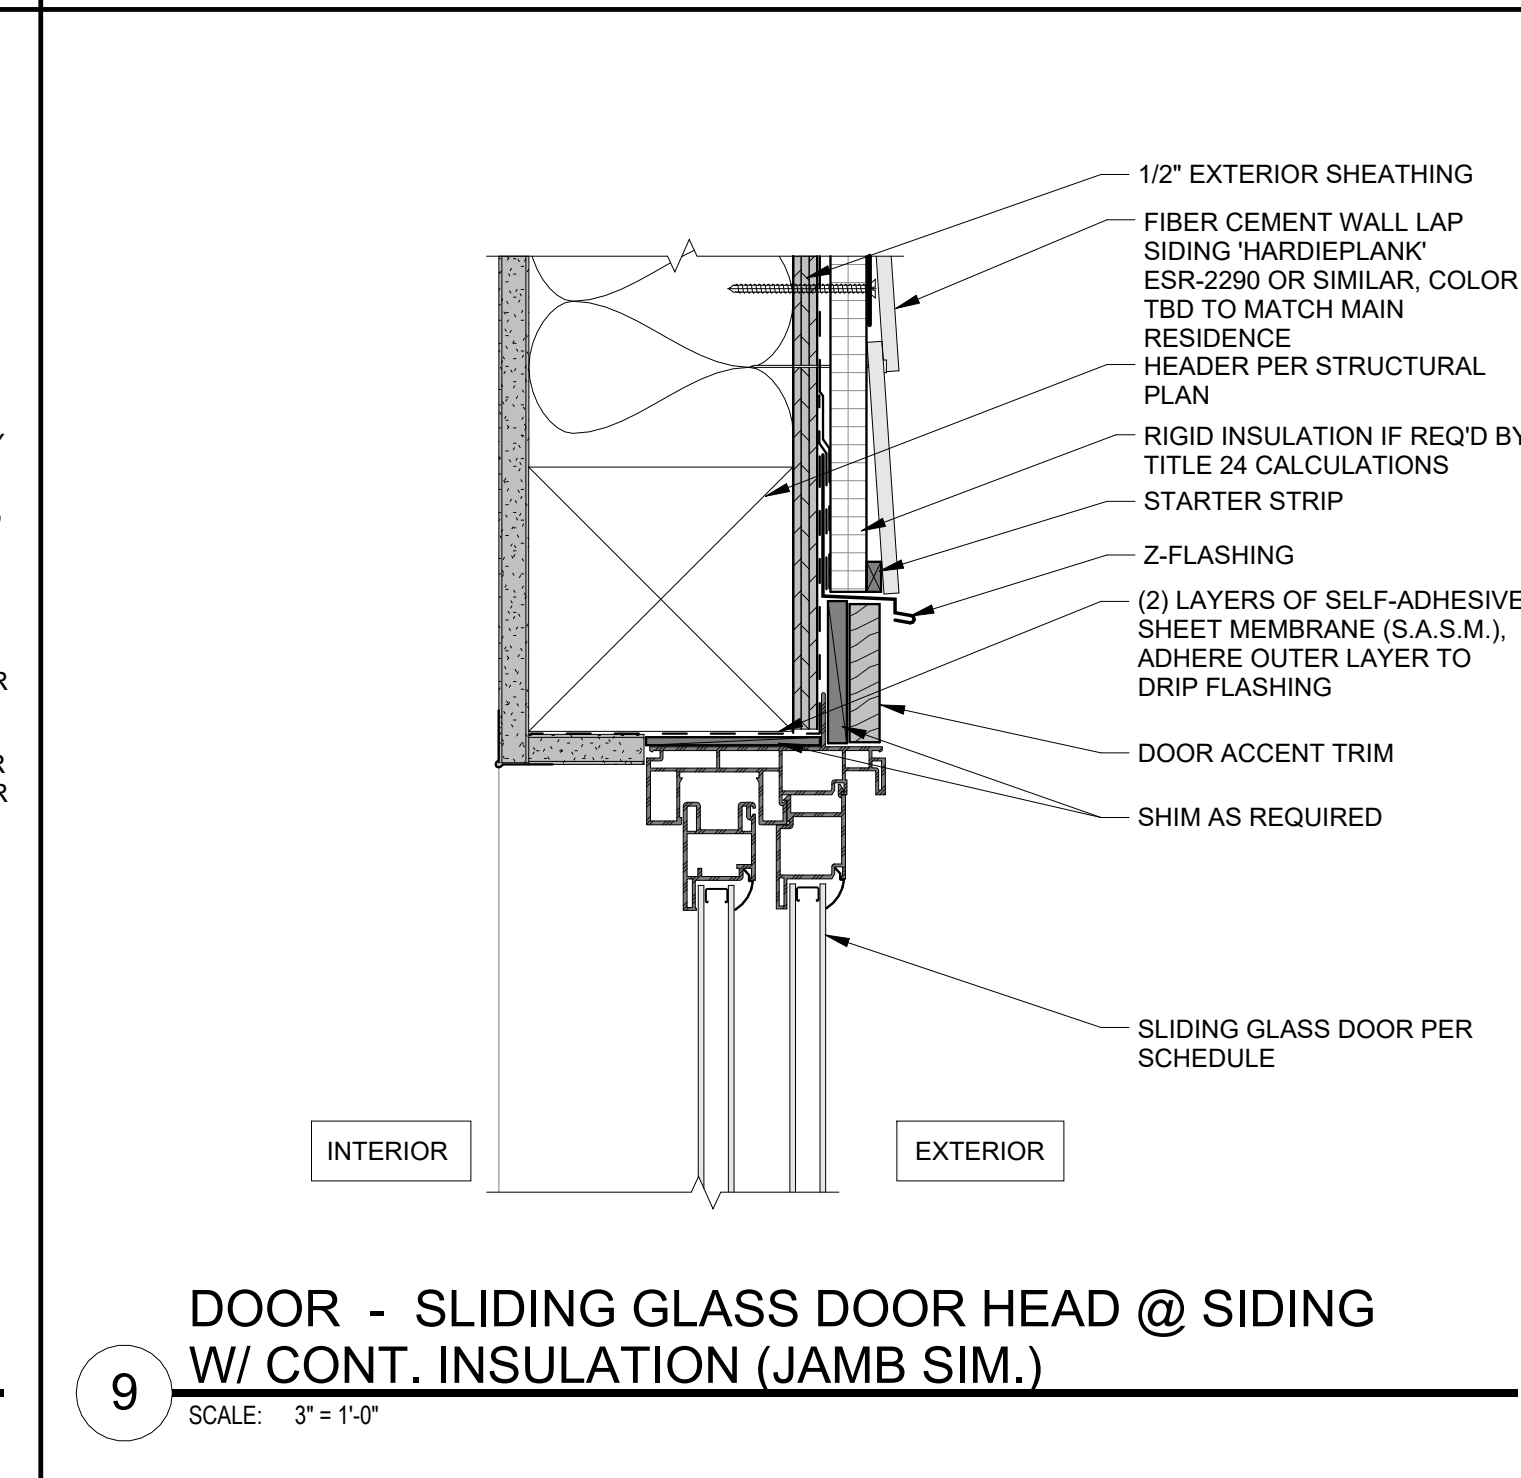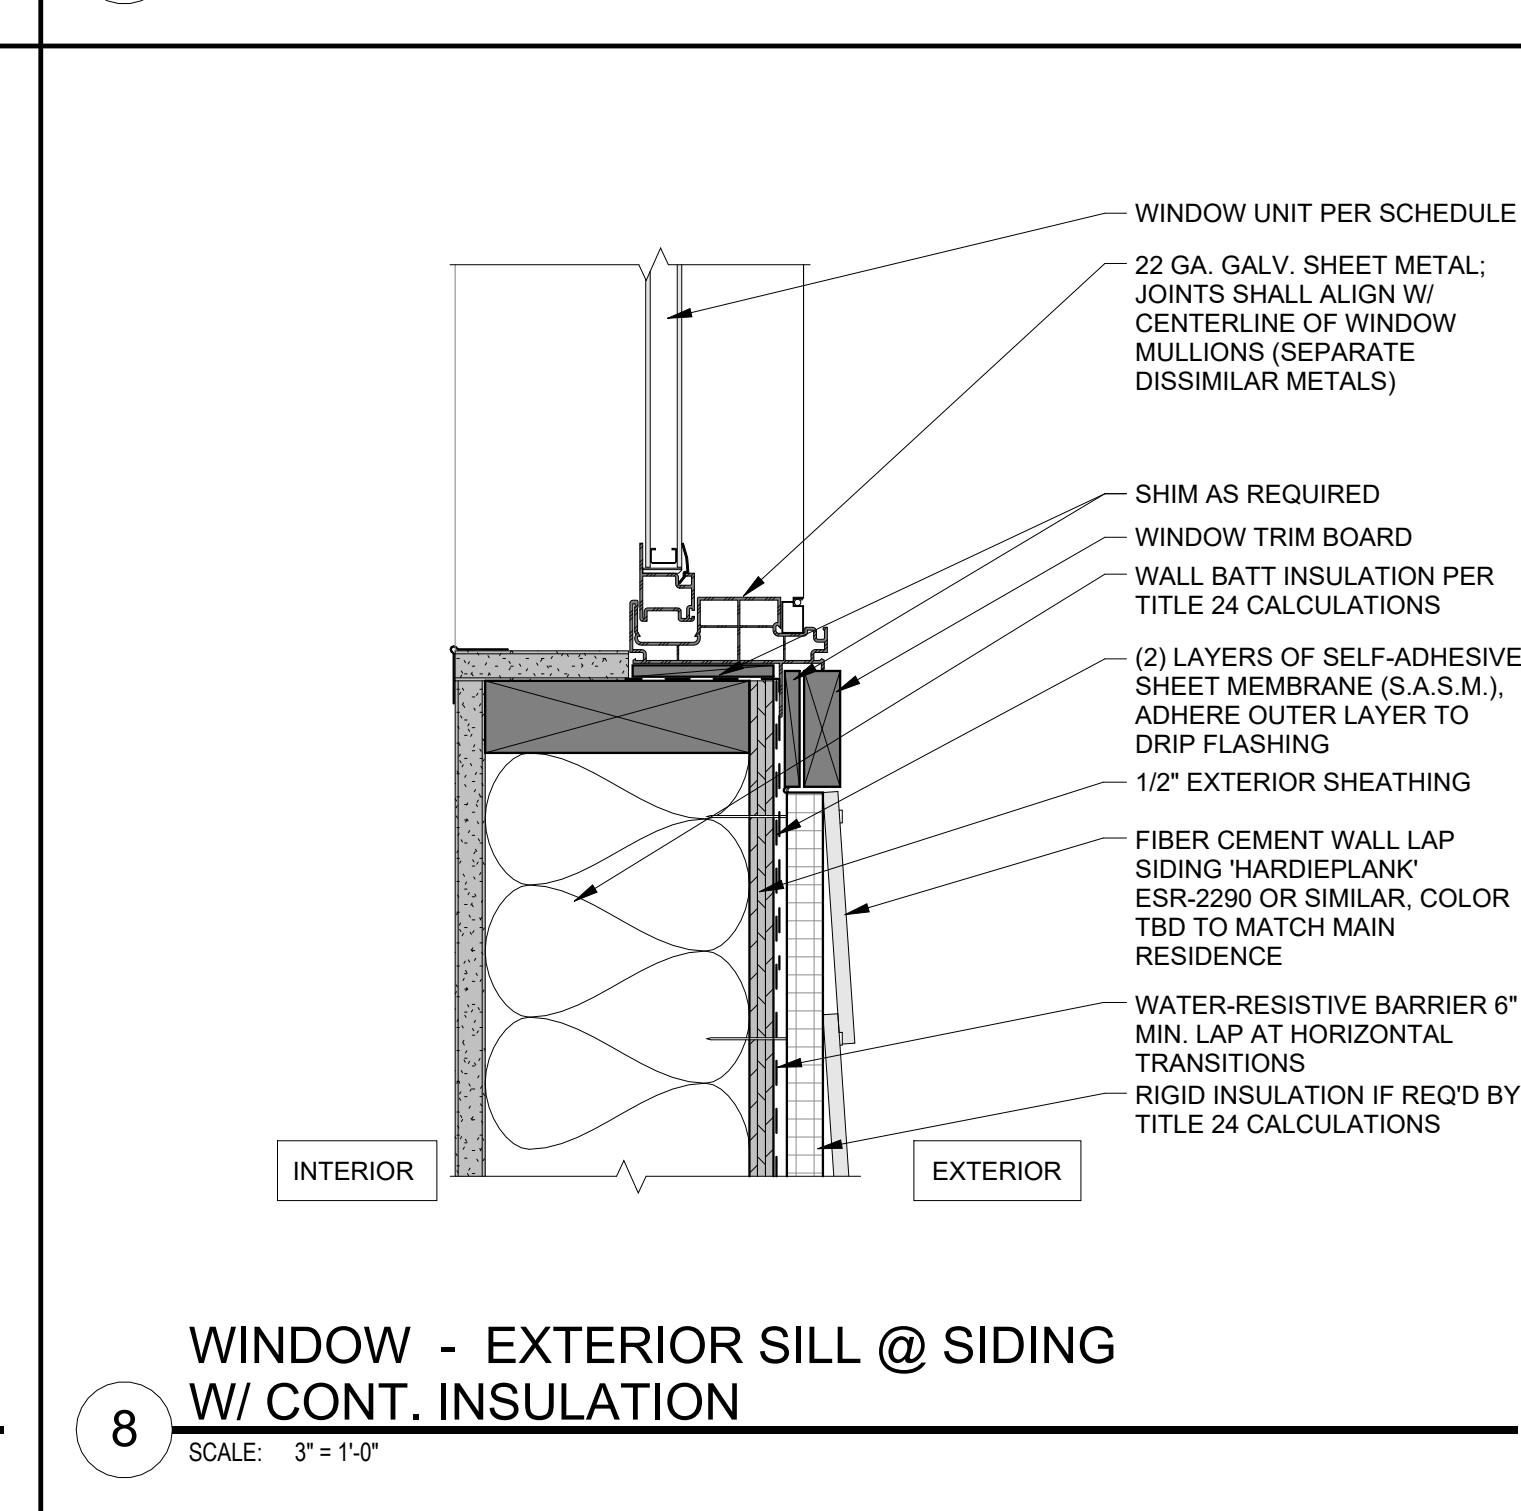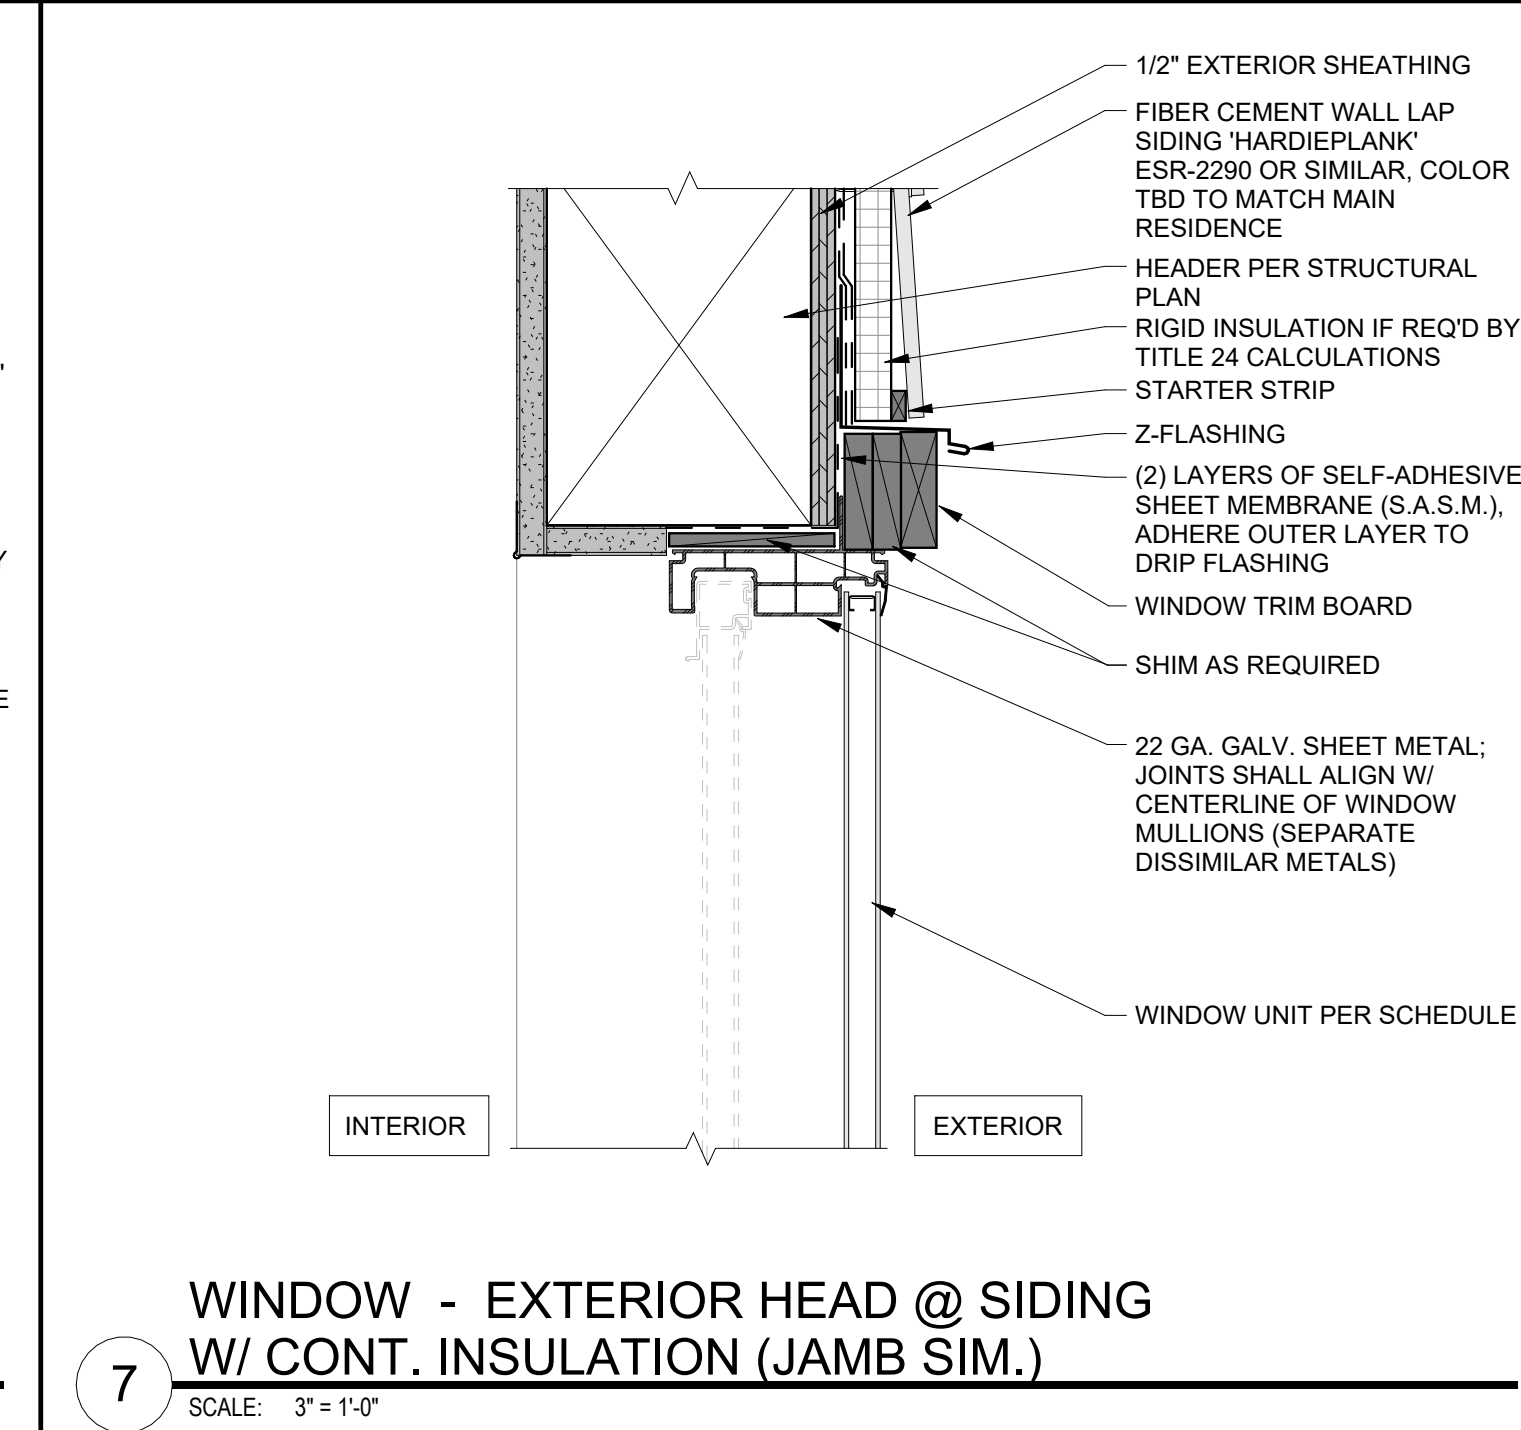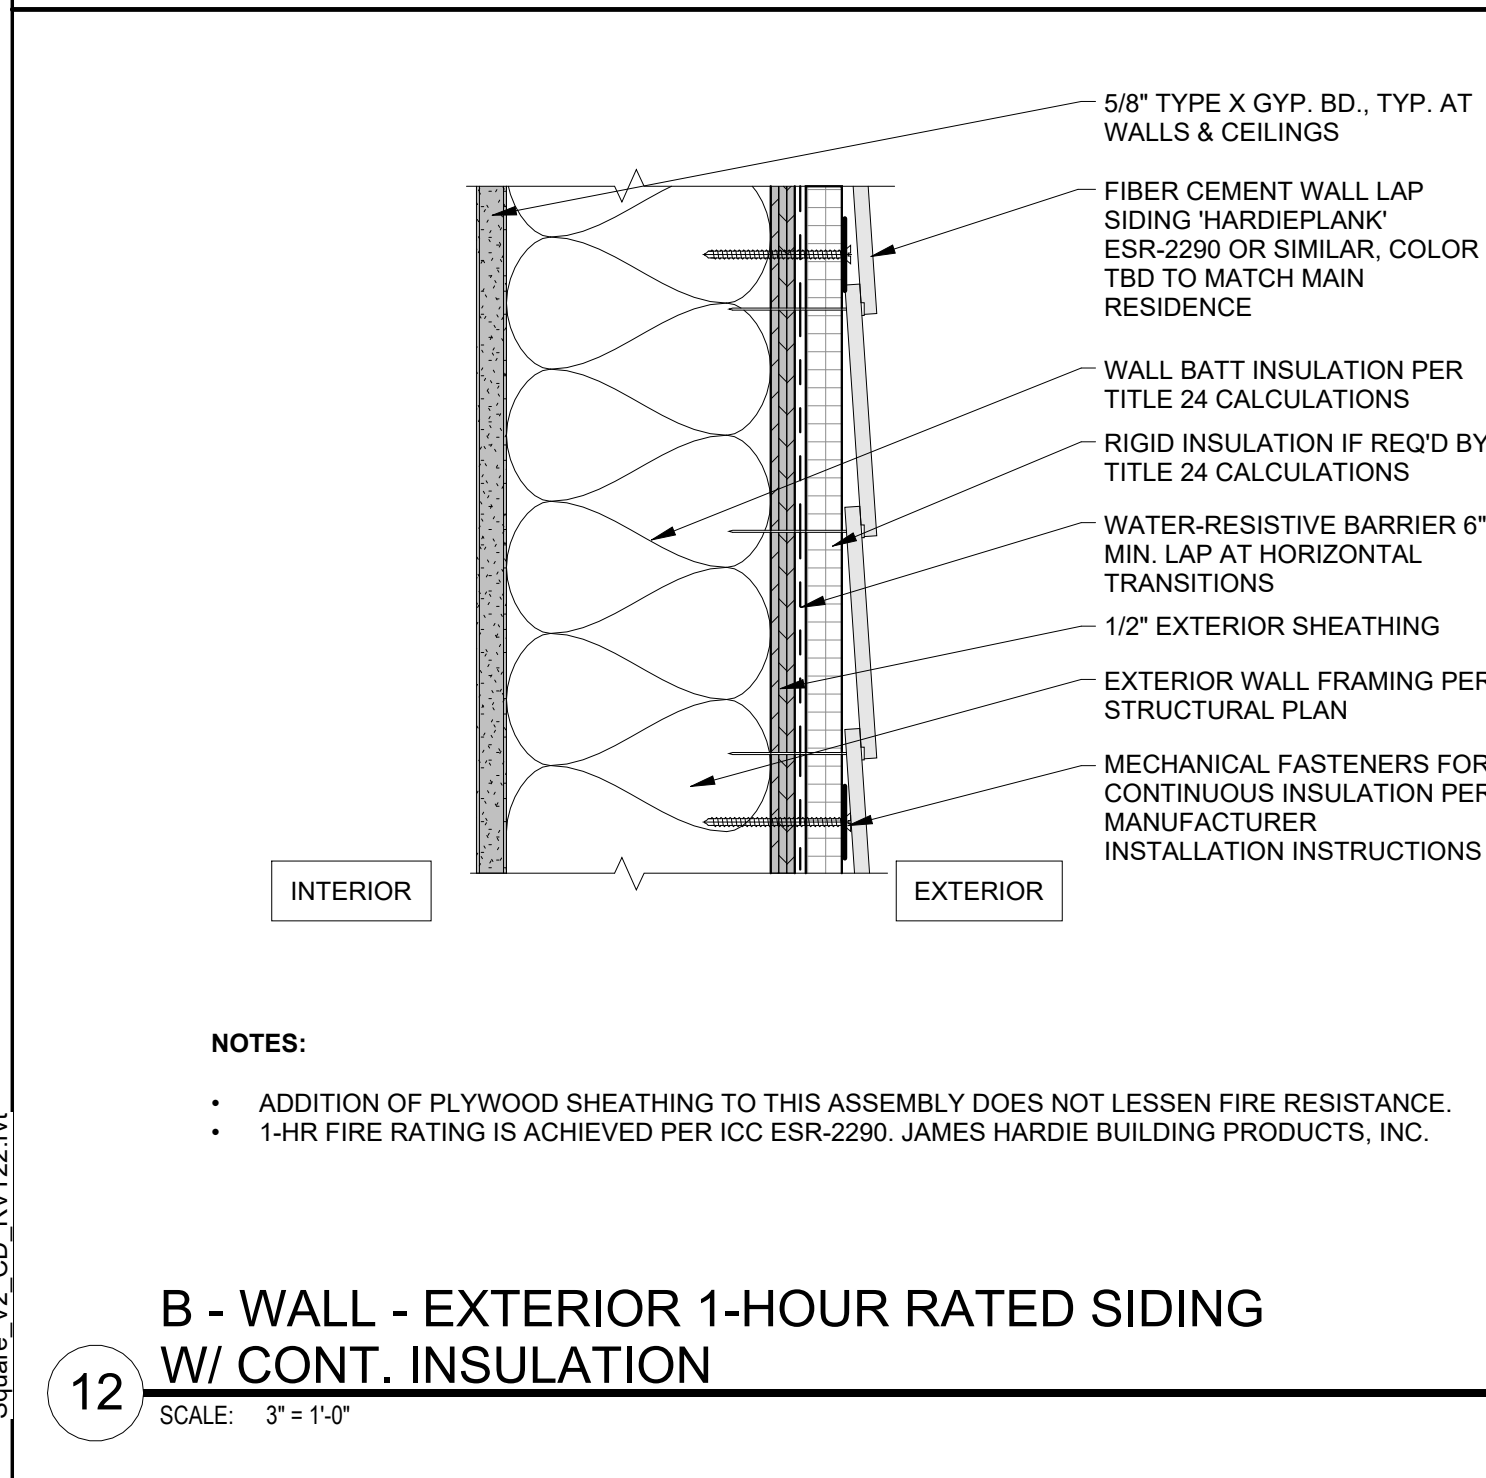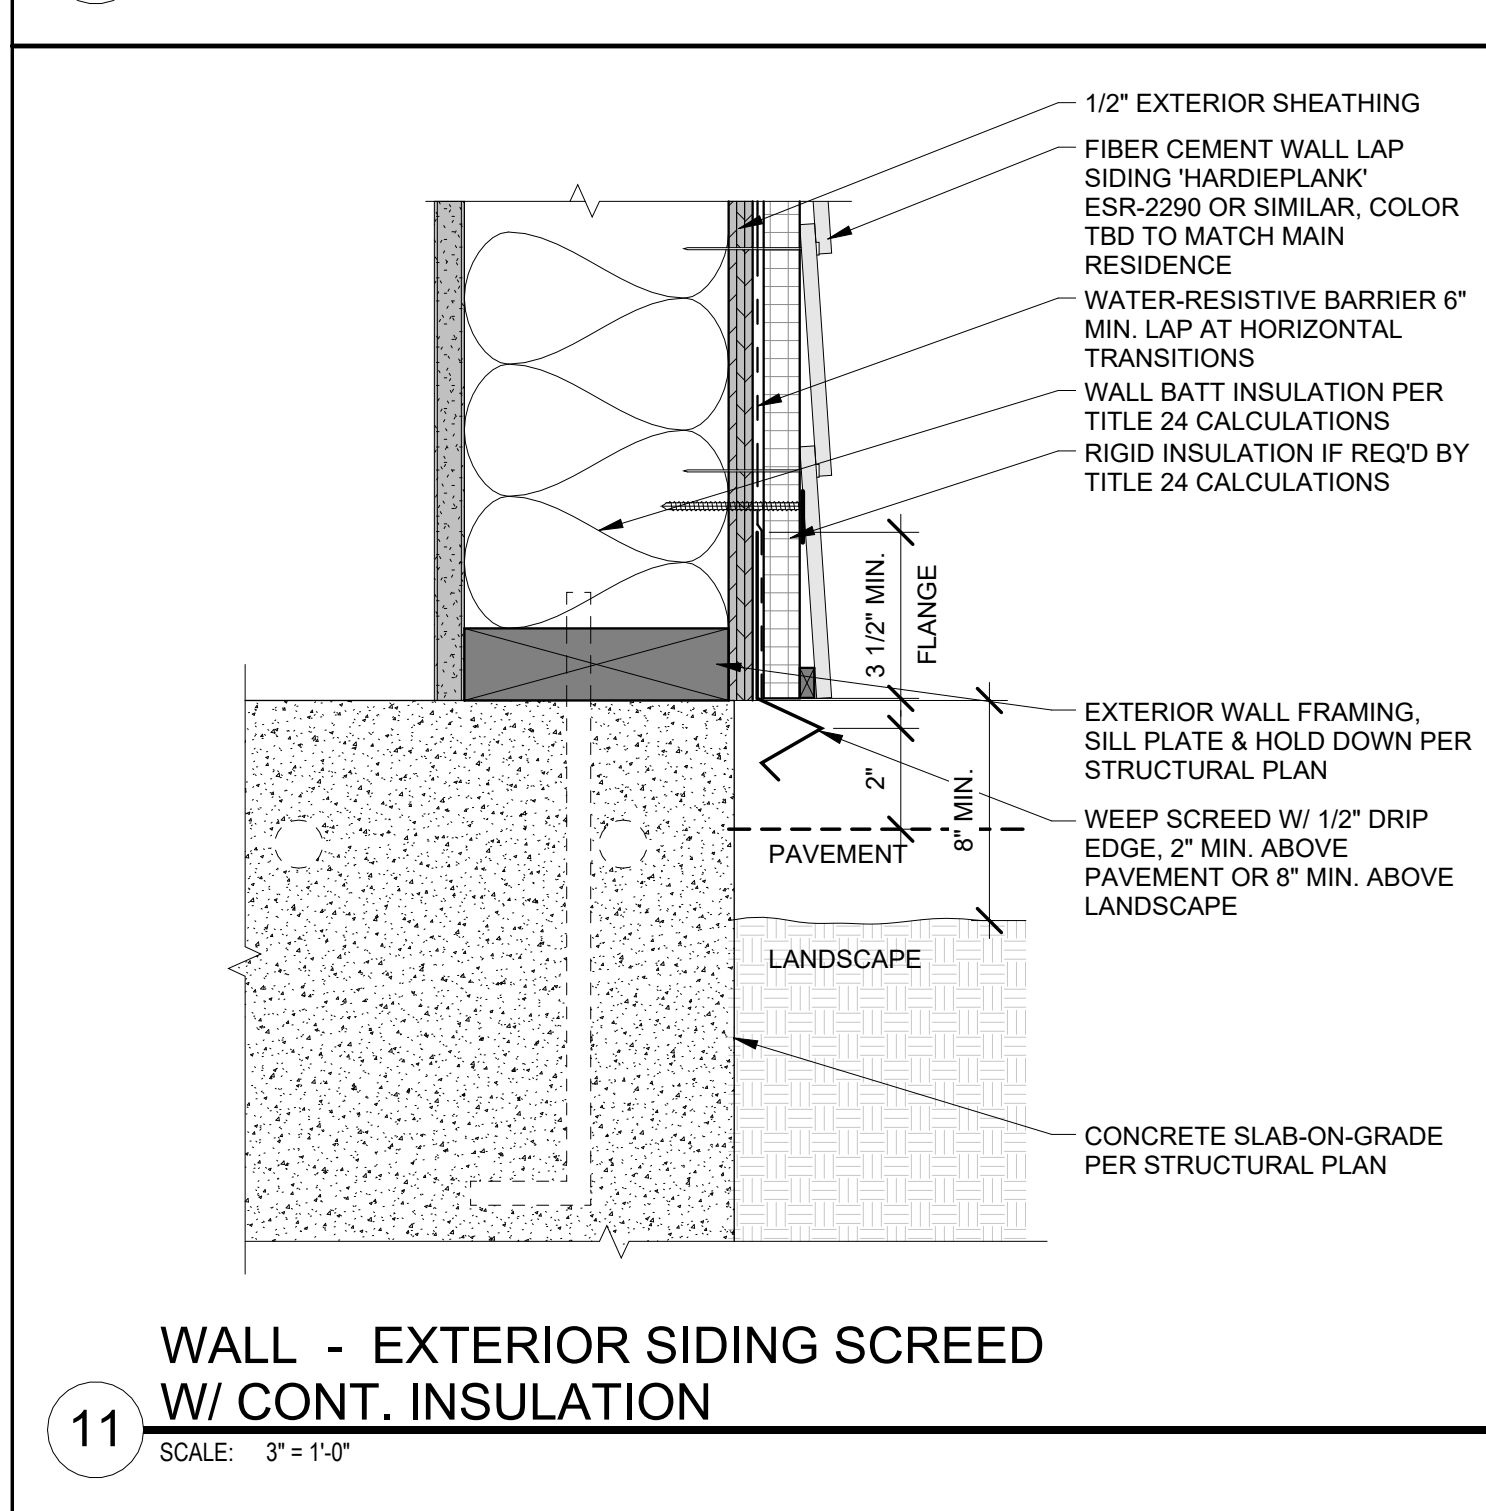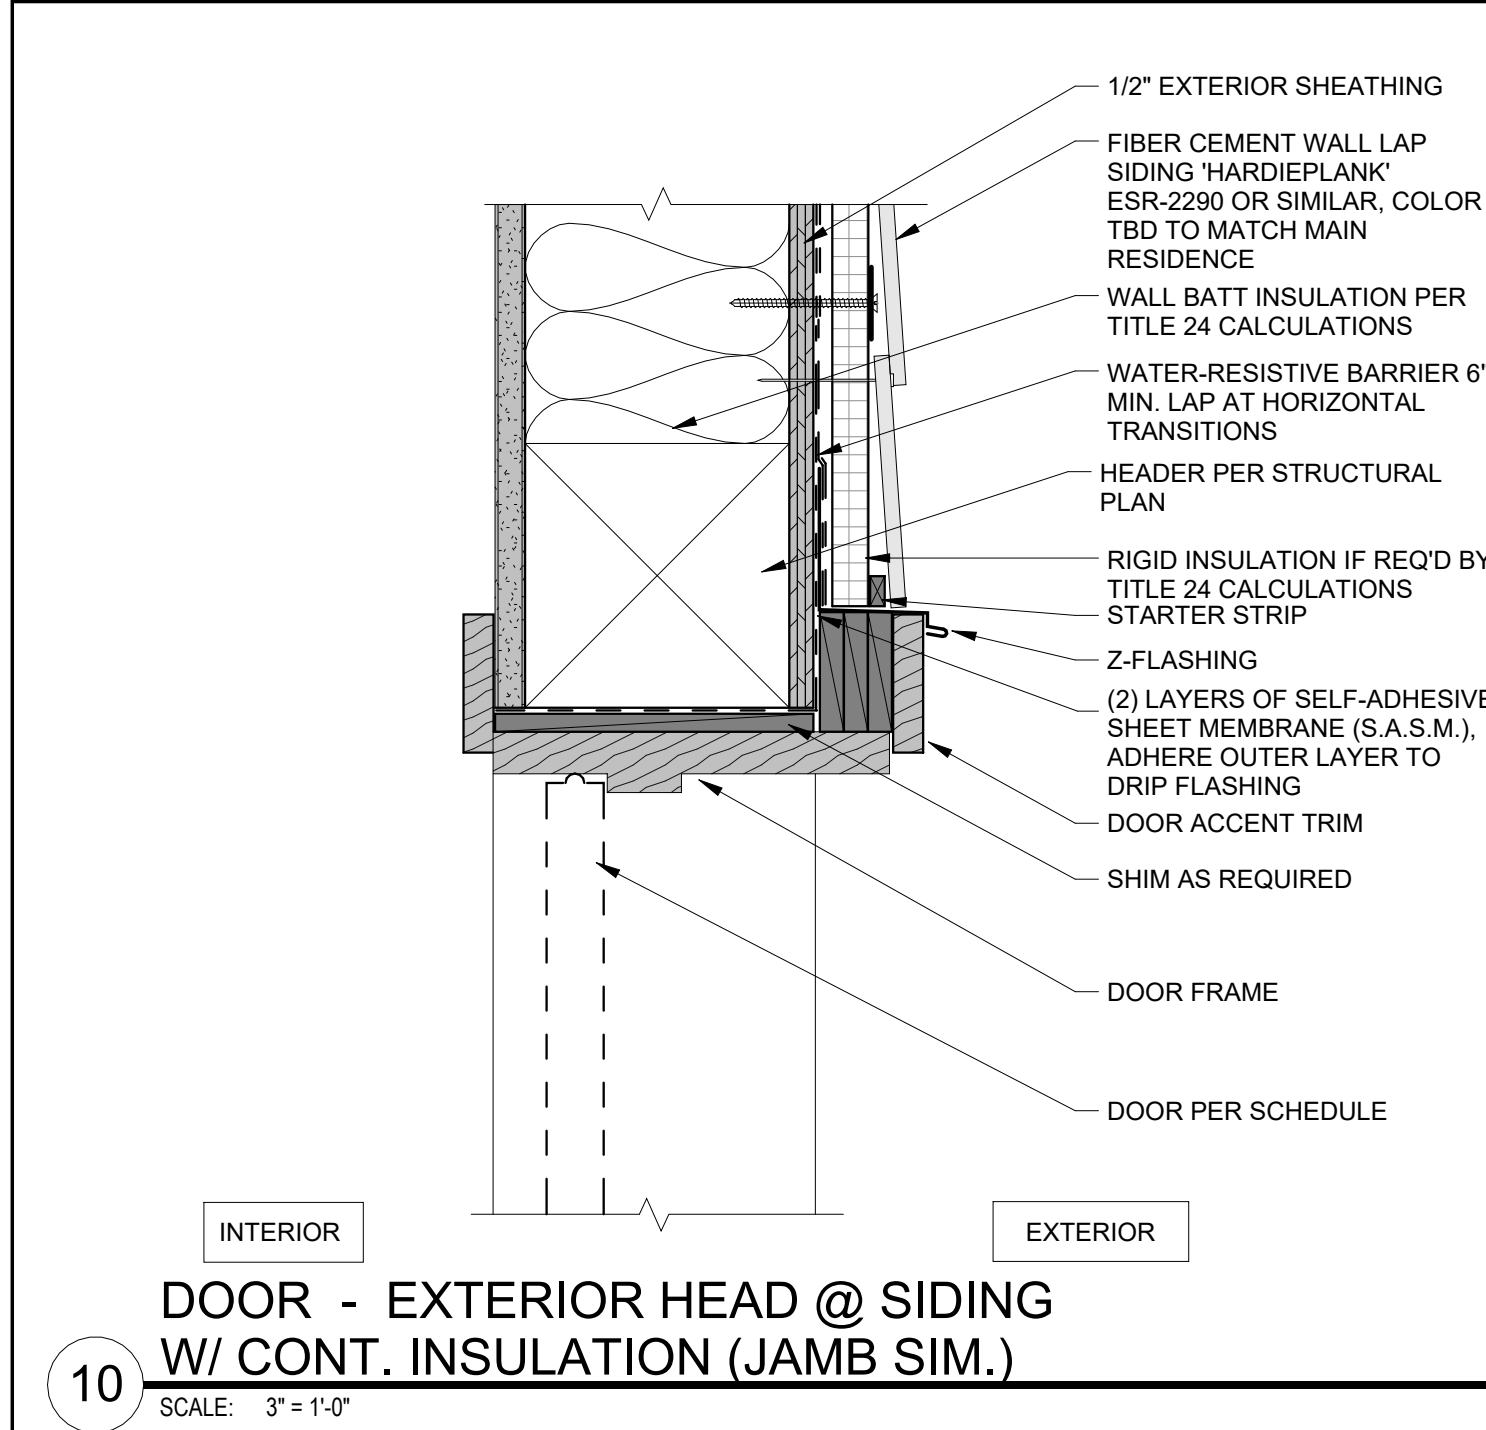



SNAPADU
DESIGN HOUSE


YUCCA ROAD
OCEANSIDE, CA 92054
760-259-2476
INFO@SNAPADU.COM
WWW.SNAPADU.COM

ADU: 498 SQUARE

CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:

LUIS CALDERON
SnapADU



SIGNATURE

RELEASE	DATE	BY	APP.	RELEASED FOR...
	03/22/2024		LAG	

LAP SIDING
DETAILS

A520

22040

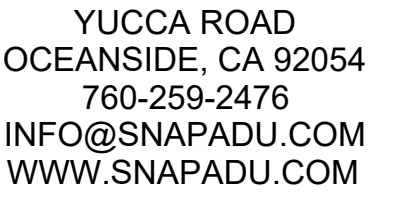

ADU: 498 SQUARE
CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:
LUIS CALDERON
napADU






SIGNATURE


[illegible]

BOARD & BATTEN DETAILS

A530

2040

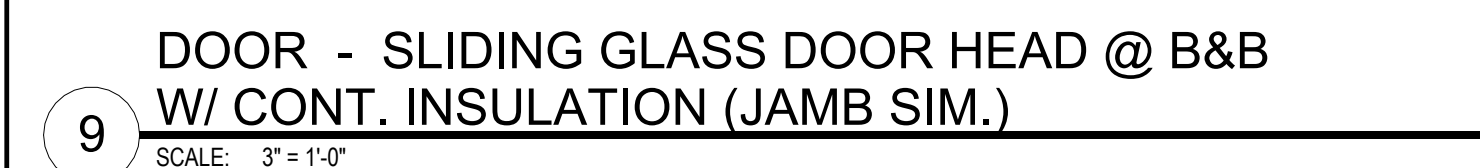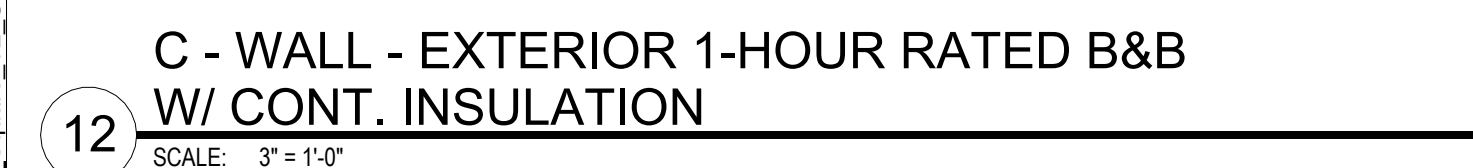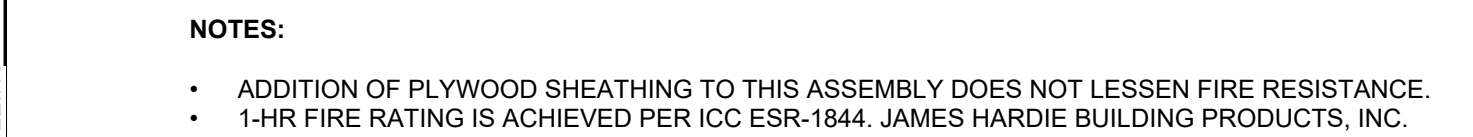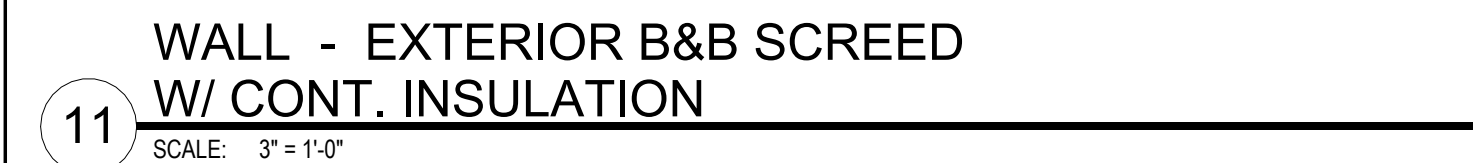

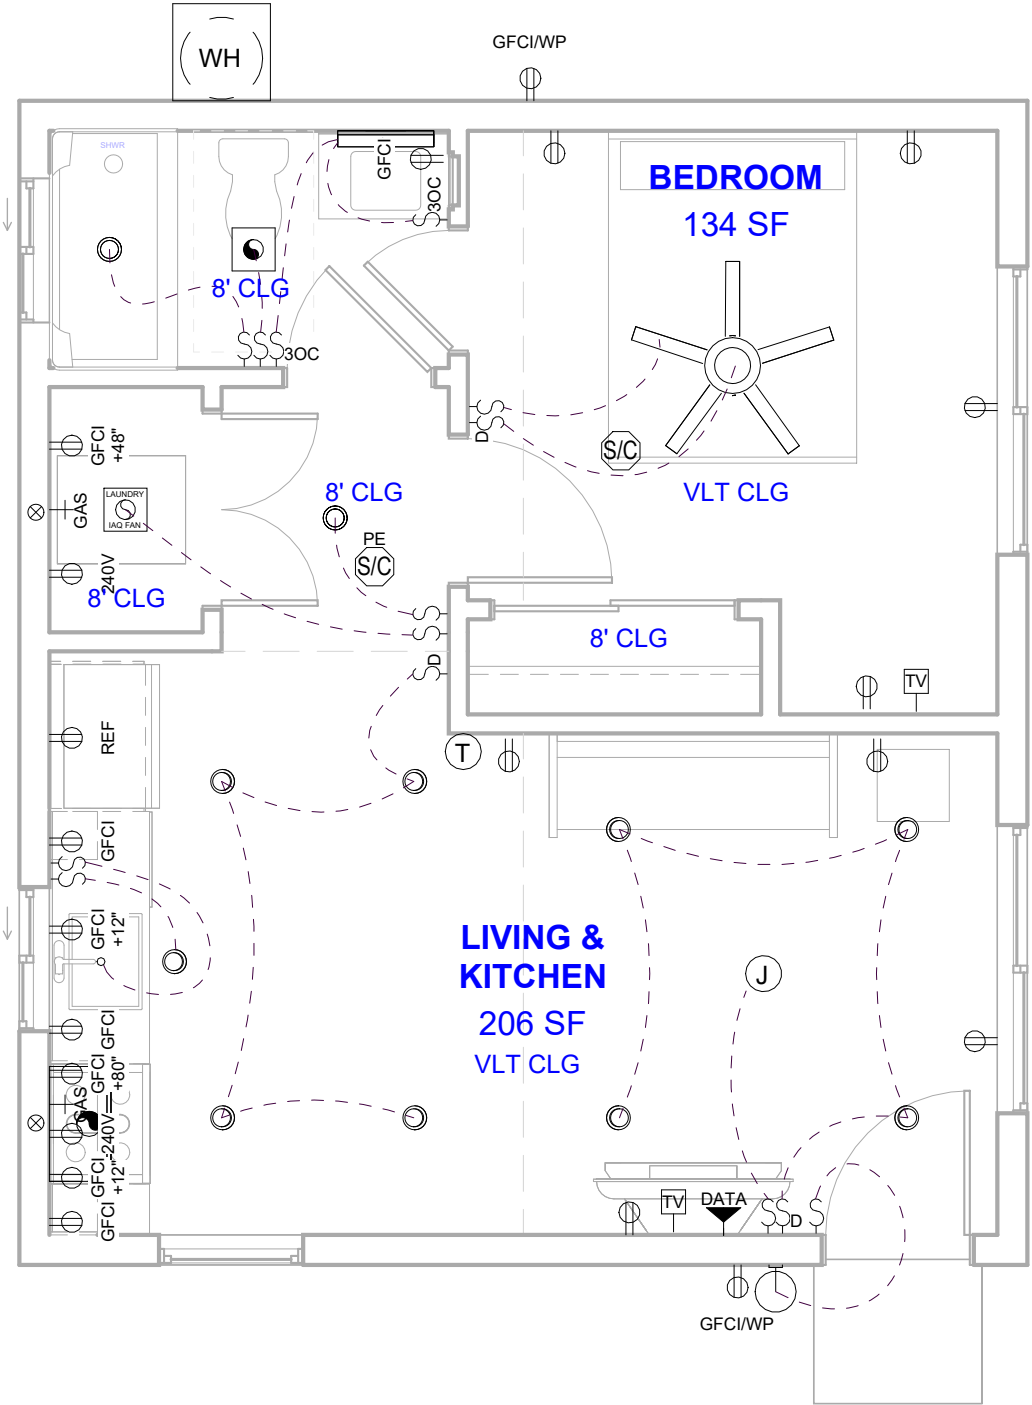

NOTES:

¹ APPROXIMATE GAS INPUT TYPICAL APPLIANCES PER CPC 2022 TABLE 1208.4.1

NOTES:

¹ NATURAL GAS PIPE SIZING PER CPC 2022 TABLE 1215.2(1)





CEILING FAN WITH LIGHT


IAQ FAN SHALL PROVIDE 50 CFM PER T-24 REPORT

LISTED WHOLE-HOUSE FAN NOT REQUIRED


EXHAUST FAN MODEL: S&P PCD110-PREMIUM CHOICE WITH DC MOTOR; 4" DUCT SONE RATING RANGE: 0.7 - 1.2;
6" DUCT SONE RATING RANGE: 0.3 - 1.1

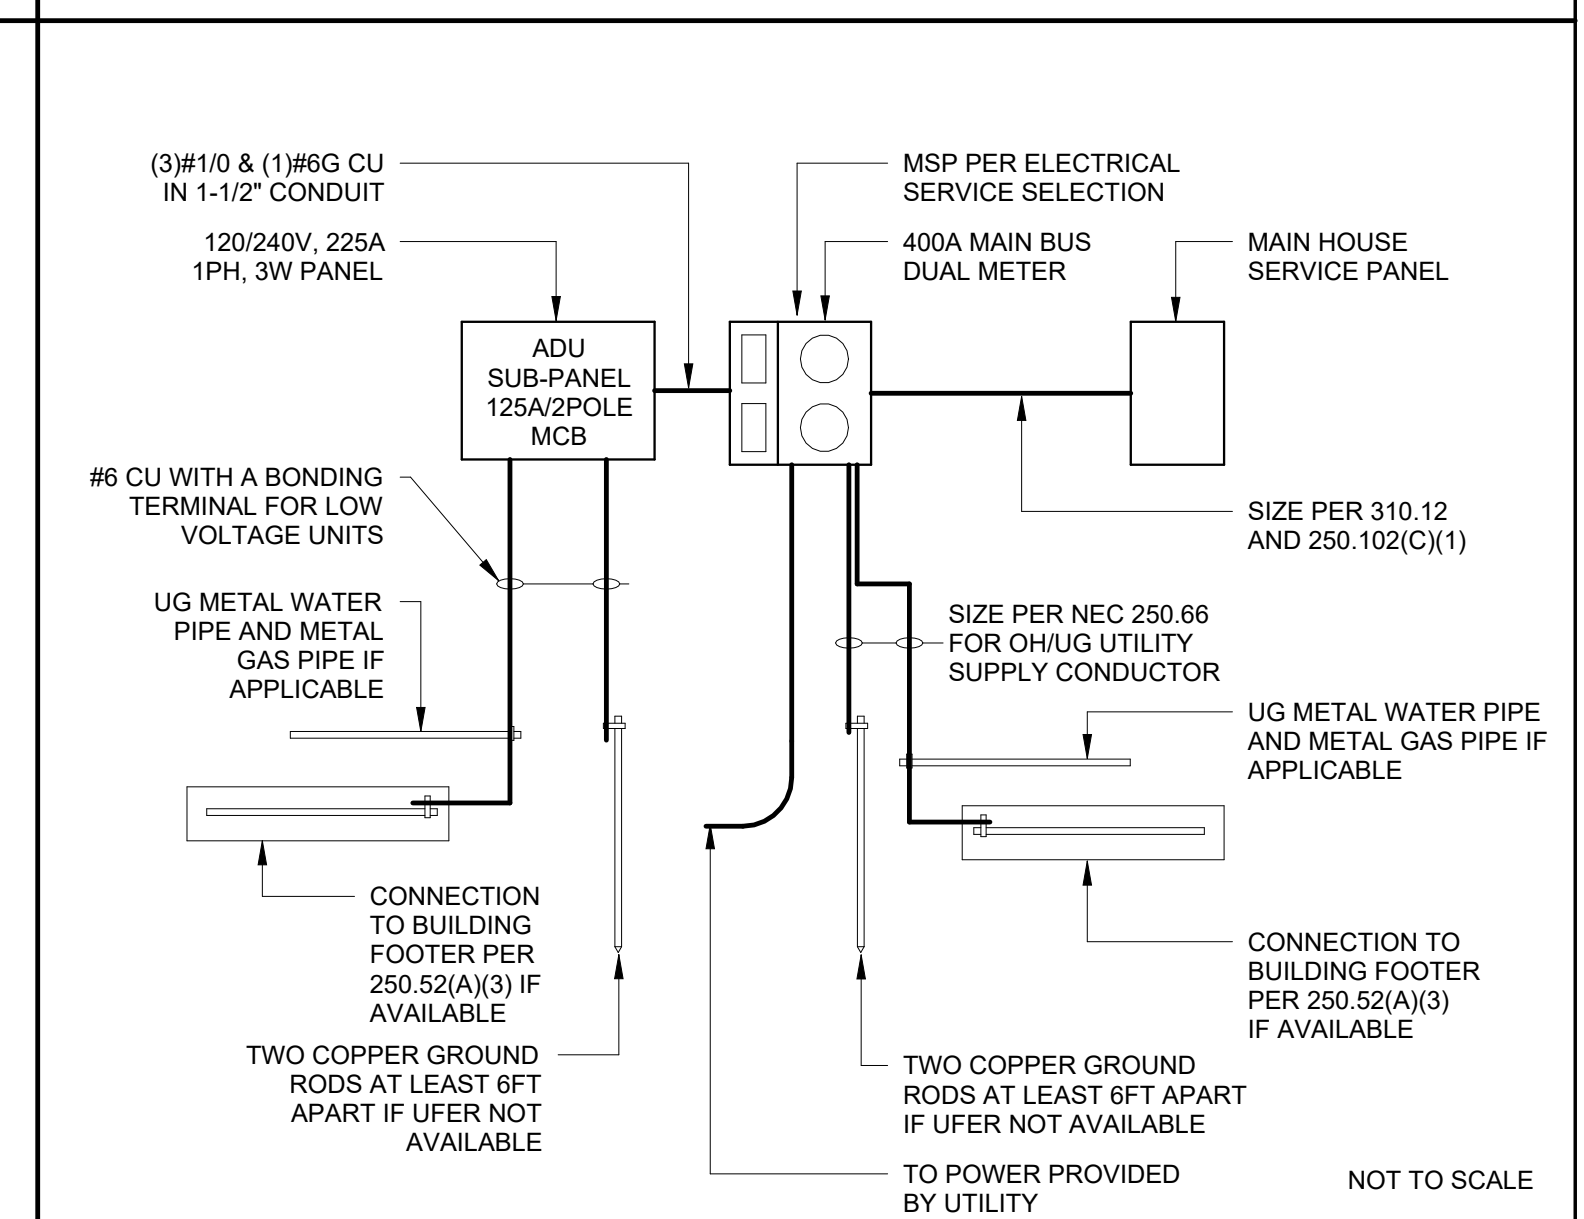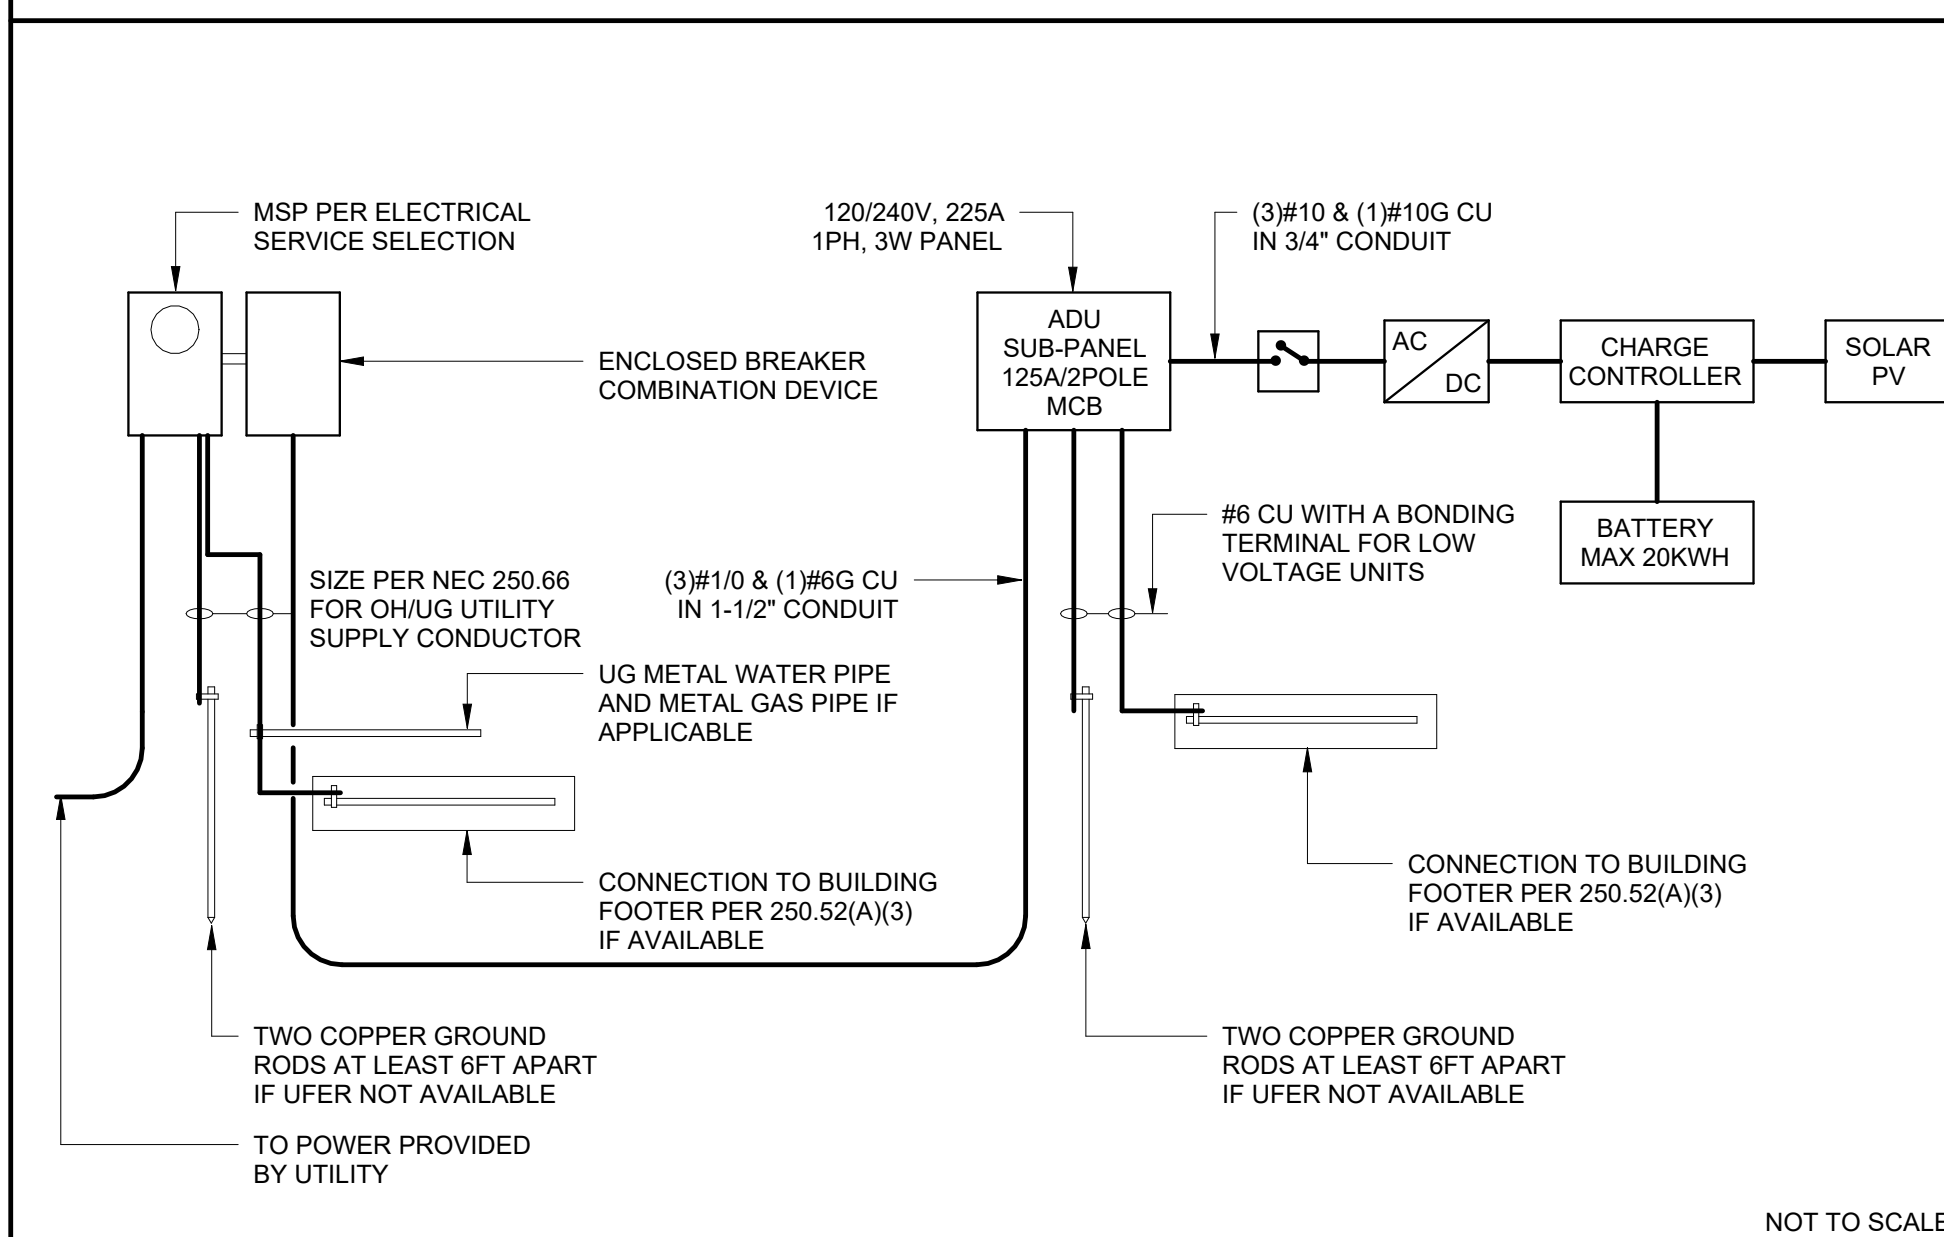

ELECTRICAL RISER DIAGRAM DUAL METER W/ SOLAR

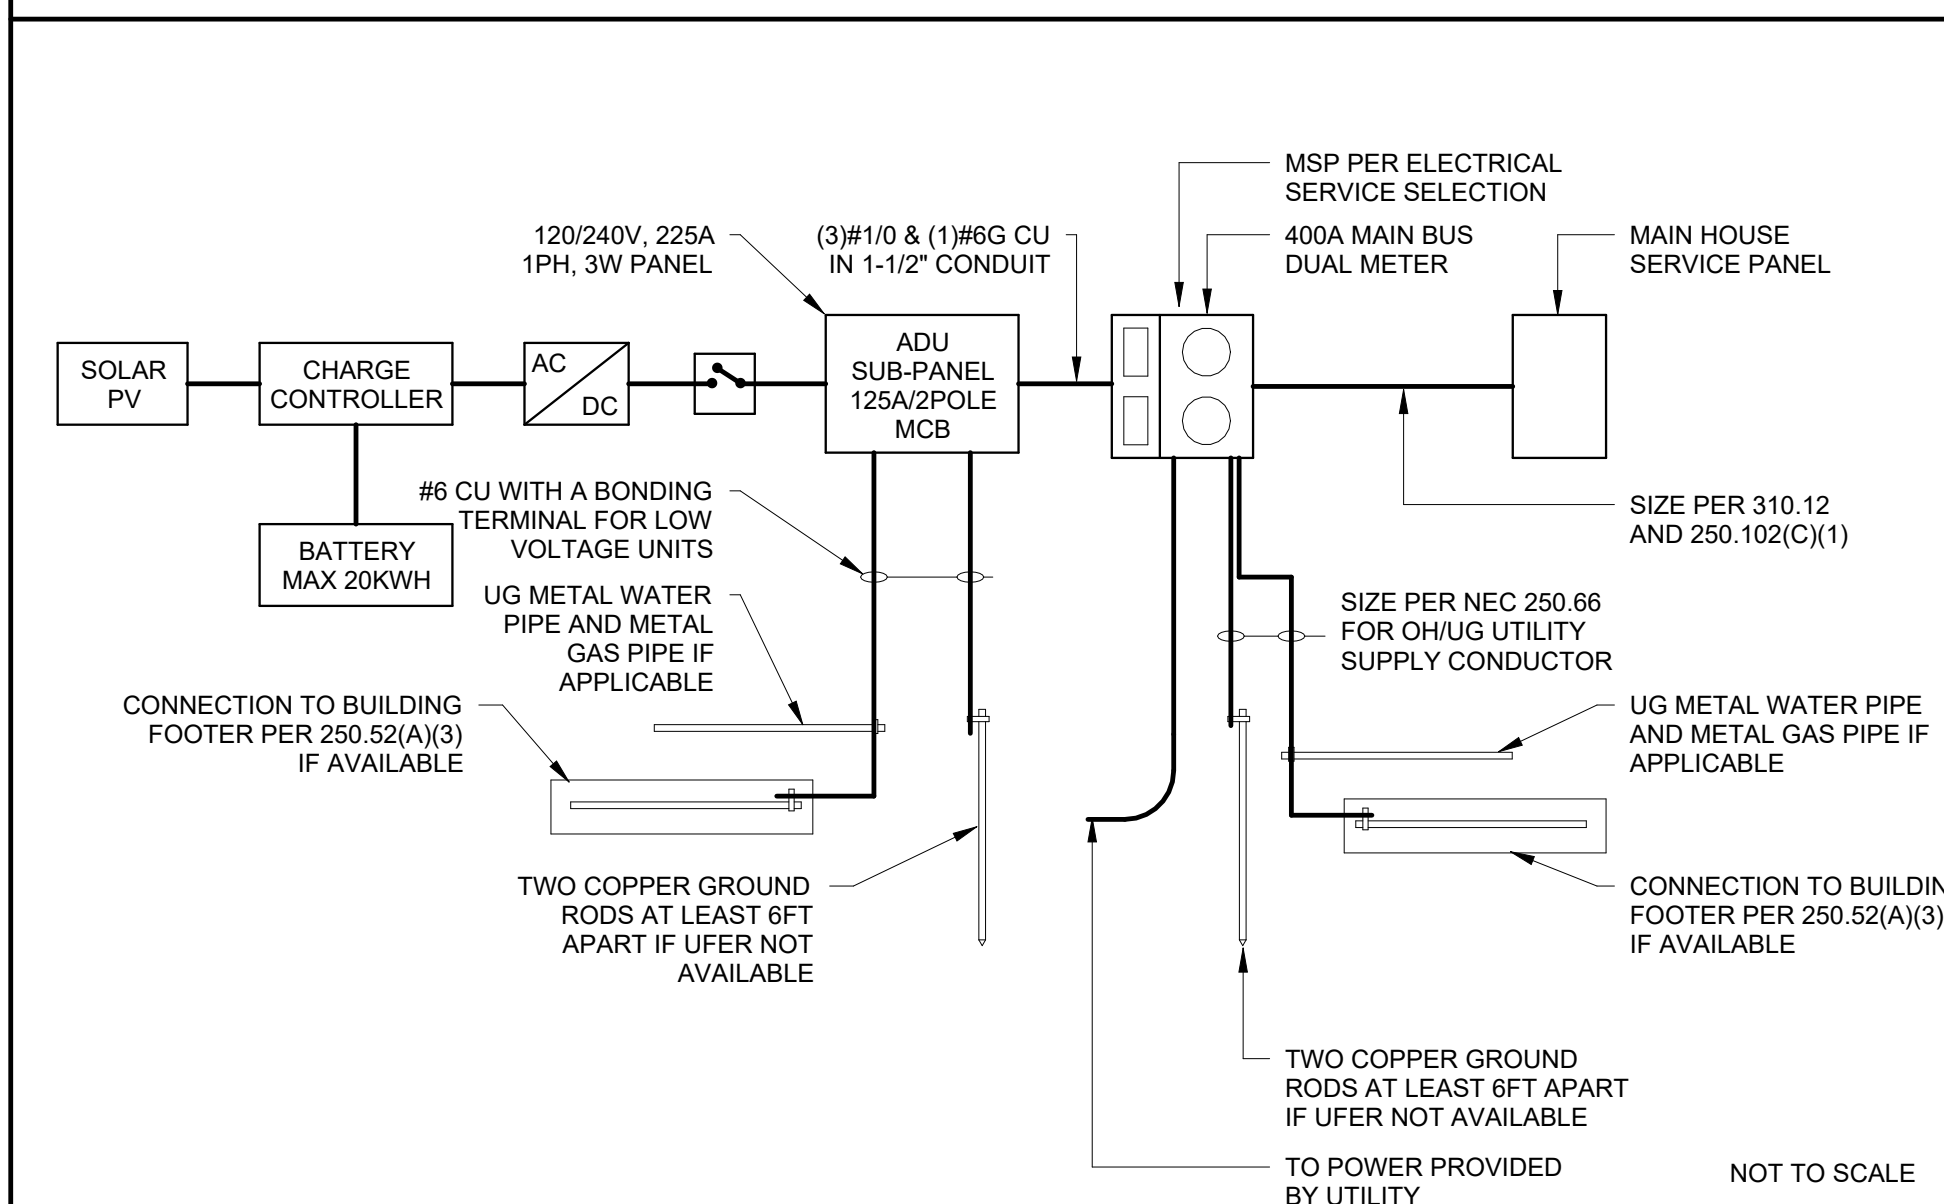

ELECTRICAL RISER DIAGRAM SIDE BY SIDE WO/ SOLAR

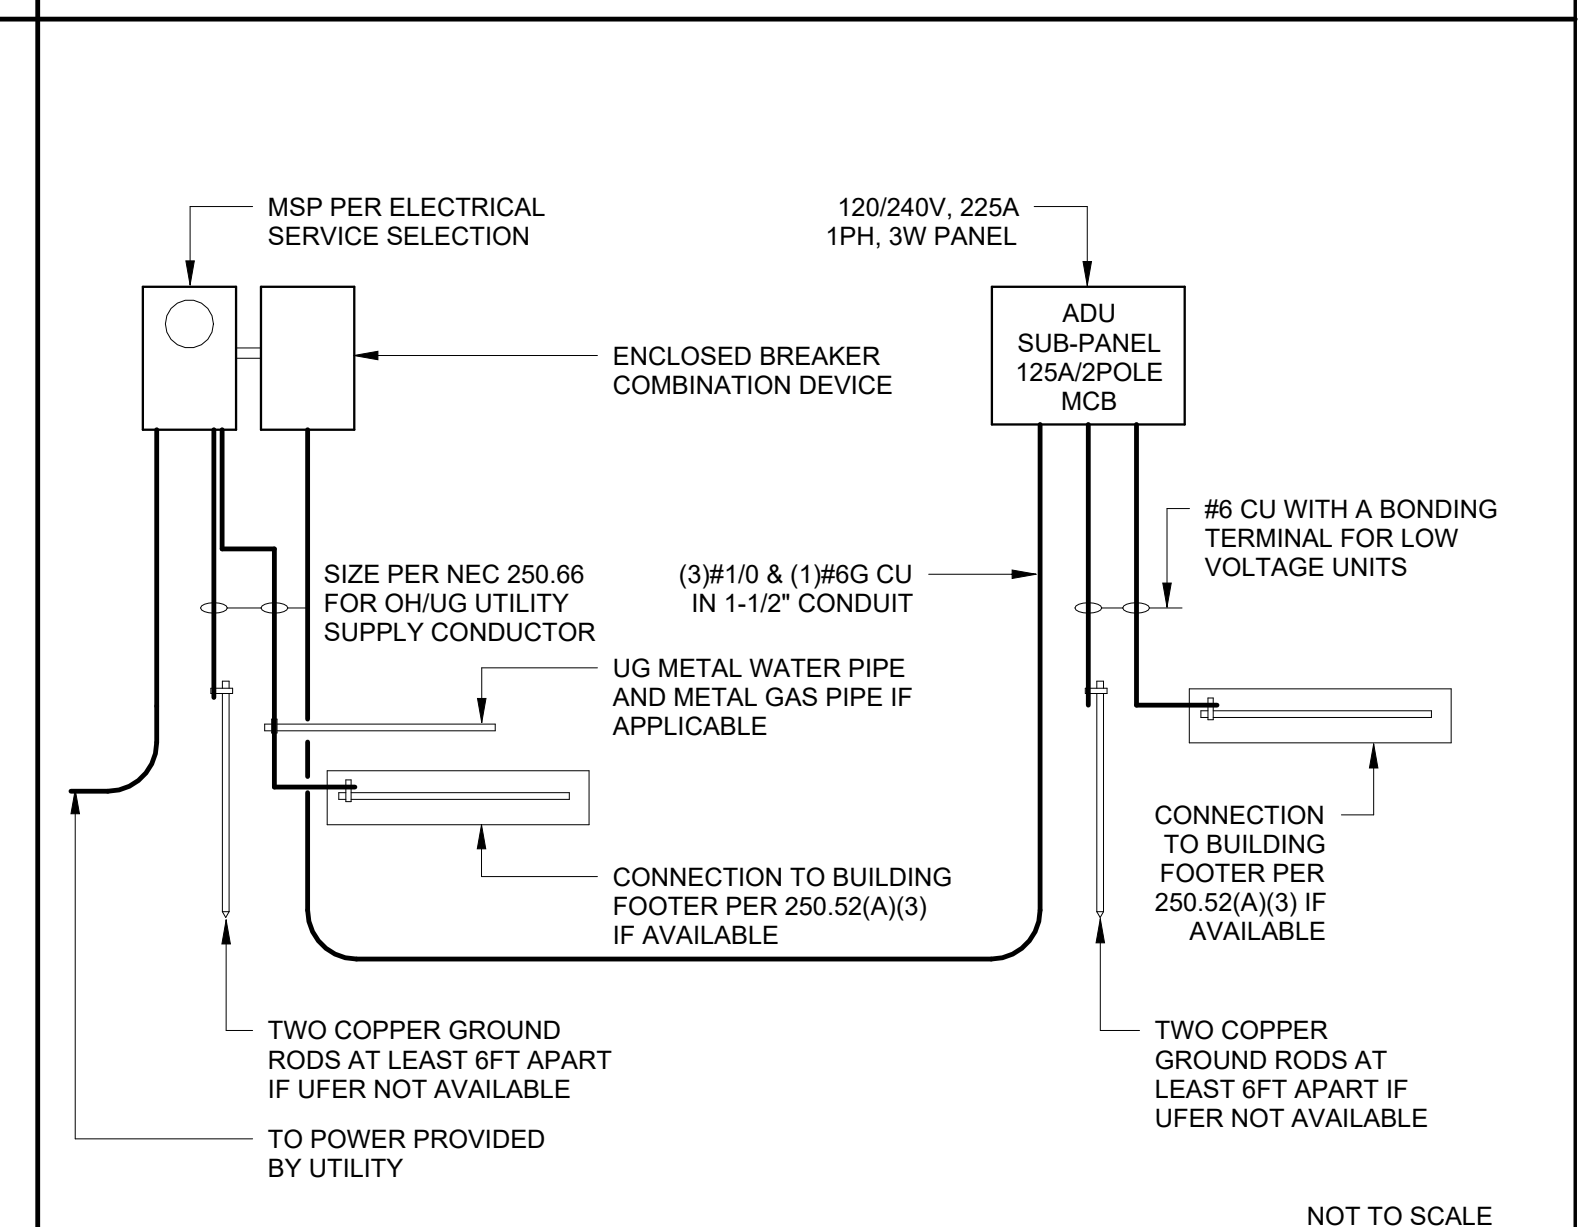

ESS PANEL SCHEDULE

ESS PANEL - 20/40 CKT 225A BUS 60A MLO 120/240V 1PH 3W OUTDOOR					
CKT #	C/B	LOAD	CKT #	C/B	LOAD
1			2		
3			4		
5			6		
7			8		
9			10		
11			12		
13			14		
15			16		
17			18		
19			20		

ELECTRICAL PANEL SCHEDULE

SUBPANEL - 30/60 CKT 225A BUS 100A MLO 120/240V 1PH 3W OUTDOOR					
CKT #	C/B	LOAD	CKT #	C/B	LOAD
1			2		
3			4		
5			6		
7			8		
9			10		
11			12		
13			14		
15			16		
17			18		
19			20		
21			22		
23			24		
25			26		
27			28		
29			30		



ADU: 498 SQUARE
CITY OF CHULA VISTA
276 FOURTH AVENUE
CHULA VISTA, CA 91910

DESIGNER:
JOS CALDERON
napADU



SIGNATURE

[illegible]

ELECTRIC RISER DIAGRAM & PANEL SCHEDULE


E103

2040

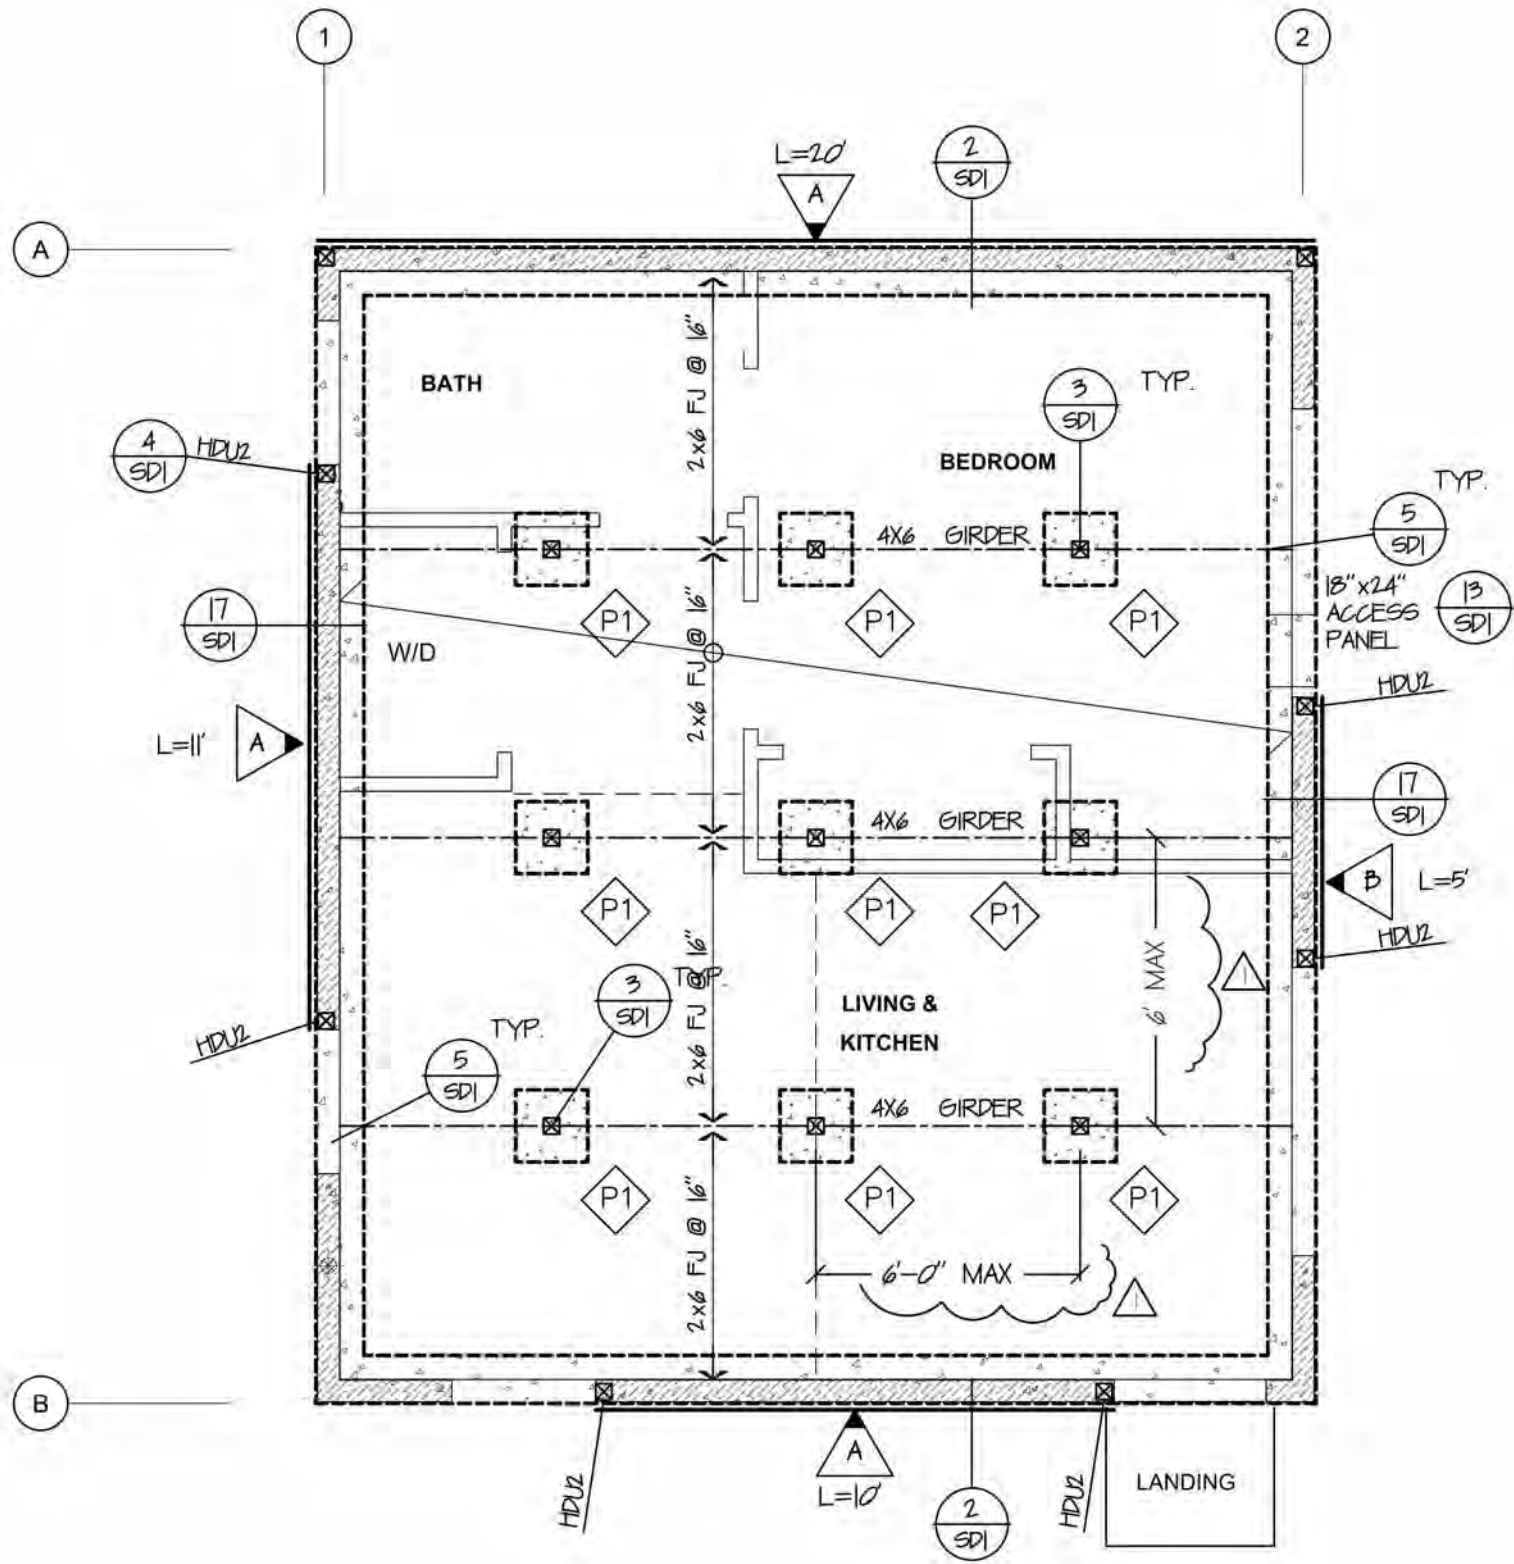


RIASED FOUNDATION PLAN

SC: 1/4" = 1'-0"

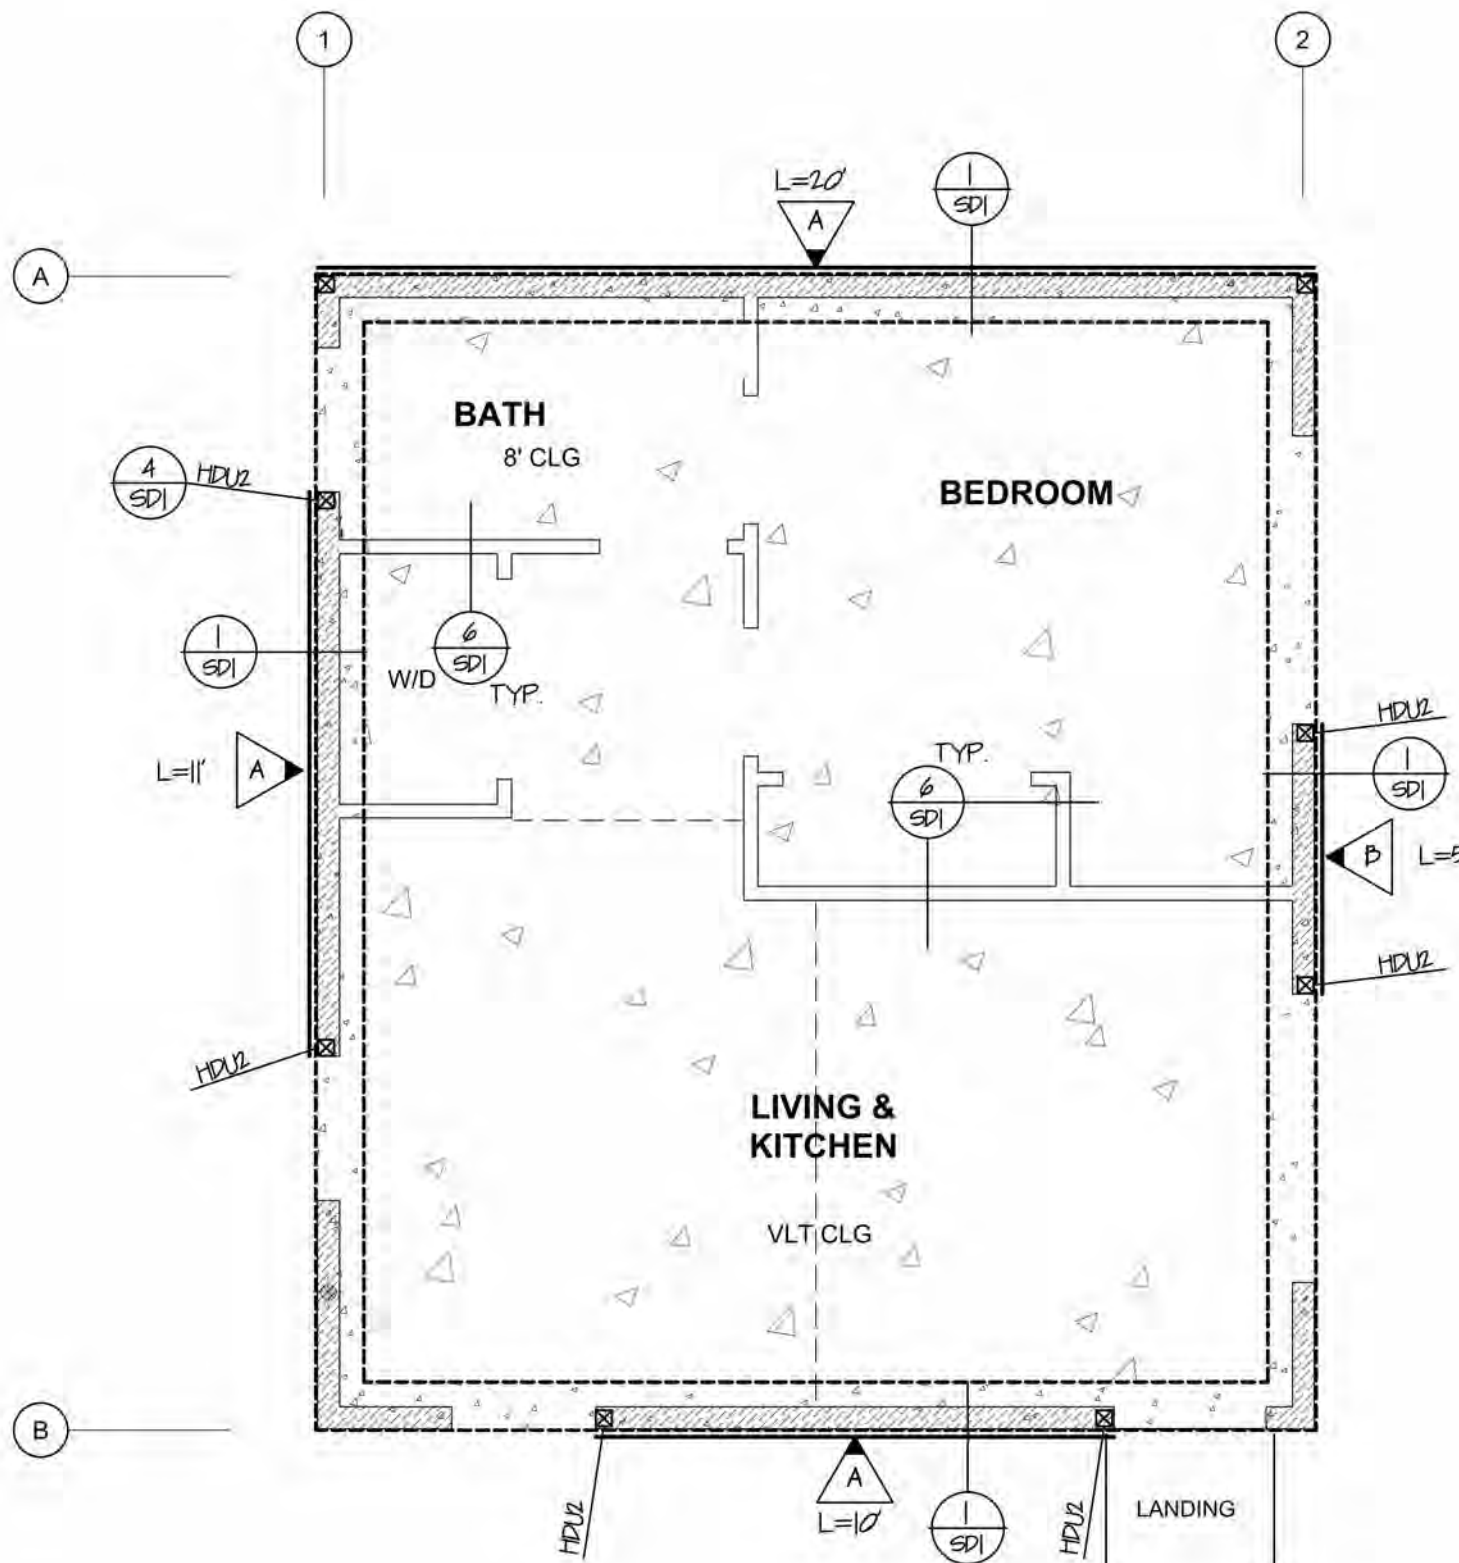

FOUNDATION PLAN

SC: 1/4" = 1'-0"

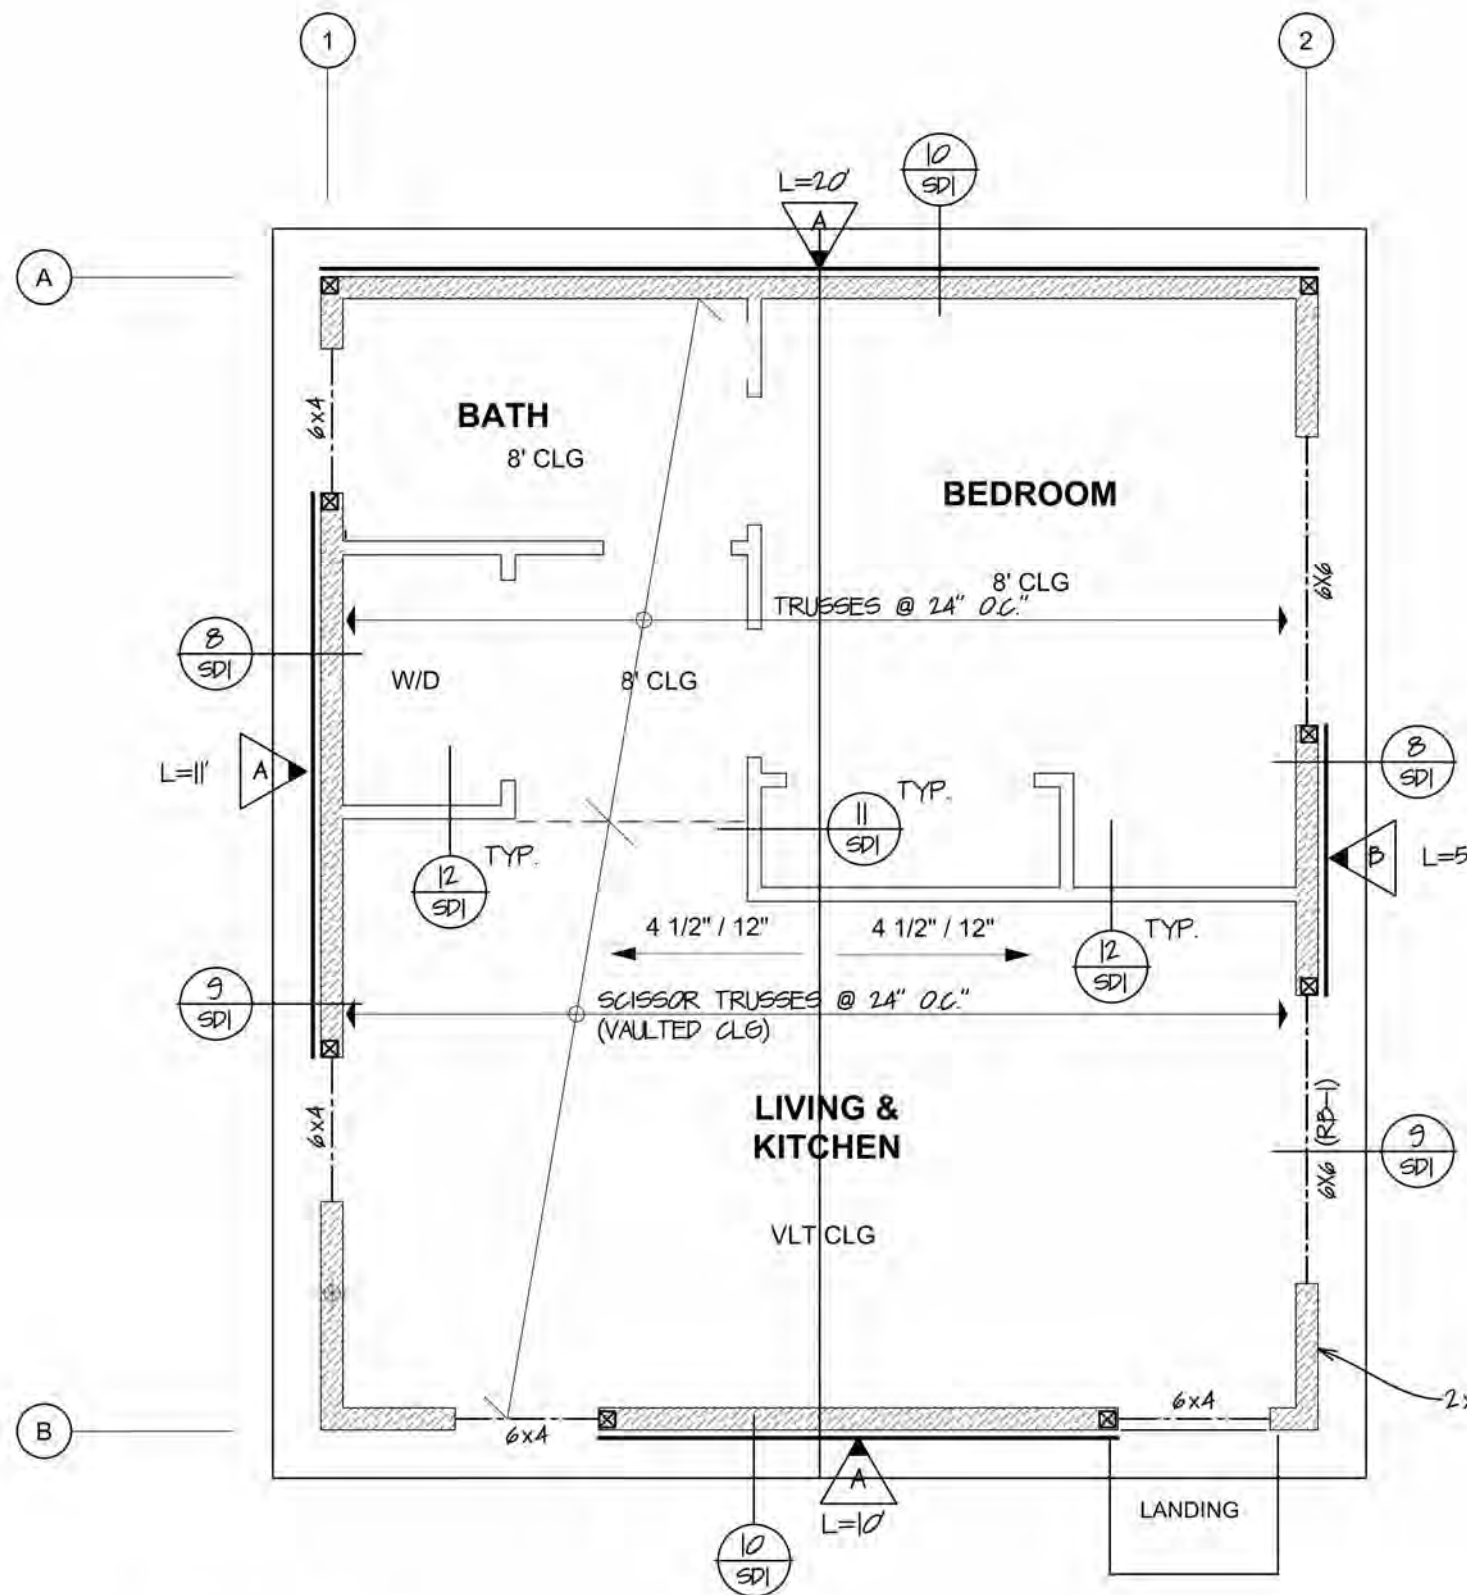

WALLS AND ROOF FRAMING PLAN

SC: 1/4" = 1'-0"

THE STRUCTURE(S) WILL BE LOCATED ENTIRELY ON UNDISTURBED NATIVE SOIL.

AS A CALIFORNIA LICENSED ENGINEER/ARCHITECT, I HAVE CLASSIFIED THE NON-EXPANSIVE NATURAL GROUND MATERIALS AS TYPE V PER TABLE RA24.4.1 OF THE 2022 CALIFORNIA RESIDENTIAL CODE AND ASSIGNED A LOAD BEARING PRESSURE OF 1500 PSF FOR DESIGN OF FOUNDATIONS RELATED TO THIS PROJECT.

THE UNDERSIGNED ACKNOWLEDGES BY THEIR SIGNATURE BELOW THAT THE PRESUMPTIVE LOAD BEARING VALUE OF 1500 PSF IS ALLOWED FOR FOUNDATION DESIGN WHERE THE FOUNDATIONS ARE EMBEDDED IN NON-EXPANSIVE NATURAL GROUND. THE UNDERSIGNED UNDERSTANDS THAT IF THE BUILDING INSPECTOR SUSPECTS FILL, EXPANSIVE SOILS, OR ANY GEOLOGIC INSTABILITY BASED UPON OBSERVATION OF THE FOUNDATION EXCAVATION, A SOILS OR GEOLOGICAL REPORT, AND RESUBMITTAL OF THE PLANS TO PLAN CHECK TO VERIFY THAT THE REPORT RECOMMENDATIONS HAVE BEEN INCORPORATED, MAY BE REQUIRED.

SIGNATURE: _____ OWNER/LICENSED ENGINEER OR ARCHITECT

SOILS

FRAMING NOTES

ROOF DIAPHRAGM

15/32" APA RATED SHEATHING (MIN), EXPOSURE 1, TONGUE AND GROOVE, w/ 1/2" COMMON NAILS @ 6" o.c. AT BOUNDARY & PANEL EDGE NAILING (EN), AND 12" o.c. AT INTERMEDIATE FRAMING MEMBERS

FLOOR DIAPHRAGM

15/32" APA STURD-I-FLOOR, EXPOSURE 1, TONGUE AND GROOVE, w/ 1/2" COMMON NAILS @ 6" o.c. AT BOUNDARY & PANEL EDGE NAILING (EN), AND 12" o.c. AT INTERMEDIATE FRAMING MEMBERS

FRAMING

1) ALL (2) 2x ROOF & FLOOR FRAMING TO HAVE MIN. 1/4" d AT 12" O.C. T&D, STAGGERED

2) ALL (2) 2x FRAMING TO HAVE MIN. 1/2" DIAMETER BOLTS AT 18" O.C. T&D, STAGGERED

3) 2x SOLID BLOCKING REQUIRED AT POINTS OF SUPPORT FOR ALL HORIZONTAL FRAMING MEMBERS. IN ADDITION, ALL 2x10 AND LARGER MEMBERS SHALL HAVE SOLID FULL DEPTH BLOCKING OR BRIDGING AT MAX. 8'-0" o.c.

4) ALL WOOD POSTS AT UPPER FLOORS TO CONTINUE TO BEAM OR FOUNDATION

5) UNLESS DETAILED OTHERWISE, ALL RIDGE / HP / VALLEY CONNECTIONS TO HAVE A SIMPSON A95 CONNECTOR AT EACH CORNER WITH A 2x KICKER TO BEARING WALL

7) AT ROOF-TO-WALL FRAMING, PROVIDE A95 FRAMING ANCHORS PER SHEARWALL SCHEDULE OR AT MAX. 48" O.C. FROM PLATES TO RAFTERS AND RAFTER BLOCKING AROUND PERIMETER OF BUILDING AND AT DRAG LINES AS INDICATED ON PLANS (SEE PLANS WHERE OTHER REQUIREMENTS MAY OCCUR)

8) AT FIRST FLOOR AND SUBTERRANEAN LEVEL, PROVIDE A95S PER SHEARWALL SCHEDULE OR AT MAX. 48" O.C. FROM PLATES TO FLOOR JOISTS AND BLOCKING AROUND PERIMETER OF BUILDING AND AT DRAG LINES AS INDICATED ON PLANS (SEE PLANS WHERE OTHER REQUIREMENTS MAY OCCUR)

9) PROVIDE DOUBLE JOISTS UNDER ALL PARALLEL WALLS, UNO.

10) WHEN SHEAR WALLS ARE SUPPORTED BY WOOD JOISTS THAT ARE PERPENDICULAR TO THE SHEAR WALL, ATTACH SOLID 4x BLOCKING UNDER SHEAR WALLS BETWEEN JOISTS. PROVIDE 2x SOLID BLOCKING UNDER NON-SHEAR WALLS PERPENDICULAR TO FLOOR JOISTS. SEE PLANS AND DETAILS WHERE OTHER REQUIREMENTS MAY OCCUR.

11) ATTACH MIN. 2x SOLID BLOCKING AND EDGE NAIL THE PERIMETER OF ALL OPENINGS OVER 12" IN WIDTH OR LENGTH IN ALL SHEAR PANELS AND DIAPHRAGMS. SEE DETAILS WHERE OTHER REQUIREMENTS MAY OCCUR.

12) ALL CONNECTORS AND METAL HARDWARE IN CONTACT WITH PRESSURE TREATED TIMBER SHALL HAVE CORROSION-RESISTANT COATINGS OR PROTECTION, SUCH AS "ZMAX", HOT DIPPED GALVANIZED, OR BE STAINLESS STEEL

STUD SIZE

2x4 @ 16" o.c.
2x6 @ 16" o.c.
2x6 @ 8" o.c.
2x8 @ 16" o.c.

MAX. HEIGHT

10 FT
12 FT
14 FT
16 FT

LEGEND

- RF TRUSSES @ 24" o.c., UNO.
- 2x6 F.J. @ 16" o.c., UNO.
- 4x PM WIDTH POST UNO.
- POST ABOVE
- PLYWOOD SHEARWALL PER PLAN
- ST#36 SIMPSON STRAP, UNO.
- DRAG LINE PER PLAN SEE SHEARWALL NOTES ON SHEET S01

FOUNDATION NOTES

1) CONCRETE SHALL HAVE A MINIMUM ULTIMATE COMPRESSIVE STRENGTH OF 1500 PSI AT 28 DAYS FOR FORD-IN-PLACE CONTINUOUS AND SPREAD FOOTINGS, AND 3000 PSI (SPECIAL INSP. REQ'D) AT 28 DAYS FOR GRADE BEAMS.

2) PORTLAND CEMENT SHALL BE TYPE II PER ASTM C 150. AGGREGATES SHALL BE PER ASTM C 39 WITH MAXIMUM SIZE OF 1 1/2" FOR FOOTINGS AND 1" FOR ALL OTHER WORK.

3) REINFORCING STEEL SHALL BE ASTM A615, GRADE 60, CLEAN AND RUST FREE. LAPS AT SPLICES AND JOINT LINES TO BE 40 BAR DIAMETERS (2'-0" MINIMUM) UNLESS NOTED OTHERWISE ON PLANS.

4) ALL NEW SILL PLATE ANCHOR BOLTS TO BE INSTALLED IN FRESH CONCRETE SHALL BE 5/8" DIAMETER A307 1" BOLTS SPACED PER PLAN AND SHEARWALL SCHEDULE WITH MINIMUM 1" EMBEDMENT. MAXIMUM ANCHOR BOLT SPACING SHALL BE 4'-0" o.c. ANCHOR BOLTS AT ENDS OF WALL PANELS SHALL BE LOCATED WITHIN 12" AND GREATER THAN 7 BOLT DIAMETERS FROM THE END OF SILL PLATE. THERE SHALL BE A MINIMUM OF TWO ANCHOR BOLTS PER WALL PANEL (ANCHOR BOLTS TO EXISTING FOOTINGS PER NOTE #8 BELOW). PLATE WASHERS A MINIMUM 3"x3"x22G THICK SHALL BE USED ON EACH BOLT. ALL CONNECTORS AND METAL HARDWARE IN CONTACT WITH PRESSURE TREATED TIMBER SHALL HAVE CORROSION RESISTANT COATINGS OR PROTECTION, SUCH AS "ZMAX", HOT DIPPED GALVANIZED, OR BE STAINLESS STEEL.

6) IF NO SOILS REPORT IS PROVIDED, ASSUMED ALLOWABLE SOIL BEARING PRESSURE (ASPT) SHALL BE 1500 PSF (PER SOIL SITE CLASS D) & EMBED FOOTINGS A MINIMUM OF 12" INTO COMPETENT SOIL.

7) REINFORCING SHALL BE CONTINUOUS AROUND CORNERS AND THROUGH INTERSECTIONS.

9) CONSTRUCTION JOINTS SHALL BE PREPARED BY WIRE BRUSHING, CLEANING AND BRUSHING IN A PASTE OF NEAT CEMENT MORTAR IMMEDIATELY PRIOR TO POURING. LOCATION OF CONSTRUCTION JOINT SHALL BE APPROVED BY THE PROJECT STRUCTURAL ENGINEER.

10) ALL CONNECTORS AND METAL HARDWARE IN CONTACT WITH PRESSURE TREATED TIMBER SHALL HAVE CORROSION-RESISTANT COATINGS OR PROTECTION, SUCH AS "ZMAX", HOT DIPPED GALVANIZED, OR BE STAINLESS STEEL.

11) PRIOR TO POURING INTERIOR CONCRETE FLOOR SLABS, ALL SOIL BELOW FLOOR SHALL BE COMPACTED TO REQUIRED 90% DENSITY AND MOISTENED TO A DEPTH NOT LESS THAN 18".

12) DEEPEN FLOOR FOOTINGS AS NECESSARY TO OBTAIN REQUIRED EMBEDMENT FOR ALL NEW HMD DOWN BOLTS. ALL HMD DOWN BOLTS TO HAVE A MINIMUM OF 3" OF CONCRETE COVER TO SOL @ BOTTOM. ALL HMD DOWN BOLTS MUST BE TIED IN PLACE PRIOR TO FOUNDATION INSPECTION.

13) ALL HMD DOWNS MUST BE TIED IN PLACE PRIOR TO FOUNDATION INSPECTION.

14) MINIMUM HORIZONTAL DISTANCE FROM BOTTOM LEADING EDGE OF FOOTING TO DAYLIGHT SHALL BE 7'-0"

FOUNDATION LEGEND

(N) 12" WIDE x 24" DEEP FOOTING W/ 2-#4 T. & D.

(N) CONC. PAD PER PLAN

4x PM WIDTH POST UNO.

POST ABOVE

SHEARWALL PER PLAN

CONCRETE SLAB

USE 4" THK. CONC. SLAB W/ #3 @ 16" O.C. EW. @ MID-HEIGHT, 0/ 2" SAND, 0/ 10 MIL VAPOR BARRIER (ASTM E36 & E1145), 0/ 2" SAND BASE.

CONCRETE PAD SCHEDULE

PAD	SIZE
P1	15" SQ. x 14" THK. CONC. PAD W/ 2-#4 EW.

REVISIONS

9-20-25

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

PC

GENERAL

1) ALL DESIGN, CONSTRUCTION, AND WORKMANSHIP SHALL CONFORM TO:
2022 EDITION OF THE CALIFORNIA BUILDING CODE (CBC), AMERICAN SOCIETY OF CIVIL ENGINEERS (ASCE)
7-16, 2022 CALIFORNIA MECHANICAL CODE (CMC), 2022 CALIFORNIA PLUMBING CODE, AND ALL LOCAL ORDINANCES AND REQUIREMENTS.

2) THE APPROVED CONTRACT STRUCTURAL DRAWINGS AND SPECIFICATIONS REPRESENT THE FINISHED STRUCTURE. THEY DO NOT INDICATE THE METHOD OF CONSTRUCTION.

3) IT SHALL BE THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO PROVIDE ALL MEASURES NECESSARY TO PROTECT THE STRUCTURE DURING CONSTRUCTION. SUCH MEASURES SHALL INCLUDE, BUT ARE NOT LIMITED TO, BRACING AND SHORING FOR LOADS DUE TO CONSTRUCTION EQUIPMENT, ETC. THE METHODS, TECHNIQUES, SEQUENCES, PROCEDURES, SUPERVISION, AND INSTALLATION OF ALL TEMPORARY BRACING AND SHORING SHOULD ENSURE THE SAFETY OF THE WORK. BRACING AND SHORING IS TO BE INSTALLED PER THE LATEST OSHA STANDARDS. ALL BRACING AND/OR SHORING SHALL STAY IN PLACE UNTIL ALL WORK HAS BEEN SUITABLY COMPLETED.

4) THE GENERAL CONTRACTOR SHALL VERIFY ALL DIMENSIONS PRIOR TO STARTING CONSTRUCTION. THE ENGINEER SHALL BE NOTIFIED OF ANY DISCREPANCIES OR INCONSISTENCIES.

5) DIMENSIONS SHALL TAKE PRECEDENCE OVER SCALES ON DRAWINGS. NOTES AND DETAILS ON DRAWINGS SHALL TAKE PRECEDENCE OVER GENERAL NOTES AND TYPICAL DETAILS.

6) IT SHALL BE THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO ENSURE THAT ALL APPLICABLE SAFETY LAWS ARE STRICTLY ENFORCED AND TO MAINTAIN A SAFE CONSTRUCTION PROJECT.

7) IT SHALL BE THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO PROVIDE SUPERVISION OF THE CONSTRUCTION WORK TO ENSURE THAT IT IS BUILT IN CONFORMANCE WITH THE APPROVED PLANS AND SPECIFICATIONS. THE ENGINEER WILL PROVIDE ONLY OBSERVATION OF THE WORK DURING CONSTRUCTION.

8) THE APPROVED SET OF CONSTRUCTION DOCUMENTS, INCLUDING ALL APPROVED REVISIONS, SHALL BE PRESENT AT THE JOB SITE AT ALL TIMES.

9) CONSTRUCTION MATERIALS SHALL BE STORED OUT IF PLACED ON FRAMED FLOORS OR ROOFS. LOADS SHALL NOT EXCEED THE DESIGN LOADING FOR THE SUPPORTING MEMBERS.

10) NO CHANGES IN THE PLANS WILL BE MADE AND NO EXTRA WORK PERFORMED UNLESS SO APPROVED BY THE OWNER, CIVIL/STRUCTURAL ENGINEER, SOLS ENGINEER/GEOLGISTS, COUNTY/CITY INSPECTOR AND BUILDING OFFICIALS.

11) A CLAIM FOR EXTRAS WILL BE CONSIDERED IF A CONDITION ARISES WHICH WAS CHANGED BY DESIGN BY OTHERS, UNFORESEEN OR HAS NOT BEEN SHOWN ON THE PLANS. SUCH CLAIMS FOR EXTRAS WILL NOT BE ALLOWED UNLESS THE CONTRACTOR HAS NOTIFIED THE OWNER AND SUPERVISING ENGINEER IN WRITING, INCLUDING AN AGREED-TO REMBURSEMENT SCHEDULE, PRIOR TO PERFORMING THE EXTRA WORK.

INTENT OF THE DOCUMENTS

IT IS THE INTENT OF THE DRAWINGS AND THE SPECIFICATIONS TO REQUIRE THE COMPLETION OF THE WORK IN A THOROUGH AND WORKMANLIKE MANNER IN EVERY RESPECT.

DESCRIPTION OF WORK

THE CONTRACTOR SHALL FURNISH PERMITS, LICENSES, FEES, MATERIAL, LABOR, TOOLS, PLANT, SUPPLIES, EQUIPMENT, TRANSPORTATION, SUPERINTENDENCE, TEMPORARY CONSTRUCTION OF EVERY NATURE, INSURANCE, TAXES, CONTRIBUTIONS, AND ALL OTHER SERVICES AND FACILITIES, UNLESS SPECIFICALLY EXCEPTED NECESSARY TO COMPLETE THIS PROJECT.

LIABILITY AND COMPENSATION INSURANCE

THE CONTRACTOR SHALL MAINTAIN AT ALL TIMES, FULL AND UNLIMITED WORKMANS COMPENSATION INSURANCE IN ACCORDANCE WITH THE LABOR CODE OF THE STATE OF CALIFORNIA, AND SHALL CARRY PUBLIC CONTINGENT LIABILITY OF INSURANCE, IN AMOUNTS SATISFACTORY TO AND IN COMPANIES SELECTED WITH THE CONSENT OF THE OWNER.

PERMITS

THE CONTRACTOR SHALL OBTAIN THE BUILDING PERMIT, AND ALL OTHER CERTIFICATIONS, INSPECTION REPORTS, RELEASES, JURISDICTIONAL SETTLEMENTS, NOTICES, RECEIPTS FOR FEE PAYMENTS, JUDGMENTS, AND SIMILAR DOCUMENTS, CORRESPONDENCE AND RECORDS IN COLLECTION.

SUBCONTRACTOR'S STATUS

EVERY ITEM MENTIONED IN THE SPECIFICATIONS IS INTENDED TO REPRESENT THE QUALITY OF MATERIALS THAT WILL BE DEMANDED. SHOULD THE SUBCONTRACTOR WISH TO SUGGEST ANY SUBSTITUTES THAT HE CONSIDERS EQUAL IN VALUE AND EFFICIENCY WITH THE ONE SPECIFIED, HE SHALL STATE WHAT THE ITEM SUGGESTED IS, AND THE DIFFERENCE IN COST, IF ANY.

IF SUBSTITUTES OF MATERIALS (EQUIVALLY GOOD) ARE OFFERED AT THE TIME BIDS ARE SUBMITTED, THEY WILL BE CONSIDERED. IN THE EVENT THE OWNER WISHES TO ACCEPT THE SUBSTITUTE, ARRANGEMENTS WILL BE MADE FOR THE CHANGE BEFORE ENTERING INTO A CONTRACT.

IF NO ITEMS ARE SUGGESTED AS A SUBSTITUTE AT THE TIME THE BIDS ARE SUBMITTED, THEN NO DEVIATION WILL BE ALLOWED FROM THE MATERIALS SPECIFIED WITHOUT FIRST RECEIVING THE APPROVAL OF THE OWNER.

WORKMAN SAFETY-EXCAVATIONS

ALL REGULATIONS OF THE STATE OR FEDERAL AGEN SHOULD BE FOLLOWED BEFORE ALLOWING WORKMEN IN A TRENCH OR OTHER EXCAVATION.

IF EXCAVATIONS ARE TO BE MADE DURING THE RAINY SEASON PARTICULAR CARE SHOULD BE GIVEN TO INSURE THAT PERMS OR OTHER DEVICES PREVENT SURFACE WATER FROM FLOWING OVER THE TOP OF THE EXCAVATION OR PONDING AT THE TOP OF THE EXCAVATIONS.

NO TRENCHES OR EXCAVATIONS SHALL BE 5' OR MORE IN DEPTH INTO WHICH A PERSON IS REQUIRED TO DESCEND, OR OBTAIN NECESSARY PERMIT FROM THE STATE OF CALIFORNIA DIVISION OF INDUSTRIAL SAFETY PRIOR TO ISSUANCE OF A BUILDING OR GRADING PERMIT.

WRAP AND PROTECT ALL UTILITY LINES IN WAY OF CONSTRUCTION PER STANDARD CONSTRUCTION PRACTICES

TIMBER

1) ALL TIMBER DESIGN AND CONSTRUCTION SHALL BE PER 2022 CBC CHAPTER 19 AND 2020 NATIONAL DESIGN SPECIFICATION (NDS). ALL SAWN LUMBER SHALL BE GRADED BY EITHER NWFA OR WCLD.

2) UNJO, ALL WOOD SILL PLATES AND LEDGERS BEARING ON CONCRETE OR MASONRY SHALL BE PRESSURE TREATED DOUGLAS FIR-LARCH. ANCHOR BOLTS SHALL BE 5/8" DIAMETER SPACED A MAXIMUM 4'-0" o.c. AND WITHIN 12" AND GREATER THAN SEVEN BOLT DIAMETERS FROM EACH END OF A SILL FROM A HOLE, OR FROM A NOTCH GREATER THAN 1/3 THE WIDTH OF THE SILL. SEE SHEARWALL SCHEDULE FOR OTHER REQUIREMENTS.

3) ALL WALL BRACING AND MATCHING OF STUDS SHALL CONFORM TO SECTION 23029.33 OF THE 2022 CALIFORNIA BUILDING CODE.

4) UNLESS NOTED OTHERWISE ON FRAMING PLANS:

ROOF SHEATHING SHALL BE 15/32" APA-RATED SHEATHING, EXPOSURE I, MIN. SPAN RATING 24/0, NAILED WITH 8d COMMON @ 6" o.c. EDGES & BOUNDARIES AND 12" o.c. AT INTERMEDIATE FRAMING MEMBERS.

FLOOR SHEATHING SHALL BE 23/32" APA-RATED STURD-FLOOR, T&G, EXPOSURE I, MIN. SPAN RATING 20" o.c., NAILED WITH 1d COMMON @ 6" o.c. AT EDGES & BOUNDARIES AND 12" o.c. AT INTERMEDIATE FRAMING MEMBERS.

SHEARWALL SHEATHING SHALL BE APA "STRUCTURAL I" RATED, EXPOSURE I, GROUP I, NAILING PER SHEARWALL SCHEDULE.

ALL WOOD STRUCTURAL PANEL SHEATHING SHALL BE GRADE MARKED BY APA, T&G, OR PTL AND SHALL CONFORM TO PS-1-9, PS-2-10, OR FRP-1-02.

TRASH REMOVAL

THE CONTRACTOR SHALL PROMPTLY REMOVE FROM THE BUILDING, LOT, SIDEWALKS, AND STREETS - ALL RUBBISH AND DIRT, AS IT ACCUMULATES, DUE TO THE WORK DONE UNDER THIS CONTRACT.

ALL COMBUSTIBLE DEBRIS SHALL BE REMOVED FROM THE BUILDING ON A DAILY BASIS.

FOUNDATION

1) CONCRETE SHALL HAVE A MINIMUM ULTIMATE COMPRESSIVE STRENGTH OF 3500 PSI AT 28 DAYS FOR FORMED-IN-PLACE CONTINUOUS AND SPREAD FOOTINGS, AND 3000 PSI (SPECIAL INSP. REQ'D) AT 28 DAYS FOR GRADE BEAMS.

2) PORTLAND CEMENT SHALL BE TYPE II PER ASTM C 150. AGGREGATES SHALL BE PER ASTM C39 WITH MAXIMUM SIZE OF 1 1/2" FOR FOOTINGS AND 1" FOR ALL OTHER WORK.

3) REINFORCING STEEL SHALL BE ASTM A615, GRADE 60, CLEAN AND RUST FREE. LAPS AT SPICES AND FOUR LINES TO BE 40 BAR DIAMETERS (2'-0" MINIMUM) UNLESS NOTED OTHERWISE ON PLANS.

4) UNJO, SLABS ON GRADE SHALL BE 4" THICK WITH #2 BARS @ 16" o.c. EACH WAY WITH 2 INCH COVER AT BOTTOM. 4" CLEAN SAND SHALL BE PLACED BELOW THE SLAB WITH A 10 MIL PLASTIC VAPOR BARRIER PER ASTM E26 & ASTM E146 PLACED AT MID-HEIGHT. BARS SHALL BE LAPPED 20". SEE SOLS REPORT (IF AVAILABLE) FOR OTHER REQUIREMENTS.

5) ALL NEW SILL PLATE ANCHOR BOLTS TO BE INSTALLED IN FRESH CONCRETE SHALL BE 5/8" DIAMETER ABOUT 1" BOLTS SPACED PER PLAN AND SHEARWALL SCHEDULE WITH MINIMUM 7' EMBEDMENT. MAXIMUM ANCHOR BOLT SPACING SHALL BE 4'-0" o.c. ANCHOR BOLTS AT ENDS OF WALL PANELS SHALL BE LOCATED WITHIN 12" AND GREATER THAN 7 BOLT DIAMETERS FROM THE END OF SILL PLATE. THERE SHALL BE A MINIMUM OF TWO ANCHOR BOLTS PER WALL PANEL. ANCHOR BOLTS TO EXISTING FOOTINGS PER NOTE #10 BELOW. PLATE WASHERS A MINIMUM 9"x10"x32S7 THICK SHALL BE USED ON EACH BOLT. ALL CONNECTORS AND METAL HARDWARE IN CONTACT WITH PRESSURE TREATED TIMBER SHALL HAVE CORROSION RESISTANT COATINGS OR PROTECTION, SUCH AS "ZMAX", HOT DIPPED GALVANIZED, OR BE STAINLESS STEEL.

6) IF NO SOLS REPORT IS PROVIDED, ASSUMED ALLOWABLE SOIL BEARING PRESSURE (ASBP) SHALL BE 800 PSF (PER SOIL SITE CLASS D) AND EMBED FOOTINGS A MINIMUM OF 24" INTO COMPETENT SOIL.

7) REINFORCEMENT CLEARANCES FOR FOOTINGS AND GRADE BEAMS (UNJO):

A) FURRED AGAINST EARTH - 3"

D) FORMED SURFACE - 2"

8) REMOVAL OF FORMS:

A) SUPPORTING VERTICAL SURFACES - 2 DAYS MINIMUM

B) SUPPORTING BEAMS & GIRDERS - 15 DAYS MINIMUM

9) REINFORCING SHALL BE CONTINUOUS AROUND CORNERS AND THROUGH INTERSECTIONS.

10) ALL NEW SILL PLATE ANCHOR BOLTS TO BE INSTALLED INTO EXISTING FOOTINGS SHALL BE SIMPSON TITAN HD ANCHOR (1/2"-ES-ESR-105/LARR# 25560).

14) CONSTRUCTION JOINTS SHALL BE PREPARED BY WIRE BRUSHING, CLEANING AND BRUSHING IN A PASTE OF NEAT CEMENT MORTAR IMMEDIATELY PRIOR TO POURING. LOCATION OF CONSTRUCTION JOINT SHALL BE APPROVED BY THE PROJECT STRUCTURAL ENGINEER.

15) ALL CONNECTORS AND METAL HARDWARE IN CONTACT WITH PRESSURE TREATED TIMBER SHALL HAVE CORROSION RESISTANT COATINGS OR PROTECTION, SUCH AS "ZMAX", HOT DIPPED GALVANIZED, OR BE STAINLESS STEEL.

16) PRIOR TO POURING INTERIOR CONCRETE FLOOR SLABS, ALL SOL BELOW FLOOR SHALL BE COMPACTED TO REQUIRED 90% RELATIVE DENSITY AND MOISTENED TO A DEPTH NOT LESS THAN 18".

17) DEEPEN NEW FOOTINGS AS NECESSARY TO OBTAIN REQUIRED EMBEDMENT FOR ALL NEW HOLD DOWN BOLTS. ALL HOLD DOWN BOLTS TO HAVE A MINIMUM OF 3" OF CONCRETE COVER TO SOL & BOTTOM.

FRAMING

ROOF DIAPHRAGM

15/32" APA RATED SHEATHING (MIN), EXPOSURE I, 24/0 MAX. SPAN RATING, w/ 8d COMMON NAILS @ 6" o.c. AT BOUNDARY & PANEL EDGE NAILING (EN), AND 12" o.c. AT INTERMEDIATE FRAMING MEMBERS.

FLOOR DIAPHRAGM

23/32" APA STURD-FLOOR, EXPOSURE I, TONGUE AND GROOVE, w/ 1d COMMON NAILS @ 6" o.c. AT BOUNDARY & PANEL EDGE NAILING (EN), AND 12" o.c. AT INTERMEDIATE FRAMING MEMBERS.

FRAMING

• BUILT-UP WOOD FRAMING MEMBERS MAY NOT BE SUBSTITUTED FOR 4x AND WIDER BEAMS UNLESS NOTED BY ENGINEER.

• ALL (2) 2x ROOF & FLOOR FRAMING TO HAVE MIN. 16d AT 12" O.C. T&G, STAGGERED.

• ALL (3) 2x FRAMING TO HAVE MIN. 1/2" DIAMETER BOLTS AT 18" O.C. T&G, STAGGERED.

• 2x SOLID BLOCKING REQUIRED AT POINTS OF SUPPORT FOR ALL HORIZONTAL FRAMING MEMBERS.

IN ADDITION, ALL 2x10 AND LARGER MEMBERS SHALL HAVE SOLID FULL DEPTH BLOCKING OR BRACING AT MAX. 16'-0" o.c.

• ALL WOOD POSTS AT UPPER FLOORS TO CONTINUE TO BEAM OR FOUNDATION.

• UNLESS DETAILED OTHERWISE, ALL RIDGE / HIP / VALLEY CONNECTIONS TO HAVE A SIMPSON A95 CONNECTOR AT EACH CORNER WITH A 2x KICKER TO BEARING WALL.

• AT ROOF-TO-WALL FRAMING, PROVIDE A95 FRAMING ANCHORS PER SHEARWALL SCHEDULE OR AT MAX. 48" O.C. FROM PLATES TO RAFTERS AND RAFTER BLOCKING AROUND PERIMETER OF BUILDING AND AT DRAG LINES AS INDICATED ON PLANS (SEE PLANS WHERE OTHER REQUIREMENTS MAY OCCUR).

• ALL FIRST FLOOR AND SUBTERRANEAN LEVEL PROVIDE A95S PER SHEARWALL SCHEDULE OR AT 32" O.C. MAX. FROM PLATES TO FLOOR JOISTS AND BLOCKING AROUND PERIMETER OF BUILDING AND AT DRAG LINES AS INDICATED ON PLANS (SEE PLANS WHERE OTHER REQUIREMENTS MAY OCCUR).

• PROVIDE DOUBLE JOISTS UNDER ALL PARALLEL WALLS, UNJO.

• WHEN SHEAR WALLS ARE SUPPORTED BY WOOD JOISTS THAT ARE PERPENDICULAR TO THE SHEAR WALL, ATTACH SOLID 4x BLOCKING UNDER SHEAR WALLS BETWEEN JOISTS. PROVIDE 2x SOLID BLOCKING UNDER NON-SHEAR WALLS PERPENDICULAR TO FLOOR JOISTS. SEE PLANS AND DETAILS FOR ANY.

ADDITIONAL REQUIREMENTS:

• ATTACH MIN. 2x SOLID BLOCKING AND EDGE NAIL THE PERIMETER OF ALL OPENINGS OVER 10" IN WIDTH OR LENGTH IN ALL SHEAR PANELS AND DIAPHRAGMS. SEE DETAILS WHERE OTHER REQUIREMENTS MAY OCCUR.

• PROVIDE A MINIMUM 3x4 OR 2x6 @ 16" FOR ALL STUD WALLS SUPPORTING TWO OR THREE FLOORS WITH 12" MAX PLATE HEIGHTS.

• ALL CONNECTORS AND METAL HARDWARE IN CONTACT WITH PRESSURE TREATED TIMBER SHALL HAVE CORROSION RESISTANT COATINGS OR PROTECTION, SUCH AS "ZMAX", HOT DIPPED GALVANIZED, OR BE STAINLESS STEEL.

REINFORCING STEEL

ALL PRIMARY REINFORCEMENT SHALL CONFORM TO ASTM A-615, GRADE 60 KSI, STEEL.

ALL TIES AND STIRRUPS SHALL CONFORM TO ASTM A-615, GRADE 60 KSI, STEEL.

SPICES OF REINFORCING SHALL BE LAPPED A MINIMUM OF 40 BAR DIAMETERS UNLESS SPECIFIED ON PLANS AND SECURELY WIRED TOGETHER, USING A MINIMUM OF 16 GA. WIRE. SPICES OF ADJACENT REINFORCING BARS SHALL BE STAGGERED WHEREVER POSSIBLE.

TIMBER

1) HORIZONTAL WOOD STRUCTURAL PANELS SHALL BE LAD WITH THE LONG DIMENSION AND FACE GRAIN PERPENDICULAR TO THE RAFTERS OR JOISTS, AND THE SHEETS SHALL BE STAGGERED AS SHOWN IN 2022 CBC TABLE 23062.2 (CAPES I AND 9). EACH SHEET SHALL CONTAIN A MINIMUM OF 8 SQUARE FEET AND EXTEND TO 3 SUPPORTS. 1/8" SPACING BETWEEN PANEL ENDS AND EDGES IS REQUIRED. ALL WOOD STRUCTURAL PANEL DIAPHRAGMS SHALL BE REVIEWED BY CONTRACTOR FOR COMPLIANCE WITH NAILING AND PANEL REQUIREMENTS BEFORE FINISH IS APPLIED.

4) UNJO, ALL 2x ROOF RAFTER AND FLOOR JOIST FRAMING MEMBERS SHALL BE MINIMUM GRADE DOUGLAS FIR-LARCH NO. 2 OR BETTER. ALL BEAMS, HEADERS, AND POSTS SHALL BE MINIMUM DOUGLAS FIR-LARCH NO. 1 OR BETTER. ALL VERTICAL WALL FRAMING MEMBERS SHALL BE DOUGLAS FIR-LARCH NO. 2 OR BETTER.

7) ALL PS1 AND LVL ENGINEERED FRAMING MEMBERS SHOWN ON PLANS TO BE 23E PARALLAM (E=2200 ksi) 1) AND LVL MICROLAM BEAMS (E=1800 ksi), RESPECTIVELY, AS DESCRIBED IN CG-ES-ESR-105 & CG-ES-ESR-107. ALL WOOD I-JOIST MEMBERS SHOWN ON PLANS TO BE AS DESCRIBED IN ESR-105.

8) MOISTURE CONTENT OF SAWN LUMBER AT TIME OF INSTALLATION SHALL NOT EXCEED 19%.

9) ALL BOLT HEADS AND NUTS BEARING ON WOOD SHALL HAVE WASHERS. HOLES IN WOOD FOR BOLTS SHALL BE DRILLED MAX. 1/16" LARGER THAN NOMINAL BOLT SIZE.

10) NOTCHING OR DRILLING HOLES IN BEAMS OR JOISTS SHALL BE ONLY AS DETAILED PER ENGINEER AND SHALL COMPLY WITH 2022 CBC SECTION 23029.30 & 23029.31.

11) ALL SAWN LUMBER (2x, 4x, 6x) RAFTERS, FLOOR JOISTS, AND BEAMS SHALL HAVE SOLID WOOD BLOCKING AT ALL POINTS OF SUPPORT. MEMBERS WITH NOMINAL DEPTH 12" OR GREATER SHALL HAVE 2x FULL DEPTH SOLID BLOCKING OR CROSS BRIDGING SPACED AT 8'-0" FOR MAXIMUM.

12) UNJO, ALL FRAMING CONNECTION HARDWARE SHALL BE AS MANUFACTURED BY THE SIMPSON STRONG-TIE COMPANY AND SHALL BE REFERENCED AS SHOWN IN THEIR LATEST CATALOG. ALL CONNECTOR NAILS AND BOLTS SHALL BE AS DESIGNATED PER MANUFACTURER. ALTERNATE MANUFACTURER CONNECTOR HARDWARE MAY BE USED PROVIDED ENGINEER'S WRITTEN APPROVAL IS OBTAINED BY CONTRACTOR AND CC APPROVAL IS PROVIDED.

13) TOP PLATES SHALL LAP LOWER PLATES AT CORNERS, AND BREAKS AT PLATE SHALL BE LAPPED A MINIMUM OF 4'-0", WITH 20-16d NAILS ON EACH SIDE.

14) ALL BEAMS SHALL BE SUPPORTED BY POSTS OR ORDERS. FOR 4x8 AND SMALLER BEAMS A MINIMUM (2)-2x4 DF. #2 POST SHALL BE USED. UNJO. FOR 4x10 AND LARGER BEAMS A MINIMUM 4x4 DF. #1 POST SHALL BE USED. UNJO. ALL POSTS SHALL PROVIDE FULL BEARING WIDTH FOR THE BEAM, UNJO.

15) ALL POSTS SHALL BE CONTINUED BETWEEN FLOORS WITH SOLID FULL WIDTH BLOCKING AND A POST OF EQUAL OR GREATER SIZE BELOW, UNTIL A BEAM OR FOUNDATION IS ENCOUNTERED. ALL POSTS INSIDE WALLS MAY BEAR ON THE SOLE OR SILL PLATE, UNJO. ISOLATED POSTS SHALL BE SEATED IN POST OR COLUMN DOWNS PER PLAN.

16) ALL WALLS HIGHER THAN 12'-0" SHALL BE 2x6 OR 3x6 STUDS @ 16" o.c., UNLESS SPECIFICALLY DESIGNED OTHERWISE BY ENGINEER. ALL WALLS CONTAINING MECHANICAL PIPING 2" IN DIAMETER OR LARGER SHALL BE FRAMED WITH 2x6 STUDS @ 16" o.c.

17) CUTTING, NOTCHING, OR BORING HOLES IN STUDS SHALL COMPLY WITH 2022 CBC SECTION 23029.30 & 23029.31.

18) FRAMING AND NAILING NOT SPECIFICALLY DETAILED ON THE PLANS ARE TO CONFORM TO 2022 CBC TABLE 23062.2. COMMON NAILS ARE REQUIRED FOR ALL SHEARWALL, FLOOR AND ROOF DIAPHRAGMS. USE DOUBLE JOISTS UNDER PARALLEL PARTITIONS, UNJO. DOUBLED HORIZONTAL MEMBERS SHALL BE STITCH-WALLED TOGETHER WITH TWO ROWS OF 16d NAILS @ 12" o.c. STAGGERED, UNLESS OTHERWISE DETAILED. TRIPLED HORIZONTAL MEMBERS SHALL HAVE MIN. 1/2" DIAMETER BOLTS AT 18" O.C. T&G, STAGGERED.

19) ANCHOR BOLTS TO SILL AND SOLE PLATES SHALL HAVE NUTS DRIVEN FLUSH WITH SQUARE PLATE WASHERS IN ACCORDANCE WITH THE FOLLOWING SCHEDULE:

BOLT DIAMETER	PLATE SIZE
5/8"	02125" x 3" x 3"
3/4"	5/16" x 3" x 3"
1"	5/16" x 3" x 3"
	3/8" x 3 1/2" x 3 1/2"

THE ABOVE SCHEDULE ALSO APPLIES TO LAG SCREWS DRIVEN INTO SOLE PLATES FOR RAISED FLOOR AND UPPER STORY CONDITIONS.

20) LAG SCREWS SHALL BE INSTALLED IN PRE-DRILLED HOLES. THE CLEARANCE HOLE FOR THE SHANK PORTION SHALL HAVE THE SAME DIAMETER AND DEPTH AS THE SHANK. THE LEAD HOLE FOR THE THREADED PORTION SHALL HAVE A DIAMETER EQUAL TO 40%-70% OF THE SHANK DIAMETER FOR ALL DOUG-FIR LARCH MEMBERS). LAG SCREWS ARE TO BE INSTALLED WITH THE TURN OF A WRENCH. DRIVING, AS WITH A HAMMER, IS NOT PERMITTED.

21) MINIMUM NAILING SHALL BE PER TABLE 23040.2 OF THE 2022 CBC.

22) ALL CONNECTORS AND METAL HARDWARE IN CONTACT WITH PRESSURE TREATED TIMBER SHALL HAVE CORROSION RESISTANT COATINGS OR PROTECTION, SUCH AS "ZMAX", HOT DIPPED GALVANIZED, OR BE STAINLESS STEEL.

STRUCTURAL STEEL

1) ALL STRUCTURAL STEEL SHALL CONFORM TO SECTION 22021 - 2022 CBC.

W-WIDE FLANGE SHAPES: ASTM A992, Fy = 50-65 KSI
PLATES, ANGLES, CHANNELS: ASTM A36, Fy = 36 KSI
HOLLOW TUBE SHAPES: ASTM A500, GRADE B, Fy = 46 KSI
ROUND PIPE SHAPES: ASTM A53, GRADE B, Fy = 36 KSI

2) ALL STRUCTURAL STEEL SHALL BE FABRICATED IN A SHOP APPROVED BY THE LOCAL MUNICIPAL BUILDING DEPARTMENT.

3) STRUCTURAL SHOP DRAWINGS SHALL BE SUBMITTED TO THE STRUCTURAL ENGINEER FOR REVIEW PRIOR TO FABRICATION.

4) ALL STRUCTURAL STEEL SHALL BE IDENTIFIED PER 2022 CBC. DESIGN OF STEEL MEMBERS SHALL BE PER ASD PROVISIONS IN THE 2022 CBC SECTION 22051 & 22052.

5) STRUCTURAL STEEL SHALL HAVE A SHOP CONT OF RED-OXIDE PRIMER.

6) AFTER ERECTION, ALL FIELD CONNECTIONS, BOLTS, WELDS, AND ALL ABRADED PLACES ON THE SHOP PAINT SHALL BE TOUCHED UP WITH THE SAME TYPE OF PAINT AS THE SHOP COAT.

7) FIELD AND SHOP WELDING SHALL BE DONE BY A FULLY CERTIFIED WELDER USING LOW-HYDROGEN E70-T4 ELECTRODE RODS, UNLESS NOTED OTHERWISE. CONTINUOUS INSPECTION BY A REGISTERED INSPECTOR IS REQUIRED FOR FIELD WELDING. ALL WELDING SHALL BE PER AWS, LATEST EDITION, AND AWS SPECIFICATIONS.

8) BOLTS SHALL BE OF A807 QUALITY WITH WASHERS, UNLESS OTHERWISE SPECIFIED ON PLANS. ANY HIGH STRENGTH A805 OR A806 BOLTS SHALL HAVE SPECIAL INSPECTION, UNLESS NOTED OTHERWISE.

9) STEEL ERECTOR SHALL PROVIDE ALL ERECTION DRAWINGS REQUIRED TO MAINTAIN STRUCTURE PLUMB AND PROPERLY BRACED DURING CONSTRUCTION.

10) ALL STRUCTURAL STEEL SHALL BE DESIGNED BASED UPON THE ALLOWABLE STRESS DESIGN METHOD PER AWS 360.

CONCRETE

1) ALL PHASES OF WORK PERTAINING TO CONCRETE CONSTRUCTION SHALL CONFORM TO 2022 CBC CHAPTER 19 (BASED ON ACI-308, LATEST ADOPTED EDITION) FOR REINFORCED CONCRETE.

2) MINIMUM ULTIMATE COMPRESSIVE CONCRETE STRENGTHS (F'c) SHALL BE:

SLAB ON GRADE	2600 PSI @ 28 DAYS
STRUCTURAL DECK	3000 PSI @ 28 DAYS
COLUMNS	3000 PSI @ 28 DAYS
FOOTINGS	3000 PSI @ 28 DAYS
CONCRETE/GRADE BEAMS	3000 PSI @ 28 DAYS
CASINGS	3000 PSI @ 28 DAYS

3) CONTINUOUS INSPECTION BY AN APPROVED DEPUTY INSPECTOR IS REQUIRED FOR CASINGS, GRADE BEAMS, STRUCTURAL SLABS, AND OTHER CONCRETE MEMBERS WHERE DESIGN COMPRESSIVE STRENGTH VALUE EXCEEDS 2500 PSI.

4) CEMENT SHALL BE TYPE II, LOW ALKALI, CONFORMING TO ASTM C-60.

5) ALL PRIMARY REINFORCEMENT SHALL BE PER ASTM A-615, GRADE 60 KSI STEEL. ALL TIES AND STIRRUPS SHALL CONFORM TO ASTM A-615, GRADE 40 KSI STEEL.

6) UNLESS NOTED OTHERWISE, SPICES OF REINFORCING SHALL BE LAPPED A MINIMUM OF 40 BAR DIAMETERS AND SECURELY WIRED TOGETHER, USING A MINIMUM OF 16 GA. WIRE. SPICES OF ADJACENT REINFORCING BARS SHALL BE STAGGERED WHEREVER POSSIBLE. WHERE SPECIFICALLY CALLED OUT, WELDING OF REINFORCING BARS SHALL BE PERFORMED BY A CERTIFIED WELDER USING E50 SERIES ELECTRODES PER AWS, LATEST EDITION.

7) INTERIOR CONCRETE SLABS ON GRADE SHALL HAVE A STEEL TROWEL FINISH. DRIVEWAYS, WALKS, AND GARAGE SLABS SHALL HAVE A BROOM FINISH AND SHALL BE FITTED TO SIEVE WATER.

8) PRIOR TO POURING INTERIOR CONCRETE FLOOR SLABS, ALL SOL BELOW FLOOR SHALL BE COMPACTED TO REQUIRED DENSITY AND MOISTENED TO A DEPTH NOT LESS THAN 18" PER SOLS REPORT.

9) CLEAR COVERAGE OF CONCRETE OVER REINFORCING BARS, ANCHOR BOLTS, AND ALL OTHER CONCRETE INSERTS, UNLESS OTHERWISE SPECIFIED, SHALL BE AS FOLLOWS:

FOURED AGAINST EARTH	3" CLEAR
FORMED CONCRETE	2" CLEAR

10) FORMS FOR CONCRETE SHALL BE Laid OUT AND CONSTRUCTED TO PROVIDE THE SPECIFIED CAMBERS SHOWN ON THE DRAWINGS. DECK CAMBERING SHOWN ON PLANS IS INTENDED TO PROVIDE A LEVEL DECK. ANY SLOPING FOR DRAINAGE SHALL BE ADDED OR SUBTRACTED FROM CAMBERING AS APPROPRIATE. THE DECK THICKNESS SHALL NOT BE REDUCED IN ORDER TO ACHIEVE DECK SLOPES.

11) DRYPACK UNDER BASEFLATES, SILL PLATES, AND WHERE OTHERWISE NOTED ON DRAWINGS SHALL CONSIST OF APPROVED NON-SHRINK HIGH STRENGTH GROUT. WHEN SPACE BETWEEN TWO SURFACES REQUIRES DRYPACK, IT SHALL BE PACKED BY TAMPING OR RAMMING WITH A BAR OR ROD UNTIL THE VOIDS ARE COMPLETELY FILLED.

12) PLACEMENT OF CONCRETE SHALL CONFORM TO ACI LATEST STANDARD AND PROJECT SPECIFICATIONS. WIRE BRUSH OR SANDBLAST ALL CONCRETE SURFACES AGAINST WHICH CONCRETE IS TO BE PLACED.

13) IF COLUMNS AND WALLS ARE PLACED WITH FLOORS, MINIMUM TIME OF TWO HOURS MUST ELAPSE BETWEEN END OF COLUMN OR WALL POUR AND BEGINNING OF FLOOR POUR.

14) PROVIDE SLEEVES FOR PLUMBING AND ELECTRICAL OPENINGS IN CONCRETE BEFORE PLACING. DO NOT CUT ANY REINFORCING WHICH MAY CONFLICT. COPIING IN CONCRETE IS NOT PERMITTED, EXCEPT AS SHOWN, NOTIFY THE PROJECT STRUCTURAL ENGINEER IN ADVANCE OF CONDITIONS NOT SHOWN ON THE STRUCTURAL DRAWINGS.

15) COVER TO BEAM REINFORCEMENT TO BE 2" MINIMUM FORMED CONCRETE & 3" MINIMUM AGAINST EARTH, UNLESS NOTED OTHERWISE.

16) ARCHITECTURAL DRAWINGS TO BE REFERRED TO FOR DECK SLOPES, DRAINAGE, PLUMBING, FRAMING AND ELECTRICAL HARDWARE & ALL DIMENSIONS.

17) REINFORCEMENT CALLED OUT IN DETAILS SHALL BE IN ADDITION TO THAT SHOWN ON PLANS (UNJO). REINFORCING METHODS SHOWN IN DETAILS SHALL BE USED AS APPLICABLE.

18) WHEN A MONOLITHIC PAIR IS NOT POSSIBLE, CONSTRUCTION JOINTS SHALL BE APPROVED BY THE PROJECT STRUCTURAL ENGINEER.

19) SHORING SHALL NOT BE REMOVED UNTIL CONCRETE HAS ACHIEVED MINIMUM 28 DAY COMPRESSIVE STRENGTH. FIFTEEN DAYS AFTER CONCRETE POUR IS COMPLETED THE PROJECT STRUCTURAL ENGINEER MAY DETERMINE, BASED ON COMPRESSION TESTS, IF SHORING MAY BE REMOVED.

20) ALL DECK SURFACES EXPOSED TO WEATHER SHALL BE WATERPROOFED. SEE ARCHITECTURAL DOCUMENTS FOR SPECIFICATIONS.

20) CONCRETE SHALL BE THOROUGHLY CONSOLIDATED IN A MANNER THAT WILL ELIMINATE THE REINFORCEMENT AND INSERTS, FILL THE FORMS, AND PROVIDE A SURFACE OF UNIFORM TEXTURE FREE OF ROCK POCKETS AND EXCESSIVE VOIDS. CONCRETE SHALL BE CONSOLIDATED BY MEANS OF HIGH FREQUENCY INTERNAL VIBRATORS WITHOUT CAUSING WATER OR CEMENT PASTE TO FLUSH TO THE SURFACE. INTERNAL VIBRATOR TYPE, SIZE, AND NUMBER SHALL BE APPROVED BY THE ENGINEER.

22) CONCRETE MIXING COMPANY SHALL PROVIDE TEST RECORDS AND STANDARD DEVIATION PER SECTION 1905 OF 2022 CBC.

SHEAR WALL

1) ONLY COMMON NAILS OR GALVANIZED NAIL NALS SHALL BE PERMITTED FOR REQUIRED NAILING AT VERTICAL SHEAR PANELS AND HORIZONTAL DIAPHRAGMS (ROOF AND FLOOR).

2) ALL SHEARWALLS WITH AN ALLOWABLE SHEAR CAPACITY GREATER THAN 350 PIF REQUIRE 3x MEMBERS AT THE FOUNDATION SILL PLATE AND AT ADJACENT PANEL EDGES. A MINIMUM OF 1/2" EDGE DISTANCE FROM THE PANEL EDGE TO THE CENTER OF THE NAIL IS REQUIRED FOR THESE 3x MEMBERS.

3) ALL HOLD DOWN CONNECTORS SHALL BE TIGHTENED UPST PRIOR TO COVERING THE WALL FRAMING. BOLT HOLES FOR HOLD DOWN CONNECTION TO POST SHALL BE 1/16" (MAX) OVERSIZED. INSPECTOR TO VERIFY HOLD DOWN CONNECTIONS.